

Belzoni Gas Station



MS CONSTRUCTION LAW - 1. PURSUANT TO SECTION 73-1-39, PRIVATELY OWNED BUILDINGS THAT ARE THREE (3) STOREYS IN HEIGHT OR MORE, OR BUILDINGS THAT ARE MORE THAN 100 SQUARE FEET, UNLESS THE PROJECT IS SPECIFICALLY EXEMPTED BY SECTION 73-1-38, 2. PURSUANT TO SECTION 73-1-38, PUBLIC BUILDINGS OWNED BY THE STATE OF MISSISSIPPI IF THE PROJECT CONTAINS MORE THAN TEN THOUSAND (10,000) SQUARE FEET OF GROUND FLOOR AREA, OR IF THE PROJECT IS THREE (3) OR MORE STOREYS IN HEIGHT, UNLESS SPECIFICALLY EXEMPTED BY SECTION 73-1-38.



Dhunna Gas Station - Belzoni
 Project No. 20230703001
 Date 1/26/2024

PURSER & COMPANY | 601.376.9647 DRAWINGS@PURSERANDCOMPANY.COM

650 1st St, Belzoni, MS 39008
 New Construction

Construction Documents

Revision	#	Rev Date
SD	2	1/7/24
DD	3	1/14/23
CD	4	1/26/24

Cover Sheet

000
 G

Project Directory

Project Information

Name: Dhunna Gas Station - Crystal Springs
Address: Highway 27, Crystal Springs, MS 39059

Client

Shivam Dhunna
468 Fairfield Dr.
Madison, MS 39110
(601) 218-8883
Contact: Sunny Dhunna

Architect

Purser & Company, PA
160 McTyre Ave, STE B
Jackson, MS 39202
(601) 376-9647
Contact: Paul Purser (paul@purserandcompany.com)

Drawing Index

Sheet Number	Sheet Name
G-000	Cover Sheet
G-001	Reference
AC101	Site Layout
AS101	Structural Notes
AS102	Foundation & Details
AS103	Framing & Section Details
A-101	First Floor
A-141	Reflected Ceiling Plan
A-201	Building Elevations
A-301	Building Sections
P-101	Plumbing Symbols & Abbreviations
P-103	Plumbing Waste
P-103	Plumbing Supply
P-104	Roof
P-105	Plumbing Details
P-106	Plumbing Schedules
M-101	HVAC Symbols & Abbreviations
M-102	HVAC Floor Plan
M-103	Exhaust
M-104	Roof
M-105	Mechanical Details
M-106	Mechanical Details
M-107	Mechanical Schedules
M-108	Mechanical Details
E-101	Electrical
E-102	Lighting Plan
E-103	Power and Aux Plan
E-104	Electrical Schedules
RV901	Existing Site Photos

Project Notes

Project Alternates

- None

Energy Code Requirements

- IBC 2012 Energy Code is the mandatory energy code standard for this project.
- All mechanical and electrical building system installed should meet all requirements of the energy code.
- Main roof insulation will be 6 inches of open cell spray foam insulation.
- Exterior walls will 5.5 inches of fiberglass batt insulation.
- Continuous air barrier to be provided at building envelope per IBC 2012 Energy Code. Air barrier joints and seams to be sealed and all joints and material transitions. Joints to be securely installed as to not dislodge, loosen or otherwise impair its ability to resist positive and negative pressure from wind or mechanical units.

Thermal Envelope Requirements

- Roofs = R-38 ci (insulation entirely above deck)
- Walls = R-19 + R-7.5ci (wood framed walls)
- Slab on Grade = no requirement

Fenestration Requirements (U-factor)

- Fixed = U-Factor 0.46
- Operable = U-Factor 0.60
- Entrances = U-Factor 0.77
- SHGC = U-Factor 0.25

General Information

- Do not scale drawings. If dimensions are in question, the contractor shall be responsible for obtaining clarification from the architect before continuing with the construction.
- Contractors shall verify, on the site, all dimensions and equipment locations, and notify architect promptly in writing of any discrepancies.
- Contractors shall be responsible to determine the on site conditions and perform all necessary work to complete the project.
- Contractors shall maintain safe methods of egress for occupied buildings and in site area during construction.
- All casework dimensions shall be field verified before unit fabrication or installation.
- Dimensions, notes, finishes, and fixtures shown on typical floor plans shall apply to similar, symmetrical, or opposite hand plans, sections, or details.
- Typical, or typ., shall mean that condition is representative for similar conditions throughout. U.N.O. Details are usually keyed and noted "Typ." only one time when they first occur.
- Partitions are dimensioned from finish face U.N.O.
- Dimensions to masonry are to actual finish face U.N.O.
- Owner to have right of refusal for all materials, furniture, fixtures and good within the limits of the construction contract.

Project Code Requirements

1. Applicable Codes and Standards :

- IBC - International Building Code (2012 edition)
- IMC - International Mechanical Code (2012 edition)
- IPC - International Plumbing Code (2012 edition)
- IEC - International Electrical Code (2012 edition)
- IFC - International Fire Code (2012 edition)
- ADA 2010 - Americans with Disabilities Act

2. Building Code Requirements Occupancy Classification

Group B: Business

B. General Building Heights and Area

- Group B, Type IV; 14,500 SF allowed per floor, 2 stories allowed
- Area modifications for Fire Suppression - x2 = 29,000 SF per floor, 3 stories allowed
- Area perimeter increases - x.75 = 50,750 SF per floor 3 stories allowed.

C. Types of Construction

Construction Type IV requirements:

Primary Structural Frame - 0hr

Bearing Walls

- Exterior - 0hr
- Interior - 0hr
- Non-bearing Walls
- Interior - 0hr
- Floor Construction - 0hr
- Roof Construction - 0hr

D. Means of Egress


Common Path of Egress Travel - 75 ft.

Exit Access Travel Distance - 200 ft.


E. Fire Protection Systems

Fire Suppression - Yes

AC	AIR CONDITIONING	ORF	QUARTZ RESINOUS FLOORING
ABV	ABOVE CEILING TILE	QTR	QUARTRY TILE
ADJ	ADJUSTABLE	R	RISER
AFF	ABOVE FINISH FLOOR	RAD	RADIUS
ALT	ALTERNATE	RB	RUBBER BASE
ALM	ALUMINUM	RBR	RUBBER
AND	AND	RCP	REINFORCED CONCRETE PIPE
APRX	APPROXIMATE	RD	ROOF DRAIN
AV	AUDIO VISUAL	REF	REFERENCE
AVD	AUDIO VISUAL DISPLAY	REFR	REFRIGERATOR
BD	BOARD	REINF	REINFORCED
BLDG	BUILDING	REQ	REQUIRED
BLK	BLOCKING	REV	REVISED
BCC	BOTTOM OF CURB	RH	RIGHT HAND
BOS	BOTTOM OF STEEL	RM	ROOM
BW	BOTH WAYS	RND	ROUND
CAB	CABINET	RO	ROUHG OPENING
CB	CATCH BASIN	ROW	RIGHT OF WAY
CC	CENTER TO CENTER	RPS	ROOF PAPER SYSTEM
CG	CONCRETE COUNTER TOP	RR	RETURN REGISTER
CG	CORNER GUARD	S	SOUTH
CH	CHAMFER	SC	SOLID CORE
CHM	CHAMFER	SCD	SEAT COVER DISPENSER
CJ	CONTROL JOINT	SCH	STAINED/SEALED CONCRETE FLOOR
CLG	CEILING	SCF	SOAP DISPENSER
CLO	CLOSET	SCS	SCHEDULE
CMU	CONCRETE MASONRY UNIT	SD	SECTION
CO	CLEAN OUT	SECT	SHEET
COL	COLUMN	SHTH	SHATHING
CONC	CONCRETE	SI	SCORE JOINT
CONT	CONTINUOUS	SLW	SEAMLESS LIQUID WALL COVERING
CORR	CORRIDOR	SND	SANITARY NAPKIN DISPENSER
CPT	CARPET	SNDJ	SANITARY NAPKIN DISPOSAL UNIT
CR	CRASH RAIL	SNTD	SANITARY NAPKIN / TAMPON DISPENSER
CT	CERAMIC TILE	SP	SOUNDPROOF
CTR	CENTERED	SPCR	SPECIFICATIONS
CYP	CYPRESS	SPTC	SPECIMEN PASS THRU CABINET
DBH	DISPOSAL BAG HOLDER	SQ	SQUARE
DBL	DOUBLE	SS	SANITARY SEWER
DET	DETAIL	SSD	SHOWER SOAP DISPENSER
DF	DRINKING FOUNTAIN	STL	STAINLESS STEEL
DIA	DIAMETER	STC	SOUND TRANSMISSION COEFFICIENT
DIAG	DIAGONAL	STD	STANDARD
DM	DIMENSION	STL	STEEL
DISP	DISPENSER	STOR	STORAGE
DN	DOWN	SUPP	SUPPLEMENTAL
DRW	DECAY RESISTANT WOOD	SHT	SHEET
E	EAST	SVSK	SERVICE SINK
EACH	EACH	SWR	SHOWER
EDF	ELECTRIC DRINKING FOUNTAIN	SWRC	SHOWER CURTAIN
EHD	ELECTRIC HAND DRIVER	SYP	SOUTHERN YELLOW PINE
EIFS	EXTERIOR INSULATING FINISH SYSTEM	T	TREAD
EJ	EXPANSION JOINT	T&B	TOP & BOTTOM
ELEC	ELECTRICAL	T&G	TONGUE & GROOVE
ELEV	ELEVATION	TB	TOWEL BAR
ELVR	ELEVATOR	TBD	TO BE DETERMINED
EQ	EQUAL	TBR	TO BE REMOVED
EW	EACH WAY	TEL	TELEPHONE
EFW	ENGINEERED WOOD FLOORING	TEMP	TEMPORARY
EXH	EXHAUST	TH	THRESHOLD
EXIST	EXISTING	THK	THICK/THICKNESS
EXP	EXPANSION	TLT	TOILET
EXT	EXTERIOR	TME	TO MATCH EXISTING
FCF	FINISHED CONCRETE FLOOR	TOC	TOP OF CURB
FCO	FLOOR CLEAN OUT	TOS	TOP OF STEEL
FD	FLOOR DRAIN	TPD	TOILET PAPER DISPENSER
FE	FIRE EXTINGUISHER	TPH	TOILET PAPER HOLDER
FEC	FIRE EXTINGUISHER CABINET	TR	TRANSOM
FFE	FINISH FLOOR ELEVATION	TV	TELEVISION
FIN	FINISH	TYP	TYPICAL
FLG	FLOORING	UC	UNDERCOUNTER
FLOR	FLOURESCENT	UNO	UNLESS NOTED OTHERWISE
FND	FLOOR	VB	VAPOR BARRIER
FOF	FACE OF FINISH	VD	VISUAL DISPLAY
FOM	FACE OF MASONRY	VCT	VISUAL COMMUNICATION BOARD
POS	FACE OF STUD	VCT	VINYL COMPOSITE TILE
FPP	FIRE PROOF	VF	VERIFY IN FIELD
FRP	FIBERGLASS REINFORCED PANEL	VT	VINYL TILE
FRT	FIRE RETARDANT	VTR	VENT THROUGH ROOF
FT	FOOT/FEET	VWC	VINYL WALL COVERING
FTG	FOOTING	W	WEST
FWC	FABRIC WALLCOVERING	W	WITH
G	GAS	WB	WOOD BASE
GA	GAUGE	WC	WOOD CLOSET
GB	GRAB BAR	WCT	WOOD COUNTER TOP
GC	GENERAL CONTRACTOR	WD	WOOD BASE
GCT	GRANITE COUNTER TOP	WDT	WIDTH
GL	GLASS/GLAZING	WDW	WINDOW
GT	GRANITE TILE	WG	WALL GUARD
GWB	GYPSON DRYWALL	WH	WATER HEATER
GYP	GYPSON	WP	WATERPROOFING
HB	HOSE BIB	WR	WATER RESISTANT
HC	HOLLOW CORE	WSC	WAINSCOT
HD	HEAVY DUTY		
HDR	HEADER		
HDW	HARDWARE		
HGT	HEIGHT		
HM	HOLLOW METAL		
HOW	HORIZONTAL		
HR	HAND RAIL		
HTG	HEATING		
HVAC	HEATING/VENTILATION/AIR CONDITIONING		
HYD	HYDRANT		
ID	INSIDE DIAMETER		
INSUL	INSULATION		
INT	INTERIOR		
INV	INVERT		
JAN	JANITOR		
JC	JENITORS CLOSET		
JST	JOIST		
JO	JOINT		
KD	KNOCK DOWN		
KIT	KITCHEN		
KO	KNOCK OUT		
KPL	KICKPLATE		
L	LENGTH		
LAB	LABORATORY		
LAD	LADDER		
LAM	LAMINATE		
LAV	LAVATORY		
LAWP	LIQUID APPLIED WATER PROOFING		
LBL	LABEL		
LF	LINEAR FEET		
LH	LEFT HAND		
LW	LINOLEUM		
LL	LIVE LOAD		
LPP	LAVATORY PIPING PROTECTION		
LT	LIGHT		
LTG	LIGHTING		
LVT	LUXURY VINYL TILE		
LWC	LIGHTWEIGHT CONCRETE		
MAS	MASONRY		
MAX	MAXIMUM		
MB	MARKER BOARD		
MC	MEDICINE CABINET		
MCT	MARBLE COUNTER TOP		
MECH	MECHANICAL		
MFG	MANUFACTURER/MANUFACTURED		
MG	MEDICAL GAS		
MIN	MINIMUM		
MIR	MIRROR		
MISC	MISCELLANEOUS		
MLDG	MOULDING		
MO	MASONRY OPENING		
MR	MOP RACK		
MT	METAL THRESHOLD		
MTL	METAL		
MWK	MILLWORK		
N	NORTH		
NAT	NATURAL		
NIC	NOT IN CONTRACT		
NO	NUMBER		
NOM	NOMINAL		
NRC	NOISE REDUCTION COEFFICIENT		
NTS	NOT TO SCALE		
O	OXYGEN		
OA	OUTSIDE AIR		
OC	ON CENTER		
OCEW	ON CENTER EACH WAY		
OD	OUTSIDE DIAMETER		
OFCI	OWNER FURNISHED / CONTRACTOR INSTALLED		
OPNG	OPENING		
OPP	OPPOSITE		
P	PART/PARTED		
PAR	PARALLEL		
PBD	PARTICLE BOARD		
PCF	PRESSED/PATTERNED CONCRETE FLOOR		
PCT	PLASTIC COUNTER TOP		
PERF	PERFORATED		
PL	PLATE		
PLAM	PLASTIC LAMINATE		
PLST	PLASTER		
PLWD	PLYWOOD		
PMR	PREFORMED METAL ROOFING		
PMS	PREFORMED METAL SIDING		
PR	PAIR		
PRT	PORCELAIN CERAMIC TILE		
PSF	POUNDS PER SQUARE FOOT		
PSI	POUNDS PER SQUARE INCH		
PT	PRESSURE TREATED		
PTD	PAPER TOWEL DISPENSER		
PTN	PARTITION		
PTR	PAPER TOWEL RECPTACLE		

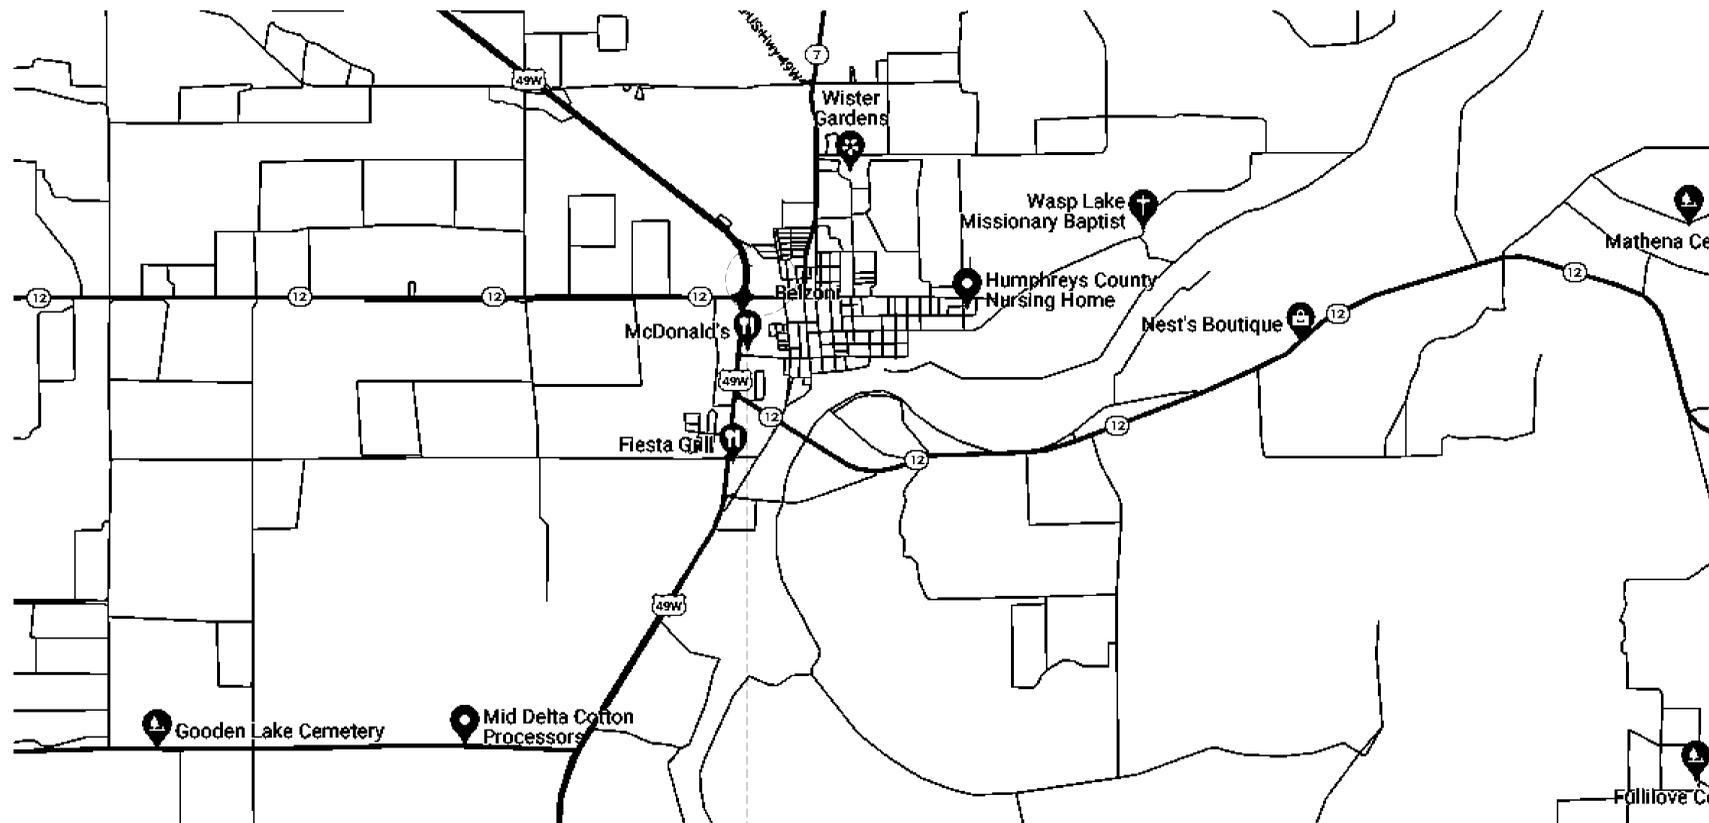

Site Locale



Dhunna Gas Station - Belzoni


Date: 1/26/2024
Project No: 20230703001

Construction Documents


Revision	#	Rev Date
CD	4	1/26/24

Reference


001
A

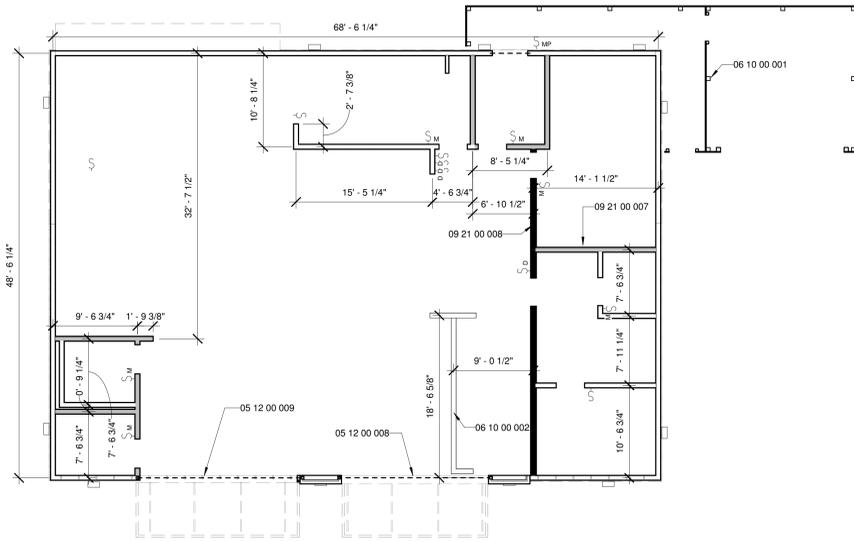

1 Framing Plan
1/8" = 1'-0"

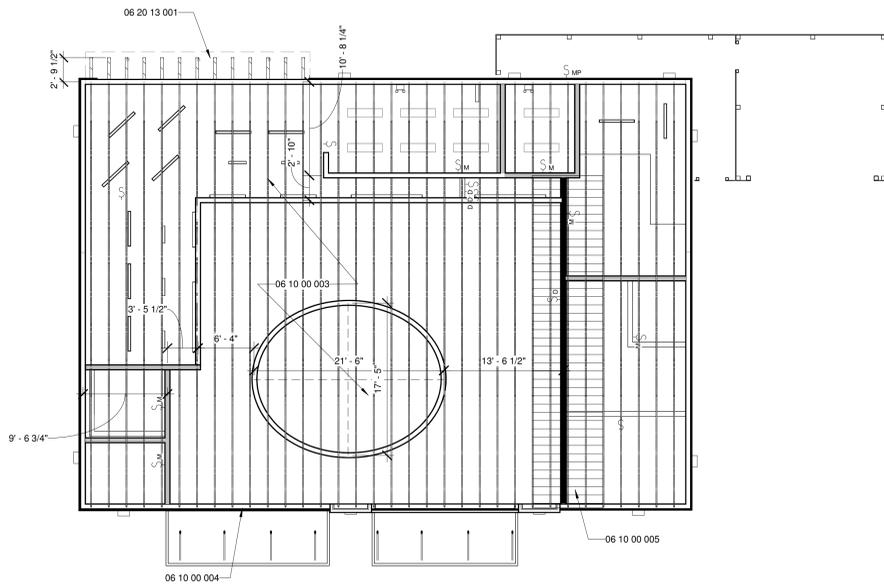

3 Framing Plan - Roof
1/8" = 1'-0"

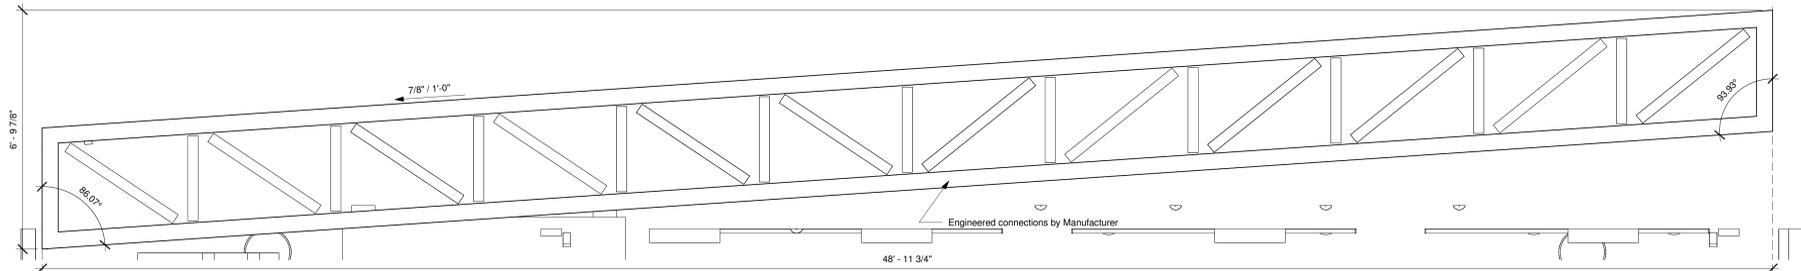


4 Truss Detail
1/2" = 1'-0"

General Notes

- All Wood Framing Members shall be #2 Southern Pine or better.
- Framing dimensions are to center stud.
- Nail off all WD sheathing at a minimum of 12" CC between fasteners at interior and perimeter of sheets.
- Where horizontal members cannot bear on load bearing plates, steel ties shall be used.
- All connections shall have the number of recommended fasteners per IRC framing regulations.
- All wood members that are in direct contact with concrete shall be treated.
- All Wall framing shall be 2x6 @ 16" CC.
- Typical 2x6 Box Header at all Openings unless noted otherwise.
- All Built up Beams shall be glued & screwed.
- Block all end of framing. For joist larger than 2x8, block every 6" CC.
- Truss supplier shall provide engineered submittals for Architectural review.
- Truss design by manufacturer shall follow all points listed under 2304.4 of the IBC 2018 Edition.
- MANUFACTURED TRUSSES
 - LATERAL SUPPORT
 - Trusses must be laterally supported at end supports (including supports adjacent to overhangs) with hangers or blocking.
 - Install 2x4 above bottom chord @ 6" CC for entire length of building for lateral support.
 - MINIMUM BEARING LENGTH
 - Minimum end bearing: 3" for all trusses.
- METAL BUILDING TIES
 - Install Hurricane Ties @ Every Joist connection at top plate at exterior wall and at top of beams at interior supports.
 - Install foundation ties per foundation plan.
 - Install Metal x-Brace Ties @ 9' Centers between all ceiling joists.
 - Install Column Connection per detail.

Specific Notes

- 05 12 00 008 W12x22 Steel Beam required with welded connection to 4x4x3/8" steel columns either end as jacks; welded columns to base at concrete
- 05 12 00 009 W14x22 Steel Beam required with welded connection to 4x4x3/8" steel columns either end as jacks; welded columns to base at concrete
- 06 10 00 001 Treated 6x6 Fence Posts
- 06 10 00 002 Short wall to be framed to support counter
- 06 10 00 003 42" Flat wood truss @ 24" CC; 2x6 top and bottom chords required for span
- 06 10 00 004 Provide blocking at wall, notched to studs for wall structural supports
- 06 10 00 005 Install 2x4 bracing @ 24" CC to underside of trusses in this section; nail off all truss connections and install shear wall top plate to 2x4 bracing
- 06 20 13 001 4x10 Cypress OR Treated SYP; provide steel strap at top side to connect to interior truss for a minimum of 2' on both members for a full length of 4' of strapping; secure underside with hidden flange metal tie (paint tie black)
- 09 21 00 007 Extend gray shaded walls to roof deck
- 09 21 00 008 Shear Wall: Extend black shaded walls to underside of Manf. truss bottom chord bracing; install 1/2" plywood on both sides with nails at all members @ 12" CC



Dhunna Gas Station - Belzoni
1/26/2024
Date
Project No. 20230703001

PURSER & COMPANY | 601.376.9647 DRAWINGS@PURSERANDCOMPANY.COM

650 1st St, Belzoni, MS 39008
New Construction

Construction Documents

Revision	#	Rev Date

Framing & Section Details

S 103
A



Dhunna Gas Station - Belzoni
 Project No. 20230703001 Date 1/26/2024

PURSER & COMPANY | 601.376.9647 DRAWINGS@PURSERANDCOMPANY.COM
 650 1st St., Belzoni, MS 39008
New Construction

101
A

General Finish Notes



- All dimensions pulled from face of wall covering.
- +/- Dimensions allow for some tolerance in construction. If dimension varies more than 2% from indicated, notify Architect.
- Coordinate all plumbing, mechanical, & electrical fixtures with their respective plans. Discrepancies between fixture locations between MPE plans and architectural should be brought up to the Architect as soon as possible.
- Coordinate all window and door openings at exterior walls with elevations.
- Match fence style and finish as metal gates so that gates are hidden behind finish.

General Roof Notes

- Roof insulation shall be open cell spray foam with a depth of 6 inches at the underside of the roof deck.
- Roofing to be standing seam metal roof panels with 1-3/4" MIN seams.

Specific Notes

- 05 12 00 005 4x4x1/4" Steel Tube Column
- 05 12 00 006 6x6x3/8" Steel Tube Column
- 07 61 00 009 Prefinished metal cap @ all parapet walls; wrap up wall so that parapet cap covers wall flashing and wall flashing extends down roof by a minimum of 8"
- 07 61 13 001 Standing seam Snap lock / Hidden fastener with minimum 1-1/2" Rib Height
- 07 71 23 001 Prefinished 5x5 gutter with downspouts as shown on elevations
- 09 21 00 007 Extend gray shaded walls to roof deck
- 09 21 00 008 Shear Wall: Extend black shaded walls to underside of Manf. truss bottom chord bracing; install 1/2" plywood on both sides with nails at all members @ 12" CC
- 10 56 26 001 Wire Roller Carts for storage
- 10 57 23 001 Painted Plywood Built-In Shelving with Horizontal Shelving @ 16" Vertically CC and with vertical supports @ 3'-6" Minimum Horizontal Centers; Depth to be a minimum of 1'-6"
- 10 73 16.13 02 New prefinished wall mounted aluminum canopy
- 11 40 00 001 Stainless steel food display
- 11 42 13 001 Stainless Steel refrigerated prep station
- 11 44 00 001 Double Fryer
- 11 44 13 001 Cook Range
- 11 46 83 001 Commercial ice maker
- 12 35 59 005 Display Counter with storage
- 12 35 59 006 Metal Display Shelving
- 22 40 00 003 Utility Mop Sink
- 22 42 16.16 01 Stainless steel 3 Compartment Sink with side rimmed counters
- 23 38 13 001 Vent hood with fire suppression

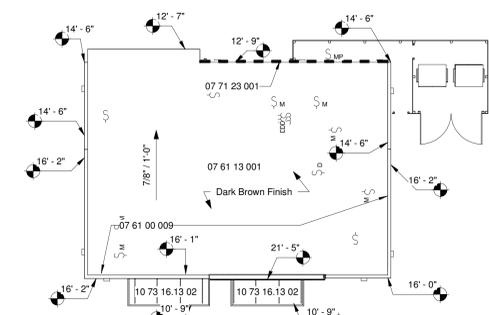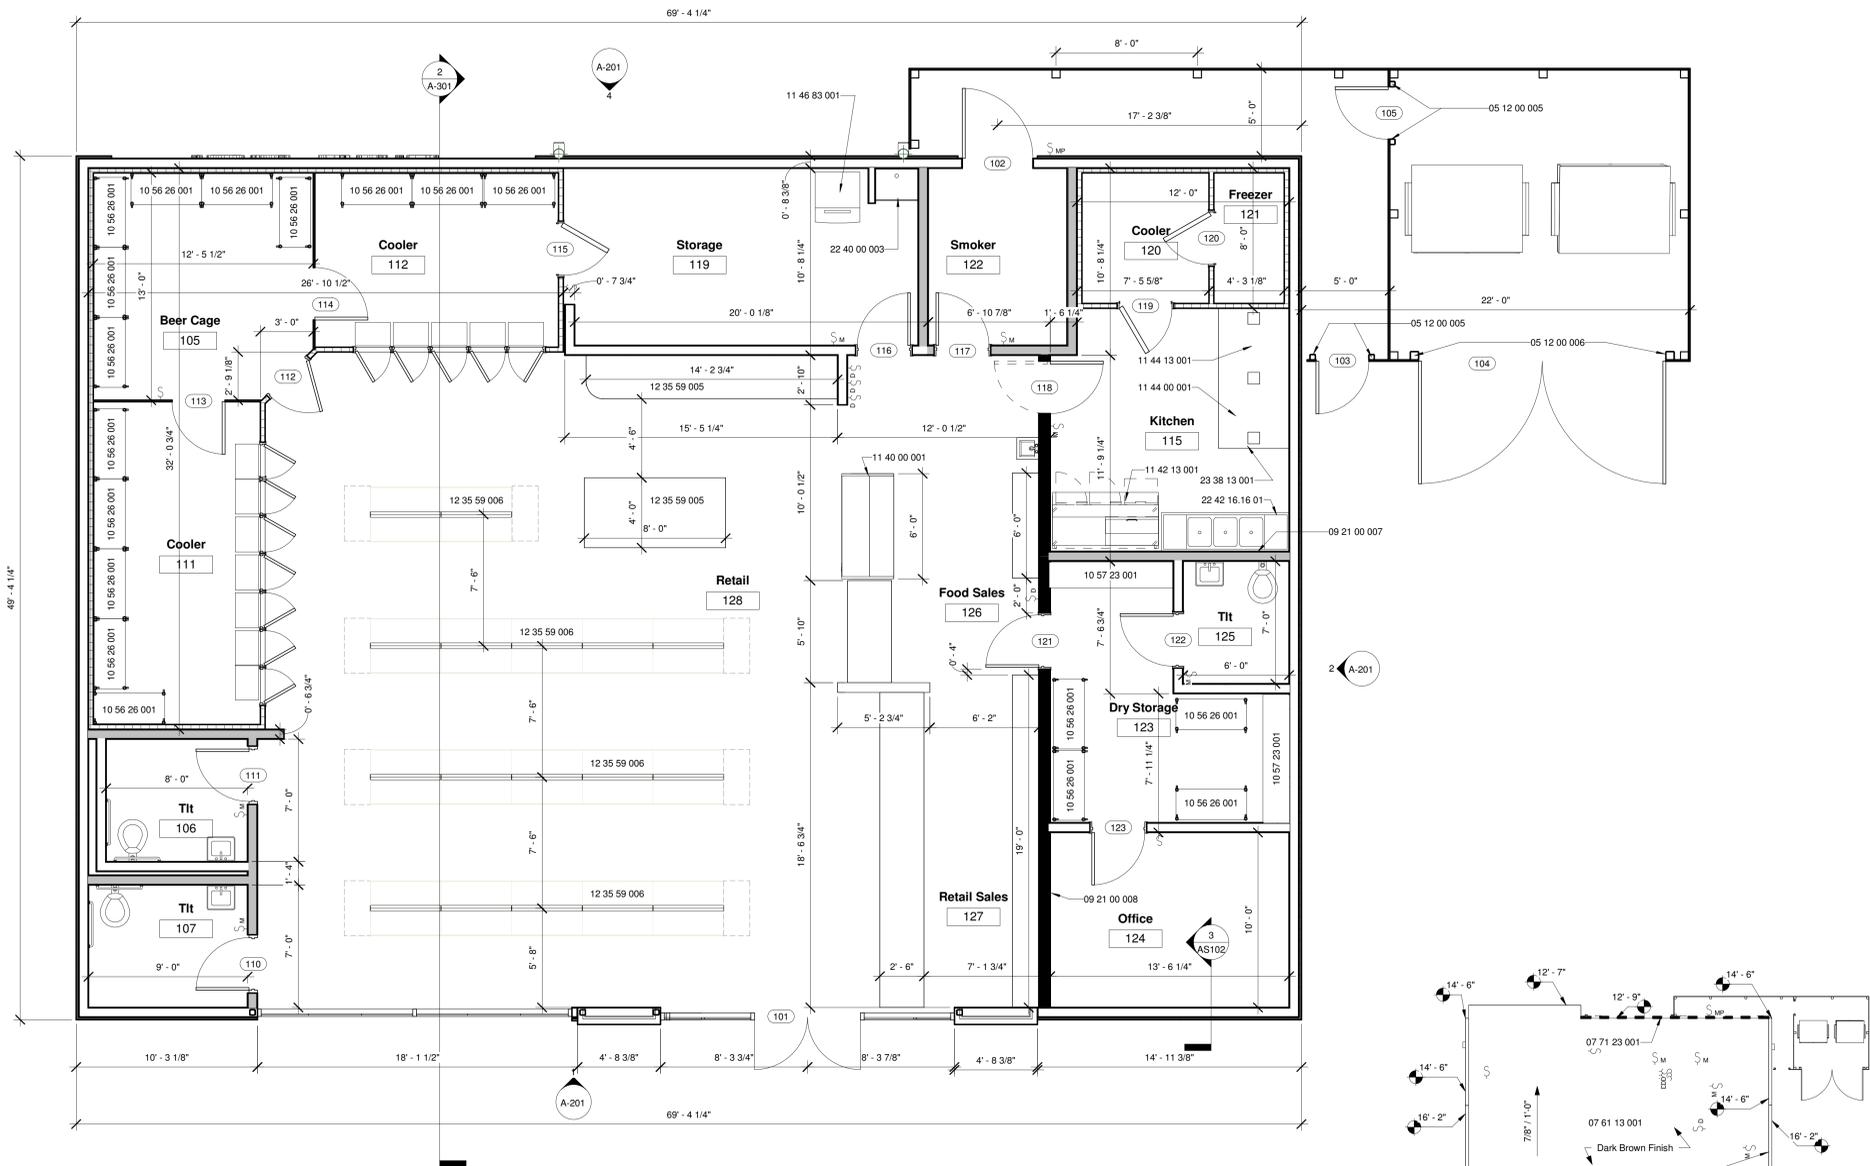

1 Floor Plan
1/4" = 1'-0"


2 Roof Plan
1/16" = 1'-0"

Door Schedule

Mark	Height	Width	Frame Material	Description	Finish	Operation	Hinges	Locket Type	#
101	7'-0"	6'-0"	Aluminum	Thin Framed Full Height Lite	Prefinished	Swing	Full Height Hinge	Passage w Closer, DB, & Flush Bolt	101
102	7'-0"	4'-0"	Steel	Hollow Metal Panel	Painted	Swing	Full Height Hinge	Keyed Entry w Hold Open Closer, DB, Rain Gaurd, Weather Seal	102
103	6'-0"	3'-0"	Steel Gate	Welded Gate with Steel Columns and Plates for Security	Painted	Swing	2 Barrel Hinges	Passage Lever with DB	103
104	6'-0"	14'-0"	Steel Gate	Welded Gate with Steel Columns and Plates for Security	Painted	Swing	8 Barrel Hinges	Welded on Padlock Hasp; Flush Bolt at one Leaf	104
105	6'-0"	3'-0"	Steel Gate	Welded Gate with Steel Columns and Plates for Security	Painted	Swing	2 Barrel Hinges	Passage Lever	105
110	7'-0"	3'-0"	Steel	Hollow Metal Panel	Painted	Swing	Full Height Hinge	Passage w Closer & DB (include exterior Privacy indicator)	110
111	7'-0"	3'-0"	Steel	Hollow Metal Panel	Painted	Swing	Full Height Hinge	Passage w Closer & DB (include exterior Privacy indicator)	111
112	7'-0"	3'-0"	Per Manf.	Thin Framed Full Height Lite	Prefinished	Swing	1-1/2 Pair	Passage w Weather Seal & Closer	112
113	6'-0"	3'-0"	Fencing	Fencing	Fencing	Swing	1-1/2 Pair	Passage	113
114	6'-0"	3'-0"	Fencing	Fencing	Fencing	Swing	1-1/2 Pair	Passage	114
115	7'-0"	3'-0"	Per Manf.	Insulated Door Solid Door Panel	Per Manf.	Swing	1-1/2 Pair	Passage	115
116	7'-0"	3'-0"	Steel	Hollow Metal Panel	Painted	Swing	1-1/2 Pair	Keyed Storage	116
117	7'-0"	3'-0"	Steel	Hollow Metal Panel	Painted	Swing	1-1/2 Pair	Passage	117
118	7'-0"	3'-0"	Steel	Stainless Double Action Door	Prefinished	Double Action Swing	1-1/2 Pair	Spring Hinges	118
119	7'-0"	3'-0"	Per Manf.	Insulated Door Solid Door Panel	Per Manf.	Swing	1-1/2 Pair	Passage	119
120	7'-0"	3'-0"	Per Manf.	Insulated Door Solid Door Panel	Per Manf.	Swing	1-1/2 Pair	Passage	120
121	7'-0"	3'-0"	Steel	Hollow Metal Panel	Painted	Swing	1-1/2 Pair	Keyed Entry	121
122	7'-0"	3'-0"	Steel	Wood Veneered Panel	Sealed	Swing	1-1/2 Pair	Privacy	122
123	7'-0"	3'-0"	Steel	Wood Veneered Panel	Sealed	Swing	1-1/2 Pair	Privacy	123

Room Schedule

Number	Name	Area	Perimeter	Ceiling Finish	Wall Finish	Floor Finish	Base Finish	Comments	#
105	Beer Cage	158 SF	49' - 2 1/8"	Insulated Metal Panel	Insulated Metal Panel	Quarry Tile	Cove Base		105
106	Tlt	58 SF	30' - 0"	Vinyl Covered ACT	Full Height Wall Tile	Floor Tile	Cove Base		106
107	Tlt	63 SF	32' - 0"	Vinyl Covered ACT	Full Height Wall Tile	Floor Tile	Cove Base		107
111	Cooler	175 SF	55' - 9 5/8"	Insulated Metal Panel	Insulated Metal Panel	Quarry Tile	Cove Base		111
112	Cooler	137 SF	47' - 5 7/8"	Insulated Metal Panel	Insulated Metal Panel	Quarry Tile	Cove Base		112
115	Kitchen	184 SF	54' - 10"	Vinyl Covered ACT	Grey FRP	Quarry Tile	Cove Base		115
119	Storage	201 SF	64' - 5"	Unfinished	Painted Plywood	Quarry Tile	Cove Base		119
120	Cooler	54 SF	29' - 3 3/4"	Insulated Metal Panel	Insulated Metal Panel	Quarry Tile	Cove Base		120
121	Freezer	30 SF	22' - 10 3/4"	Insulated Metal Panel	Insulated Metal Panel	Quarry Tile	Cove Base		121
122	Smoker	79 SF	35' - 11 1/4"	Painted Plywood	Painted Plywood	Quarry Tile	Cove Base		122
123	Dry Storage	152 SF	56' - 11"	2x2 ACT	5/8" Drywall	Floor Tile	Rubber Base		123
124	Office	135 SF	47' - 0 1/2"	2x2 ACT	5/8" Drywall	Floor Tile	Rubber Base		124
125	Tlt	42 SF	26' - 0"	2x2 ACT	Full Height Wall Tile	Floor Tile	Cove Base		125
126	Food Sales	213 SF	60' - 9 1/4"	2x2 ACT	5/8" Drywall	Floor Tile	Rubber Base		126
127	Retail Sales	152 SF	53' - 5 1/4"	2x2 ACT	5/8" Drywall	Floor Tile	Rubber Base		127
128	Retail	1259 SF	146' - 0 5/8"	2x2 ACT & WD Look Tile	5/8" Drywall	Floor Tile	Rubber Base		128

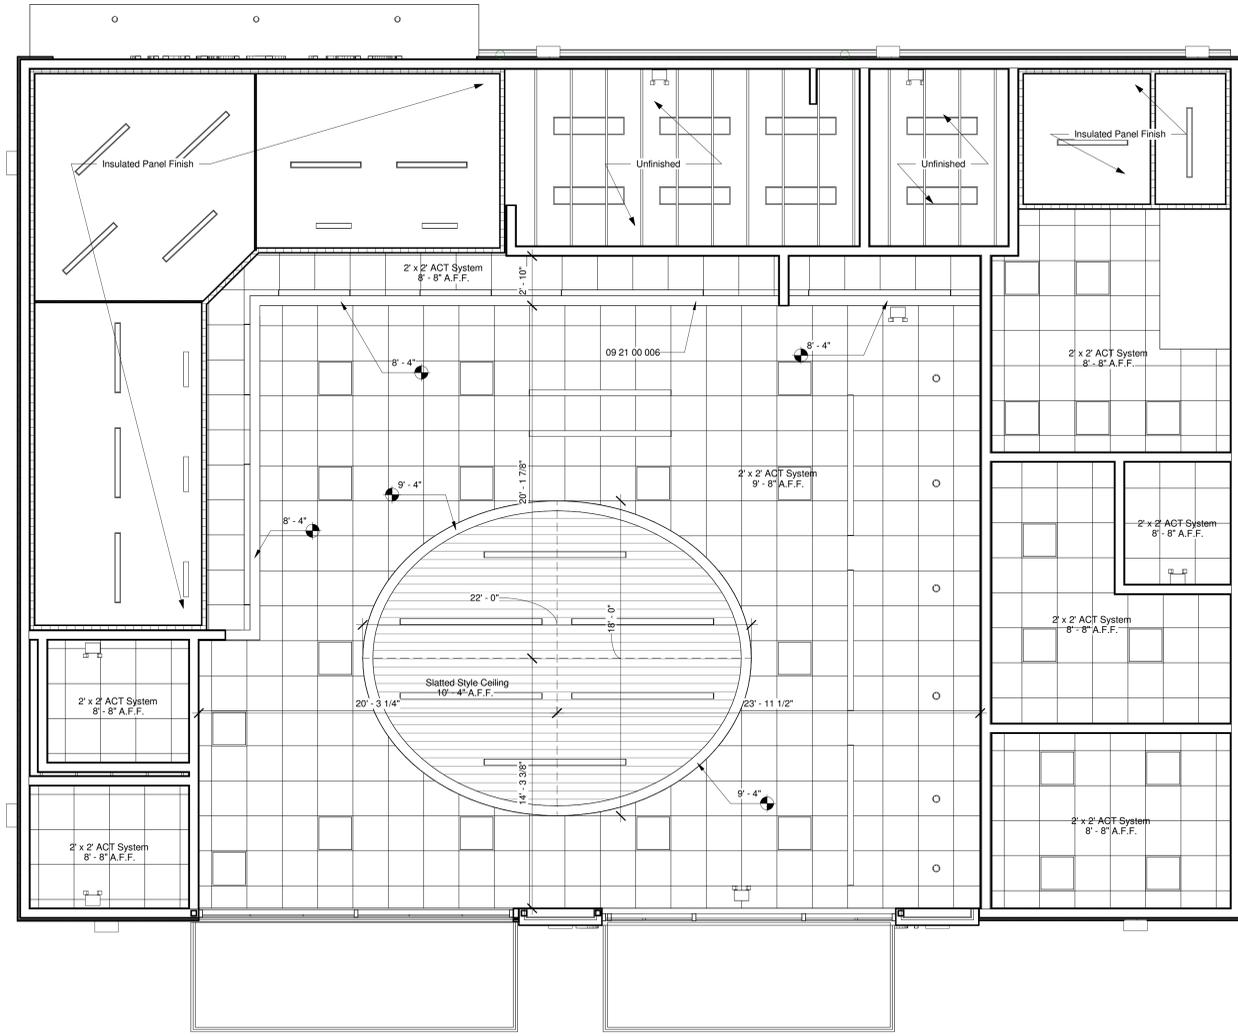

1 Reflected Ceiling Plan
1/4" = 1'-0"

General Ceiling Notes

- Any Ceiling Patterns not identified below are open to the structure above and do not require finishing.

- 2x2 Lay In Tile w Tegular Edge
- 2x2 Lay In Tile w Vinyl Covering
- Rigid Vinyl Tile - Impressed with Wood Texture

Specific Notes

- 09 21 00 006 Drywall furr down; support to above structure as needed; drywall to extend above finished ceiling by a minimum of 2"

MS CONSTRUCTION LAW: 1. PURSUANT TO SECTION 73-1-39, PRIVATELY OWNED BUILDINGS THAT ARE THREE (3) STORIES IN HEIGHT OR MORE, OR BUILDINGS THAT ARE MORE THAN 100 SQUARE FEET, UNLESS THE PROJECT IS SPECIFICALLY EXEMPTED BY SECTION 73-1-38, 2. PURSUANT TO SECTION 73-1-38, PUBLIC BUILDINGS OWNED BY THE STATE OF MISSISSIPPI IF THE PROJECT CONTAINS MORE THAN TEN THOUSAND (10,000) SQUARE FEET OF GROUND FLOOR AREA, OR IF THE PROJECT IS THREE (3) OR MORE STORIES IN HEIGHT, UNLESS SPECIFICALLY EXEMPTED BY SECTION 73-1-38.

STAMP NOT VALID WITHOUT SIGNATURE

Dhunna Gas Station - Belzoni

Project No 20230703001 Date 1/28/2024

PURSER & COMPANY | 601.376.9647 DRAWINGS@PURSERANDCOMPANY.COM


650 1st St, Belzoni, MS 39008
New Construction

Construction Documents

Revision	#	Rev Date

Reflected Ceiling Plan

141
A

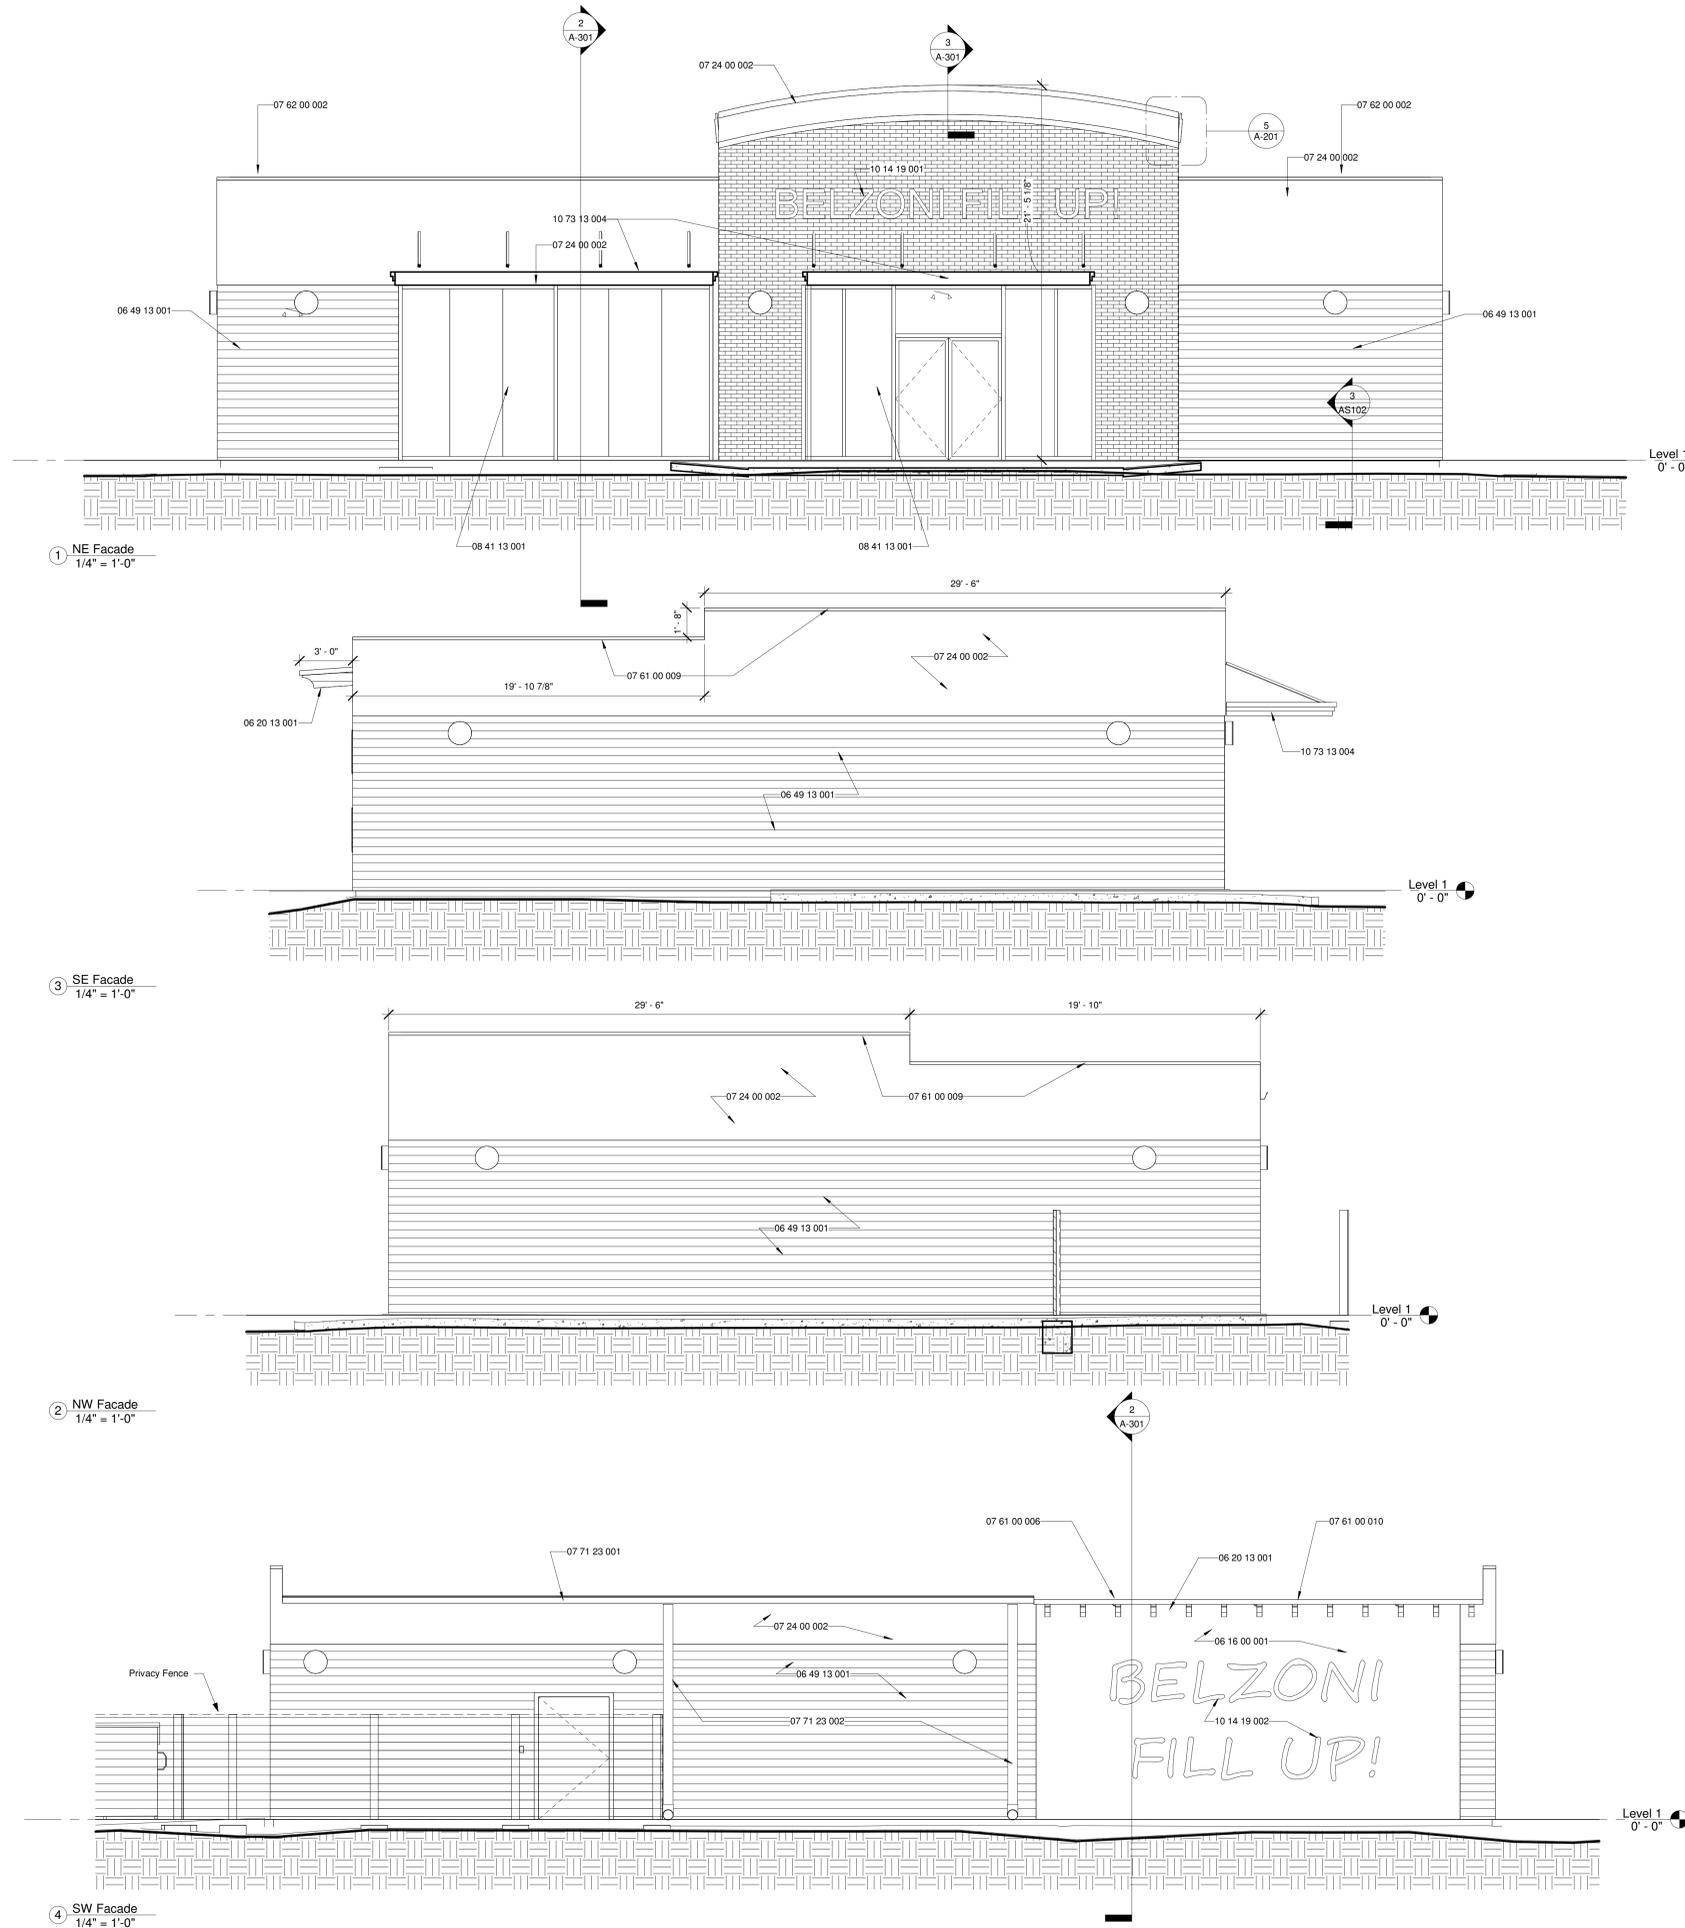


General Notes


1. Coordinate Brick Color with Owner.
2. Coordinate EIFS Color with Owner.
3. Coordinate Awning Color with Owner.
4. Provide mounting brackets thru brick to structure for awnings.

Specific Notes

- 06 16 00 001 Sheathing with Dampproofing as exterior finish; dampproofing to be black in color
- 06 20 13 001 4x10 Cypress OR Treated SYP; provide steel strap at top side to connect to interior truss for a minimum of 2' on both members for a full length of 4' of strapping; secure underside with hidden flange metal tie (paint tie black)
- 06 49 13 001 1x6 Wood Board as rain screen (stained); see detail
- 07 24 00 002 EIFS wall finish at upper wall
- 07 61 00 006 Standing Seam Roof Panel; 24 GA Galvanized finish
- 07 61 00 009 Prefinished metal cap @ all parapet walls; wrap up wall so that parapet cap covers wall flashing and wall flashing extends down roof by a minimum of 8"
- 07 61 00 010 Provide 1-3/4" drip edge with matching roof finish
- 07 62 00 002 Cap Parapet with wall prefinished metal trim
- 07 71 23 001 Prefinished 5x5 gutter with downspouts as shown on elevations
- 07 71 23 002 Prefinished 4x3 Downspout
- 08 41 13 001 Aluminum storefront assembly
- 10 14 19 001 20" Dimensional Letter Signage with high metallic brass finish
- 10 14 19 002 30" Dimensional Letter Signage with high metallic brass finish
- 10 73 13 004 New Aluminum Pan Awning to be supported from wall; include integral drain with spouts at ends



5 EIFS Detail
1" = 1'-0"



Dhunna Gas Station - Belzoni
Date 1/26/2024
Project No. 20230703001

PURSER & COMPANY | 601.376.9647 DRAWINGS@PURSERANDCOMPANY.COM


650 1st St, Belzoni, MS 39008
New Construction

Construction Documents

Revision	#	Rev Date
DD	3	1/14/23
CD	4	1/26/24


Building Elevations

201
A

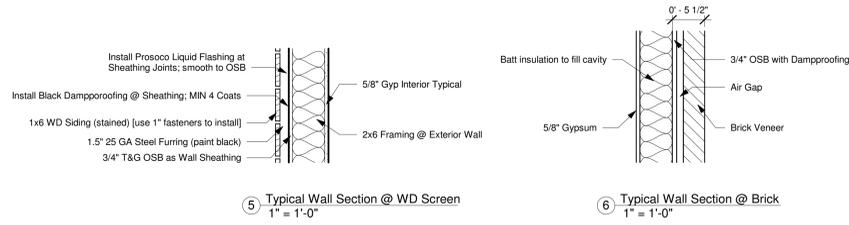


5 Typical Wall Section @ WD Screen
1" = 1'-0"


6 Typical Wall Section @ Brick
1" = 1'-0"

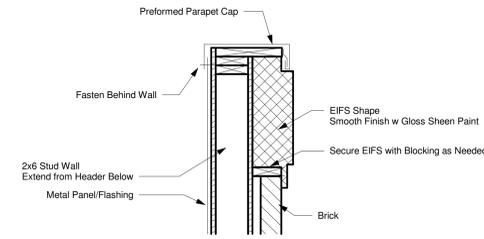

3 Upper EIFS Detail
1" = 1'-0"

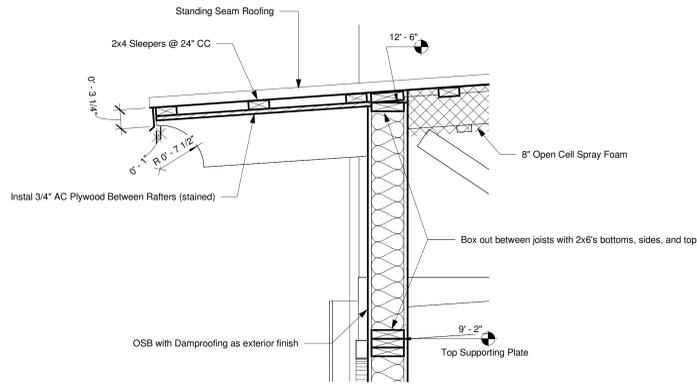

4 Soffit at Rafter Tails
1" = 1'-0"

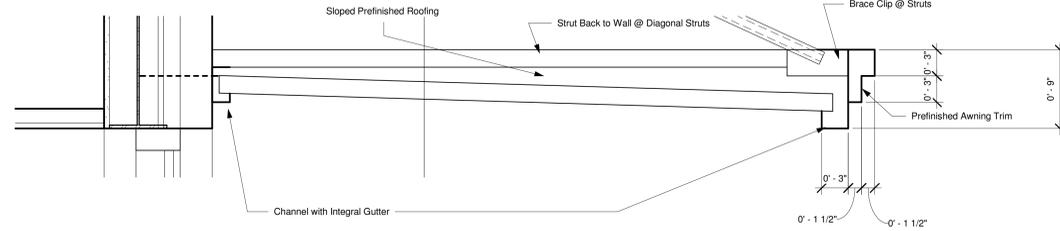


1 Typical Awning Detail
1 1/2" = 1'-0"

General Section Notes


1. Exterior air/water barrier and thermal insulation to be installed so as to provide a continuous separation of the building exterior from all interior occupied or conditioned spaces.
2. All anchors, fasteners, relief angles and attachment devices to be hot dipped galvanized steel.
3. All wood framing unless noted otherwise.
4. Provide drip edge flashing @ all horizontal joists @ sheathing joints and vertical material changes.

Specific Notes

- 06 10 00 006 Install 2x4 sleepers at 24" CC as mounting for roofing at top of truss for full length of truss
- 06 10 00 007 Install 2x4 sleepers as bracing on 48" CC at top of bottom truss chord for full length of truss
- 06 20 13 001 4x10 Cypress OR Treated SYP; provide steel strap at top side to connect to interior truss for a minimum of 2' on both members for a full length of 4' of strapping; secure underside with hidden flange metal tie (paint tie black)
- 07 27 36 002 8" open cell foam sprayed to metal roofing
- 07 61 00 010 Provide 1-3/4" drip edge with matching roof finish
- 07 61 13 001 Standing seam Snap lock / Hidden fastener with minimum 1-1/2" Rib Height
- 07 62 00 004 Install prefinished wall flashing up wall and secured behind parapet cap; flashing should overlap roofing below by a minimum of 8"

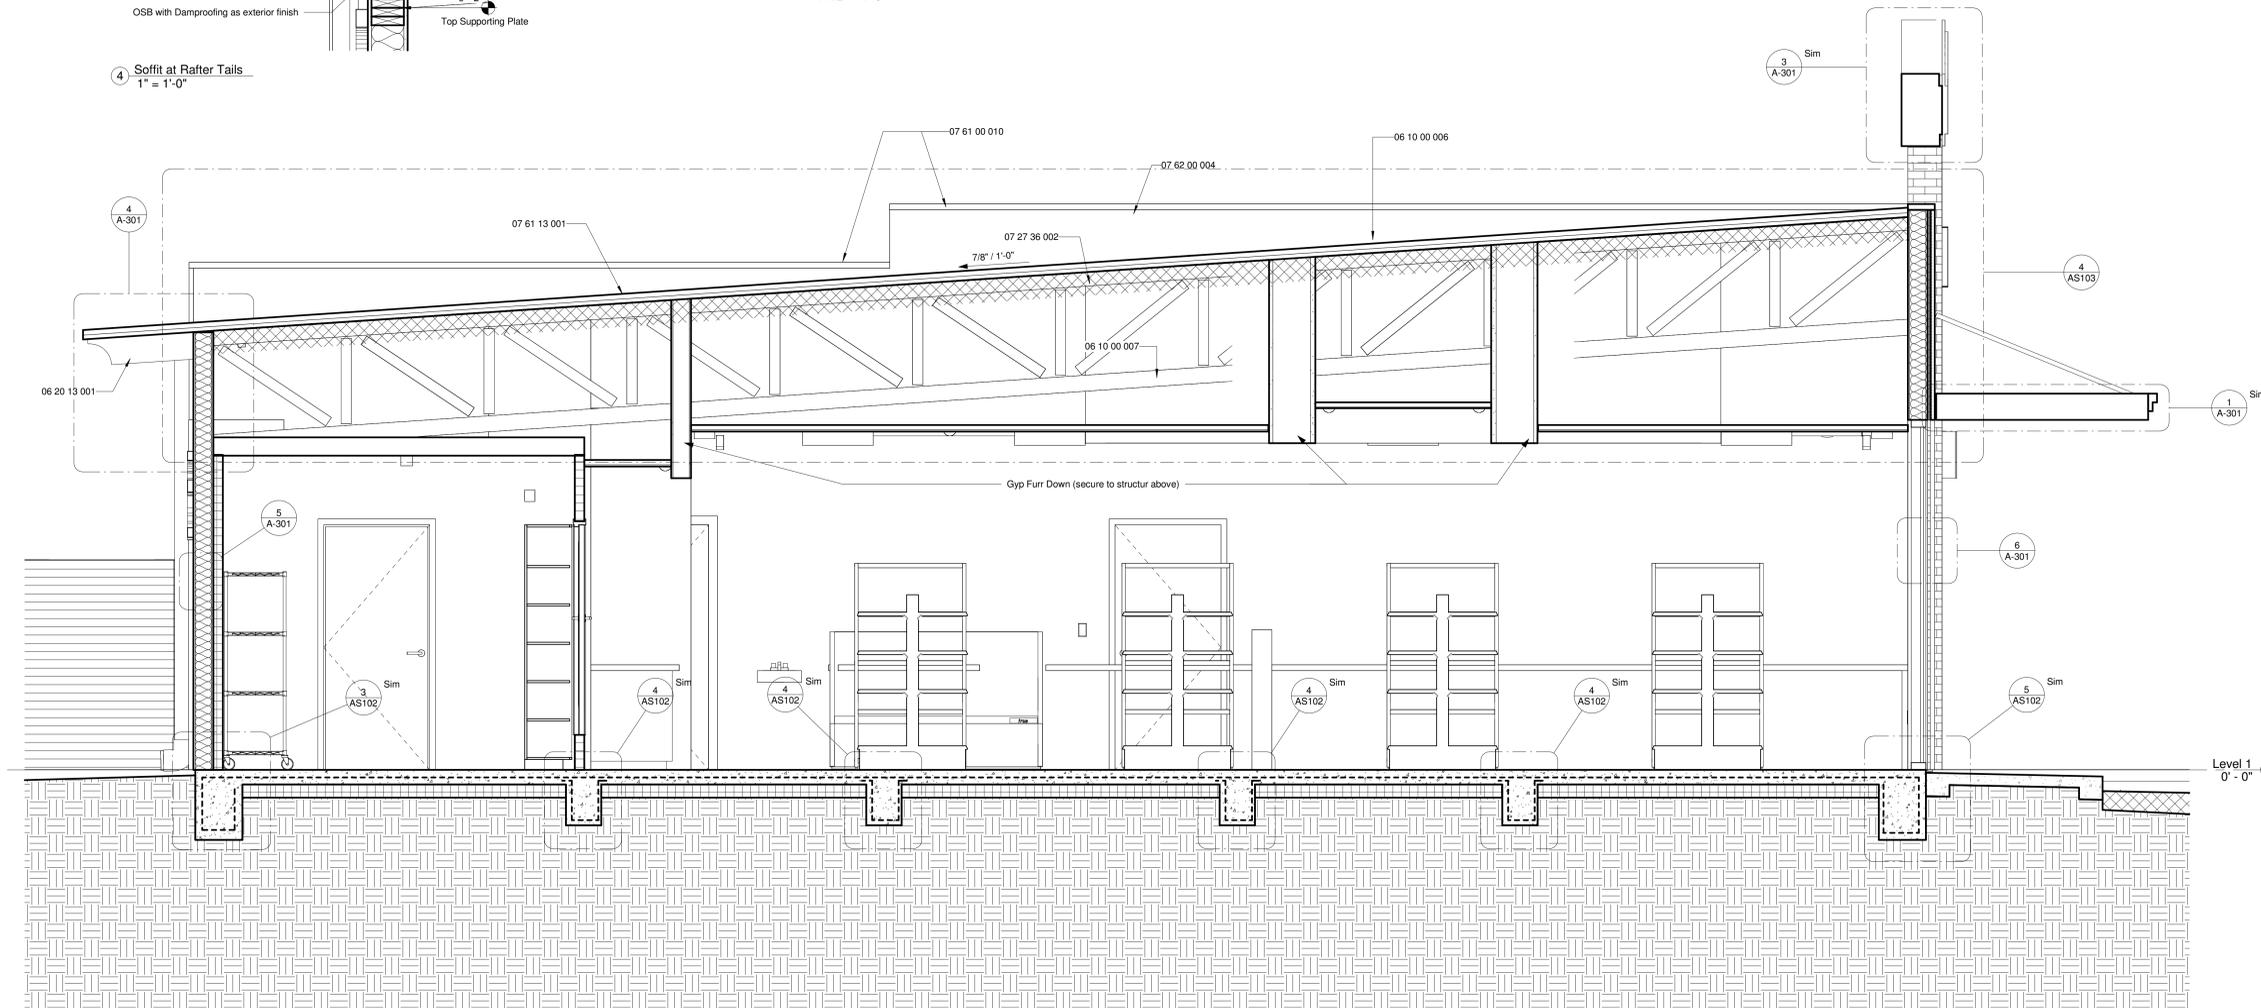

2 Cross Section
1/2" = 1'-0"



Dhunna Gas Station - Belzoni
Date 1/26/2024
Project No. 20230703001

PURSER & COMPANY | 601.376.9647 DRAWINGS@PURSERANDCOMPANY.COM

650 1st St, Belzoni, MS 39008
New Construction

Construction Documents

Revision	#	Rev Date
DD	3	1/14/23
CD	4	1/26/24

Building Sections

301
A

PLUMBING SYMBOLS & ABBREVIATIONS

ABBREVIATIONS

A.S.M.E.	AMERICAN SOCIETY OF MECH. ENGINEERS	HR.	HOUR
A.S.T.M.	AMERICAN SOCIETY FOR TESTING MATERIAL	H.W.	HOT WATER
A/C	AIR CONDITIONING	I.D.	INSIDE DIAMETER
ABV.	ABOVE	IND.	INDIRECT
APPROX.	APPROXIMATE	INV.	INVERT
BLDG.	BUILDING	I.W.	INDIRECT WASTE
BOT.	BOTTOM	KIT.	KITCHEN
BRKR.	BREAKER	K.W.	KILOWATT
B.W.V.	BACK WATER VALVE	MECH.	MECHANICAL
CL	CENTER LINE	MIN.	MINUTE
C.O.	CLEAN OUT	M.H.	MANHOLE
C.P.	CHROME PLATED	MOD.	MODEL
C.V.	CHECK VALVE	N.I.C.	NOT IN CONTRACT
CONC.	CONCRETE	N.T.S.	NOT TO SCALE
CONT.	CONTINUATION	#	DIAMETER
COND.	CONDENSATE	O.D.	OUTSIDE DIAMETER
CONN.	CONNECTION	O.S.&Y.	OUTSIDE SCREW & YOKE VALVE
CAP.	CAPACITY	P.&T.	PRESSURE & TEMPERATURE
CLG.	CEILING	PLUMB.	PLUMBING
C.I.P.	CAST IRON PIPE	PROP.	PROPERTY
C.W.	COLD WATER	R.D.	ROOF DRAIN
DN.	DOWN	RED.	REDUCER
DR.	DRAIN	REINF.	REINFORCING
DET.	DETAIL	REQ'D.	REQUIRED
DIAG.	DIAGRAM	R.F.	ROOF
DIAM.	DIAMETER	R.M.	ROOM
DIM.	DIMENSION	R.P.M.	REVOLUTIONS PER MINUTE
DOM.	DOMESTIC	R.W.L.	RAIN WATER LEADER
DWG.	DRAWING	SAN.	SANITARY
EA.	EACH	SCH.	SCHEDULE
E.D.F.	ELECTRIC DRINKING FOUNTAIN	SECT.	SECTION
ELEC.	ELECTRICAL	SHT.	SHEET
ELEV.	ELEVATION	SPECS.	SPECIFICATIONS
EMERG.	EMERGENCY	SPKR.	SPRINKLER
E.W.H.	ELECTRIC WATER HEATER	S/S	STAINLESS STEEL
EXIST.	EXISTING	S.S.	SERVICE SINK
F.D.	FLOOR DRAIN	TEMP.	TEMPERATURE
FL.	FLOOR	T.O.P.	TOP OF PIPE
F.O.	FUEL OIL	TYP.	TYPICAL
FT.	FOOT	T.S.	TAMPER SWITCH
F.U.	FIXTURE UNIT	VAC.	VACUUM
F.C.O.	FLUSH CLEAN OUT	V.C.P.	VITRIFIED CLAY PIPE
FIN.	FINISHED	V.T.R.	VENT THRU ROOF
FIXT.	FIXTURE	V.	VENT
FUT.	FUTURE	VS.	VENT STACK
GA.	GAUGE	W/	WITH
G.V.	GATE VALVE		
GAL.	GALLONS		
GALV.	GALVANIZED		
GEN.	GENERAL		
G.P.H.	GALLONS PER HOUR		
G.P.M.	GALLONS PER MINUTE		
H.B.	HOSE BIBB		
HD.	HEAD		
H.P.	HORSE POWER		

PIPING SYMBOLS

	ACID WASTE		UNION
	ACID VENT		CLEAN OUT PLUG
	SANITARY SEWER		FLOOR CLEAN OUT
	SANITARY VENT		IN LINE STRAINER
	GREASE WASTE		WATER HAMMER SHOCK ABSORBER (PLAN VIEW)
	STORM DRAIN		WATER HAMMER ARRESTOR (ELEVATION)
	DENTAL COMPRESSED AIR		POST INDICATOR VALVE
	DENTAL VACUUM		FLOW SWITCH
	COMPRESSED AIR		FIRE DEPT. SIAMESE CONNECTION
	TEMPERED WATER		SEMI-RECESSED CHROME PENDENT
	COLD WATER		UPRIGHT FIRE SPRINKLER HEAD
	HOT WATER (120°)		INSTITUTIONAL TYPE PENDENT SPRINKLER
	HOT WATER RECIRCULATION (120°)		INSTITUTIONAL TYPE SIDEWALL
	HOT WATER (140°)		INSTITUTIONAL TYPE EXTENDED COVERAGE SIDEWALL
	HOT WATER RECIRCULATION (140°)		DRY PENDENT SPRINKLER
	HOT WATER (180°)		EXTRA LARGE ORIFICE 286' UPRIGHT
	HOT WATER RECIRCULATION (180°)		PRESSURE GAUGE WITH COCK
	FIRE PROTECTION WATER		PLUMBING RISER
	AUTOMATIC FIRE SPRINKLER		CONNECTION OF NEW TO EXISTING
	FIRE TEST DRAIN		HOSE BIBB W/ VACUUM BREAKER
	GAS		RISER DOWN
	FUEL OIL SUPPLY		FLOW IN DIRECTION OF ARROW
	FUEL OIL RETURN		RISER UP
	FUEL OIL VENT		PIPE RISE OR DROP
	CUT-OFF VALVE (ABOVE GRADE)		TOP CONNECTION BRANCH
	CUT-OFF VALVE (BELOW GRADE)		BOTTOM CONNECTION BRANCH
	PRESSURE REDUCING VALVE		SIDE CONNECTION BRANCH
	CHECK VALVE		CAP ON END OF PIPE
	BALANCING VALVE		CONCENTRIC REDUCER
	O.S.&Y. VALVE		ECCENTRIC REDUCER
	PRES. AND TEMP. RELIEF VALVE		
	GAS COCK		
	WATER FLOW MEASURING DEVICE		

GENERAL NOTES:

CONTRACTOR IS RESPONSIBLE FOR COORDINATING ALL PLUMBING INSTALLATIONS WITH OTHER TRADES SUCH AS ELECTRICAL, STRUCTURAL, HVAC, LIGHTING, CEILING CONSTRUCTION AND SUPPORTS, ETC. ANY CONFLICTS ARISING OUT OF A LACK OF CONSTRUCTION COORDINATION OR DUE TO LACK OF CONSIDERATION FOR THE NEEDS OF OTHER TRADES SHALL BE RESOLVED AT NO EXPENSE TO THE OWNER.

ALL PIPING SHALL BE INSTALLED IN SUCH A MANNER THAT CONFLICTS WITH AIR CONDITIONING DUCTS AND WITH CEILING LIGHTS WILL NOT OCCUR. SOME PIPING SHALL BE INSTALLED WITH SLEEVES THROUGH WALLS. CONTRACTOR SHALL BE RESPONSIBLE FOR FURNISHING THE SIZES OF SLEEVES AND THE ELEVATIONS AT WHICH OPENINGS ARE TO BE MADE PRIOR TO INSTALLATION OF STRUCTURAL MEMBERS.


FOR EVERY PIPE SLEEVE PENETRATING FIRE RATED WALLS AND SLABS, USE A FIRE BARRIER WRAP STRIP, FIRE RATED CAULK AND PUTTY, ASTM E-814, U.L. LISTED, CAPABLE OF RAPID EXPANSION WHEN EXPOSED TO HEAT. COMPLIES WITH BOCA, ICBO AND SSBC. PROVIDES 3 HOUR FIRE RATING. SEE FIRESTOPPING SPECIFICATION.

ALL SANITARY AND STORM DRAINAGE PIPING SHALL BE INSTALLED AT 1/8" PER FOOT SLOPE UNLESS OTHERWISE NOTED. FIXTURE ARMS AND SMALL BRANCHES SHALL BE SLOPED IN ACCORDANCE WITH THE INTERNATIONAL PLUMBING CODE.

PROVIDE ACCESS PANELS FOR SHOCK ABSORBERS AND GATE VALVES AND CLEANOUT COVERS FOR CLEANOUT PLUGS AS SPECIFIED. EACH ITEM SHALL BE PROVIDED WITH ITS ACCESS PANEL OR COVER. ACCESS PANELS AND CLEANOUT COVERS SHALL BE EASILY ACCESSIBLE AND CONTRACTOR WILL BE RESPONSIBLE FOR LOCATING THESE ITEMS SO THAT SHOCK ABSORBER, VALVE, OR CLEANOUT LIES WITHIN WALL OR CEILING IMMEDIATELY BEHIND COVER OR PANEL. CONTRACTOR SHALL COORDINATE THE LOCATION OF PANELS AND COVERS WITH OTHER TOILET ACCESSORIES AND FIXTURES AS WELL AS ARCHITECTURAL LAYOUT.

DURING FINAL PUNCH LIST INSPECTION, CONTRACTOR SHALL HAVE ALL CLEANOUT COVERS AND ACCESS PANELS OPENED AND ITEMS EXPOSED FOR VERIFICATION AS TO THEIR INSTALLATION BY CONTRACTING OFFICER.

PROVIDE AUTOMATIC TRAP PRIMERS FOR ALL FLOOR DRAINS.

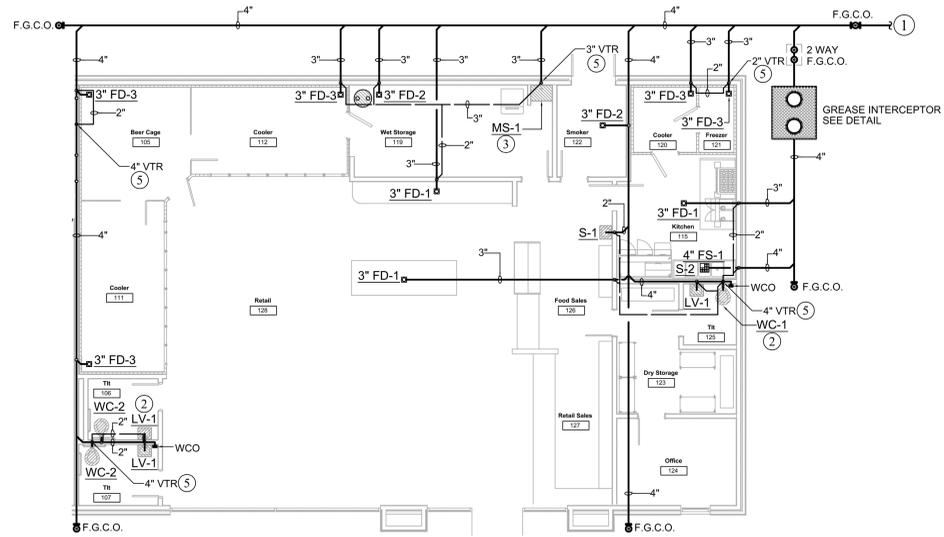


GENERAL NOTES:

- CONTRACTOR TO INSTALL PLUMBING ACCORDING TO THE 2018 INTERNATIONAL PLUMBING CODE AND LOCAL AUTHORITY HAVING JURISDICTION.
- SLOPE AND SUPPORT ALL PIPING PER CODE REQUIREMENTS. PROVIDE AND INSTALL UL LISTED FIRE STOP COLLARS AND FIRE CAULK ALL PLUMBING PENETRATIONS AT RATED WALL AND FLOOR ASSEMBLIES.
- NOTIFY THE ENGINEER 48 HOURS BEFORE THE WASTE AND VENT PIPING SYSTEM WILL BE PRESSURE TESTED ACCORDING TO 2018 INTERNATIONAL PLUMBING CODE.
- NOTIFY THE ENGINEER 48 HOURS BEFORE ANY PIPING ABOVE THE SLAB IN THE WALLS OR CEILINGS IS COVERED. FAILURE TO NOTIFY ENGINEER FOR INSPECTION WILL CAUSE ALL PIPING TO BE UNCOVERED AND PRESSURE TESTED IN THE PRESENCE OF THE ENGINEER.
- ALL BELOW GRADE SANITARY SEWER WASTE AND VENT PIPING TO BE SCHEDULE 80 PVC WITH SOLVENT WELD JOINTS. ALL ABOVE GRADE WASTE AND VENT TO BE SCHEDULE 40 PVC WITH SOLVENT JOINTS. INSTALL PIPING, JOINTS, AND FITTINGS PER MANUFACTURER'S RECOMMENDATIONS. WASTE PIPING SHOWN ON THIS DRAWING IS ROUTED BELOW THE FLOOR AND INSIDE THE WALLS TO FIXTURE ROUGH IN LOCATIONS.
- ALL VENT PIPING SHOWN IS IN THE WALL AND ABOVE CEILING EXCEPT WHERE OTHERWISE NOTED.
- ALL BELOW GRADE PIPE TRENCHES SHALL BE BACKFILLED WITH SELECT SANDY CLAY MATERIAL, AND STAMPED TO PROVIDE CONTINUOUS PIPE SUPPORT. SLOPE AND SUPPORT ALL PIPING ACCORDING TO THE INTERNATIONAL PLUMBING CODE.
- SLOPE AND SUPPORT ALL PIPING ACCORDING TO THE 2018 INTERNATIONAL PLUMBING CODE.
- ALL WASTE PIPING TO BE SLOPED AT 1/8" OR 1/4" PER FOOT AS REQUIRED FOR THE PIPE SIZE IN CONFORMANCE WITH THE 2018 INTERNATIONAL PLUMBING CODE.
- ALL PLUMBING ON THIS PROJECT WILL BE CONCEALED BELOW FLOOR, ABOVE CEILING, IN WALL, IN CHASE, OR ELSE AS PER ENGINEER.
- COORDINATE VENT STACK THRU ROOF TO BE MINIMUM 15 FEET FROM ANY FRESH AIR INTAKE.
- SUPPLY WATER PIPING TO BE HARD DRAWN TYPE 'L' COPPER TUBING WITH SOLDERED FITTINGS.
- ALL DOMESTIC WATER PIPING TO BE INSULATED WITH 1" PREFORMED FIBERGLASS PIPE INSULATION WITH ALL SERVICE JACKET. APPLY ADHESIVE LABELS ON PIPING ABOVE CEILING TO SHOWN CONTENTS AND FLOW. LABELS TO BE INSTALLED EVERY TWENTY FEET.
- PIPING TO BE SUPPORTED WITH CLEVIS TYPE HANGERS AT SPACING AS REQUIRED BY THE 2018 IPC. FOR DOMESTIC WATER PIPING, THE HANGERS SHALL BE LARGE ENOUGH FOR THE PIPE AND INSULATION TO PASS THROUGH. INSTALL SHEET METAL SADDLE AT ALL HANGER LOCATIONS AT BOTTOM OF PIPE.
- ROUGH IN PLUMBING CONNECTIONS FOR THE NEW FIXTURES ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS. ALL NEW SUPPLY WATER PIPING TO BE SOLDERED TYPE L COPPER.
- CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL NEW FLOOR PENETRATIONS FOR NEW SANITARY SEWER ROUGH IN AND FIRE STOPPING ALL WALL, CEILING, AND FLOOR PENETRATIONS OF FIRE RATED ASSEMBLIES. SEE ARCHITECTURAL PLANS FOR WALL RATINGS ON THIS PROJECT. CONTRACTOR TO CONSIDER ALL FLOOR PENETRATIONS AS RATED.
- CONTRACTOR IS RESPONSIBLE FOR ITEMS INCLUDING FIXTURE MOUNTING HEIGHTS, GRAB BARS, FAUCET HANDLES, SEATS, PIPING INSULATION, LAVATORY BARRIERS, AND ELSE REQUIRED TO ENSURE THE ACCESSIBLE FIXTURES ON THIS PROJECT MEET THE REQUIREMENTS OF THE ADA GUIDELINE. CONSULT ENGINEER OR ARCHITECT FOR INFORMATION AS REQUIRED.
- CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL NEW FLOOR PENETRATIONS FOR NEW SANITARY SEWER ROUGH IN AND FIRE STOPPING ALL WALL, CEILING, AND FLOOR PENETRATIONS OF FIRE RATED ASSEMBLIES. SEE ARCHITECTURAL PLANS FOR WALL RATINGS ON THIS PROJECT. CONTRACTOR TO CONSIDER ALL FLOOR PENETRATIONS AS RATED.
- PENETRATIONS THROUGH PARTITIONS AND FLOORS SHALL BE SLEEVED AND SEALED TO MAINTAIN INTEGRITY OF PARTITION AND FLOOR RATING.

NUMBERED NOTES:

- ① ROUTE SANITARY WASTE PIPING BELOW GRADE TO APPROVED POINT OF CONNECTION ON PUBLIC SANITARY SEWER SYSTEM. PLUMBING CONTRACTOR RESPONSIBLE FOR INSTALLING COMPLETE PLUMBING SYSTEM AS SHOWN TO A POINT APPROXIMATELY FIVE FEET FROM THE BUILDING FOUNDATION. PLUMBING CONTRACTOR TO COORDINATE IN ADVANCE WITH THE SITE CONTRACTOR IN REGARD TO ALL UTILITY CONNECTION POINTS. FIELD VERIFY THE INVERT ELEVATION OF ANY EXISTING SYSTEMS IF APPLICABLE AND ROUTE NEW PIPING ACCORDINGLY. SEE CIVIL SITE UTILITY PLAN FOR CONTINUATION AND COORDINATE WITH UTILITY PROVIDER FOR THE CONNECTION POINT TO PUBLIC SANITARY SEWER. INSTALL FINISH GRADE CLEANOUTS AT EACH CHANGE OF DIRECTION AND EVERY 75 FEET ALONG ROUTE AS REQUIRED.
- ② PROVIDE AND INSTALL NEW PLUMBING FIXTURES AS SHOWN. ROUTE NEW SANITARY SEWER PIPING BELOW GRADE TO EACH FIXTURE. ROUGH IN 4" WASTE PIPING TO EACH WATER CLOSET AND 2" WASTE TO LAVATORIES. VENT EACH FIXTURE TRAP UP IN WALL TO CONNECT TO PLUMBING VENT PIPING. SEE PLUMBING FIXTURE SCHEDULE FOR ADDITIONAL INFORMATION.
- ③ ROUGH-IN 3" WASTE PIPING TO NEW SERVICE SINK. INSTALL PER MANUFACTURER'S RECOMMENDATIONS. CONTINUE PLUMBING VENT PIPING UP TO ABOVE THE CEILING AND CONNECT TO VENT PIPING THRU THE ROOF.
- ④ PROVIDE AND INSTALL NEW 3" FLOOR DRAIN WITH WITH SURESEAL TRAP SEAL.
- ⑤ ROUTE VENT PIPING UP THROUGH GALVANIZED ROOF JACK FLASHING AND TERMINATE 12" ABOVE ROOF LEVEL. COORDINATE WITH ARCHITECTURAL.
- ⑥ CONTRACTOR TO STUB UP AND ROUGH IN APPROPRIATE SIZED WASTE PIPING FOR FUTURE FIXTURE CONNECTION (S). CAP AND PLUG PIPE AT PENETRATION. TYPICAL.

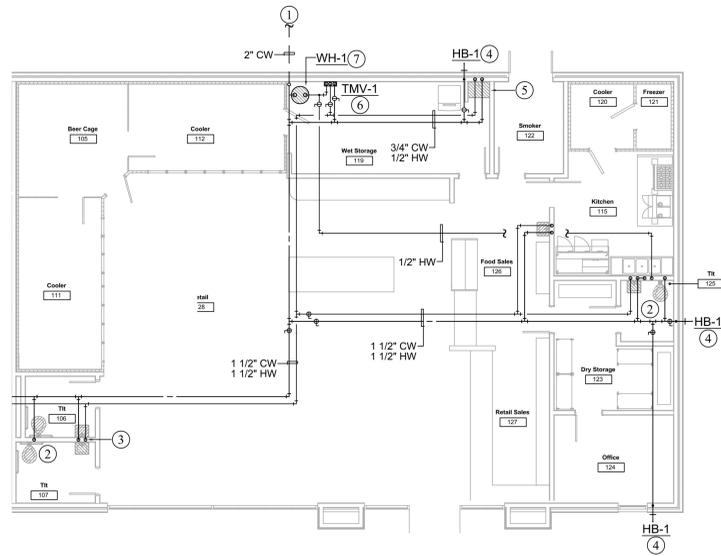

GENERAL NOTES:


- CONTRACTOR TO INSTALL PLUMBING ACCORDING TO THE 2018 INTERNATIONAL PLUMBING CODE AND LOCAL AUTHORITY HAVING JURISDICTION.
- SLOPE AND SUPPORT ALL PIPING PER CODE REQUIREMENTS. PROVIDE AND INSTALL UL LISTED FIRE STOP COLLARS AND FIRE CAULK ALL PLUMBING PENETRATIONS AT RATED WALL AND FLOOR ASSEMBLIES.
- NOTIFY THE ENGINEER 48 HOURS BEFORE THE WASTE AND VENT PIPING SYSTEM WILL BE PRESSURE TESTED ACCORDING TO 2018 INTERNATIONAL PLUMBING CODE.
- NOTIFY THE ENGINEER 48 HOURS BEFORE ANY PIPING ABOVE THE SLAB IN THE WALLS OR CEILINGS IS COVERED. FAILURE TO NOTIFY ENGINEER FOR INSPECTION WILL CAUSE ALL PIPING TO BE UNCOVERED AND PRESSURE TESTED IN THE PRESENCE OF THE ENGINEER.
- ALL BELOW GRADE SANITARY SEWER WASTE AND VENT PIPING TO BE SCHEDULE 80 PVC WITH SOLVENT WELD JOINTS. ALL ABOVE GRADE WASTE AND VENT TO BE SCHEDULE 40 PVC WITH SOLVENT JOINTS. INSTALL PIPING, JOINTS, AND FITTINGS PER MANUFACTURER'S RECOMMENDATIONS. WASTE PIPING SHOWN ON THIS DRAWING IS ROUTED BELOW THE FLOOR AND INSIDE THE WALLS TO FIXTURE ROUGH IN LOCATIONS.
- ALL VENT PIPING SHOWN IS IN THE WALL AND ABOVE CEILING EXCEPT WHERE OTHERWISE NOTED.
- ALL BELOW GRADE PIPE TRENCHES SHALL BE BACKFILLED WITH SELECT SANDY CLAY MATERIAL, AND STAMPED TO PROVIDE CONTINUOUS PIPE SUPPORT. SLOPE AND SUPPORT ALL PIPING ACCORDING TO THE INTERNATIONAL PLUMBING CODE.
- SLOPE AND SUPPORT ALL PIPING ACCORDING TO THE 2018 INTERNATIONAL PLUMBING CODE.
- ALL WASTE PIPING TO BE SLOPED AT 1/8" OR 1/4" PER FOOT AS REQUIRED FOR THE PIPE SIZE IN CONFORMANCE WITH THE 2018 INTERNATIONAL PLUMBING CODE.
- ALL PLUMBING ON THIS PROJECT WILL BE CONCEALED BELOW FLOOR, ABOVE CEILING, IN WALL, IN CHASE, OR ELSE AS PER ENGINEER.
- COORDINATE VENT STACK THRU ROOF TO BE MINIMUM 15 FEET FROM ANY FRESH AIR INTAKE.
- SUPPLY WATER PIPING TO BE HARD DRAWN TYPE 'L' COPPER TUBING WITH SOLDERED FITTINGS.
- ALL DOMESTIC WATER PIPING TO BE INSULATED WITH 1" PREFORMED FIBERGLASS PIPE INSULATION WITH ALL SERVICE JACKET. APPLY ADHESIVE LABELS ON PIPING ABOVE CEILING TO SHOWN CONTENTS AND FLOW. LABELS TO BE INSTALLED EVERY TWENTY FEET.
- PIPING TO BE SUPPORTED WITH CLEVIS TYPE HANGERS AT SPACING AS REQUIRED BY THE 2018 IPC. FOR DOMESTIC WATER PIPING, THE HANGERS SHALL BE LARGE ENOUGH FOR THE PIPE AND INSULATION TO PASS THROUGH. INSTALL SHEET METAL SADDLE AT ALL HANGER LOCATIONS AT BOTTOM OF PIPE.
- ROUGH IN PLUMBING CONNECTIONS FOR THE NEW FIXTURES ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS. ALL NEW SUPPLY WATER PIPING TO BE SOLDERED TYPE L COPPER.
- CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL NEW FLOOR PENETRATIONS FOR NEW SANITARY SEWER ROUGH IN AND FIRE STOPPING ALL WALL, CEILING, AND FLOOR PENETRATIONS OF FIRE RATED ASSEMBLIES. SEE ARCHITECTURAL PLANS FOR WALL RATINGS ON THIS PROJECT. CONTRACTOR TO CONSIDER ALL FLOOR PENETRATIONS AS RATED.
- CONTRACTOR IS RESPONSIBLE FOR ITEMS INCLUDING FIXTURE MOUNTING HEIGHTS, GRAB BARS, FAUCET HANDLES, SEATS, PIPING INSULATION, LAVATORY BARRIERS, AND ELSE REQUIRED TO ENSURE THE ACCESSIBLE FIXTURES ON THIS PROJECT MEET THE REQUIREMENTS OF THE ADA GUIDELINE. CONSULT ENGINEER OR ARCHITECT FOR INFORMATION AS REQUIRED.
- CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL NEW FLOOR PENETRATIONS FOR NEW SANITARY SEWER ROUGH IN AND FIRE STOPPING ALL WALL, CEILING, AND FLOOR PENETRATIONS OF FIRE RATED ASSEMBLIES. SEE ARCHITECTURAL PLANS FOR WALL RATINGS ON THIS PROJECT. CONTRACTOR TO CONSIDER ALL FLOOR PENETRATIONS AS RATED.
- PENETRATIONS THROUGH PARTITIONS AND FLOORS SHALL BE SLEEVED AND SEALED TO MAINTAIN INTEGRITY OF PARTITION AND FLOOR RATING.
- LICENSED GAS CONTRACTOR TO BE EXPERIENCED IN DESIGN AND INSTALLATION OF LP GAS PIPING SYSTEM PER NFPA 58, NFPA 54, AND INTERNATIONAL FUEL GAS CODE, CURRENT EDITIONS.
- ALL NATURAL GAS PIPING ON THIS PROJECT SHALL BE SCHEDULE 40 BLACK STEEL PIPE WITH THREADED FITTINGS. EXPOSED PIPING TO BE WIRE BRUSHED, CLEANED, PAINTED WITH TWO COATS OF RUST RESISTANT PRIMER, AND THEN PAINTED TO MATCH THE NEW GAS METER.
- VALVES TO BE BRONZE FULL PORT BALL VALVES WITH THREADED FITTINGS.
- METALLIC PIPE EXPOSED TO CORROSIVE ACTION, SUCH AS SOIL CONDITION OR MOISTURE, SHALL BE PROTECTED. PROVIDE PROTECTIVE COATING OR WRAPPING APPROVED FOR APPLICATION. WIRE BRUSH AND CLEAN ALL EXPOSED PIPING. SPRAY PRIME AND FINISH PAINT TO MATCH COLOR OF THE ADJACENT SURFACE TO PIPE.
- PRIOR TO ACCEPTANCE AND INITIAL OPERATION, CONTRACTOR SHALL BE INSPECT AND PRESSURE TEST ALL PIPING INSTALLATION PER INTERNATIONAL FUEL GAS CODE.

NUMBERED NOTES:


- ① CONTRACTOR TO COORDINATE WITH CIVIL SITE PLAN AND PUBLIC UTILITY PROVIDER FOR THE INSTALLATION OF NEW DOMESTIC WATER SERVICE, METER, AND SUPPLY TO BUILDING. ROUTE PIPING A MINIMUM OF 18" BELOW GRADE TO FOUNDATION WALL AND SLEEVE PIPING UP THRU SLAB AND TURN UP IN WALL. INSTALL A MAIN SHUTOFF GATE TYPE VALVE IN RECESSED VALVE BOX BELOW GRADE OUTSIDE BUILDING. CONTINUE PIPING UP AND ROUTE ABOVE THE CEILING AS SHOWN.
- ② ROUTE 1" COLD WATER SUPPLY TO EACH WATER CLOSET AND 1/2" HOT AND 1/2" COLD WATER SUPPLY DOWN IN WALL AND CONNECT TO EACH SINK OR LAVATORY. SEE PLUMBING FIXTURE SCHEDULE FOR MORE INFORMATION. INSTALL FIXTURE PER MANUFACTURER'S RECOMMENDATIONS. TYPICAL.
- ③ ROUTE 1/2" HOT AND 1/2" COLD WATER SUPPLY DOWN IN WALL BEHIND FIXTURE OR AS REQUIRED. INSTALL FIXTURE PER MANUFACTURER RECOMMENDATION. TYPICAL.
- ④ ROUTE 3/4" COLD WATER DOWN IN WALL TO FREEZELESS HOSE BIBB. CONNECT PER MANUFACTURERS RECOMMENDATIONS. TYPICAL.
- ⑤ ROUTE 1/2" HOT AND 1/2" COLD WATER SUPPLY TO MOP SINK FAUCET SET PER MANUFACTURER'S INSTRUCTIONS.
- ⑥ THERMOSTATIC MIXING VALVE LOCATED IN MECHANICAL ROOM AS SHOWN. MINIMUM FLOW RATE 1 TO 100 GPM. MAXIMUM PRESSURE DROP OF 5 PSI. INSTALL PER MANUFACTURER'S RECOMMENDATIONS. MANUFACTURER REPRESENTATIVE TO SETUP.
- ⑦ PROVIDE DIRECT VENT TYPE GAS WATER HEATER. INSTALL PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE DIRECT VENT TYPE VENT KIT FOR INTAKE/EXHAUST PIPING. SEE APPLIANCE DETAIL FOR ADDITIONAL REQUIREMENTS. ROUTE 1" GAS SUPPLY PIPING TO GAS WATER HEATER. PROVIDE AND INSTALL VENTLESS GAS REGULATOR SIZED TO REGULATE PRESSURE FROM 2PSI TO 7 OUNCES OR PER MANUFACTURER'S RECOMMENDATIONS. REDUCE SIZE TO EQUIPMENT CONNECTION. PROVIDE AND INSTALL REQUIRED SHUT-OFF VALVES, PRESSURE RELIEF, EXPANSION TANK, DIRT LEG, GAS COCK, AND UNIONS PER MANUFACTURER'S RECOMMENDATIONS. ROUTE NATURAL GAS PIPING ABOVE CEILING LEVEL AND DOWN ALONG WALL TO WATER HEATER CONNECTION. SUPPORT PIPING ALONG WALL AND AS HIGH AS POSSIBLE TO THE CEILING. COORDINATE POWER OUTLET WITH ELECTRICAL CONTRACTOR. SEE DETAIL.
- ⑧ ROUTE 1/2" COLD WATER TO ICE MAKER SUPPLY BOX BEHIND APPLIANCE REQUIRING DOMESTIC COLD WATER SUPPLY. PROVIDE AND INSTALL SHUTOFF VALVE ON SUPPLY PIPING ABOVE THE CEILING. TYPICAL.

LEGEND


COLD WATER PIPING	----
HOT WATER PIPING	----

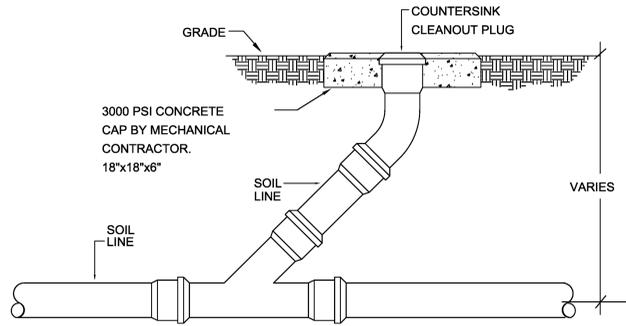


CLEANOUT DETAIL (FGCO)

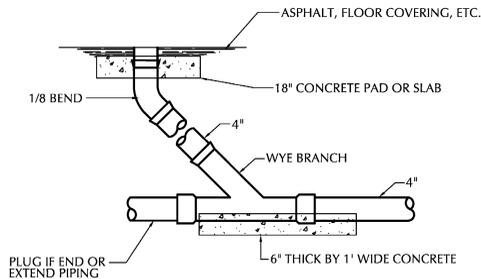


TYPICAL SANITARY SEWER CLEANOUT

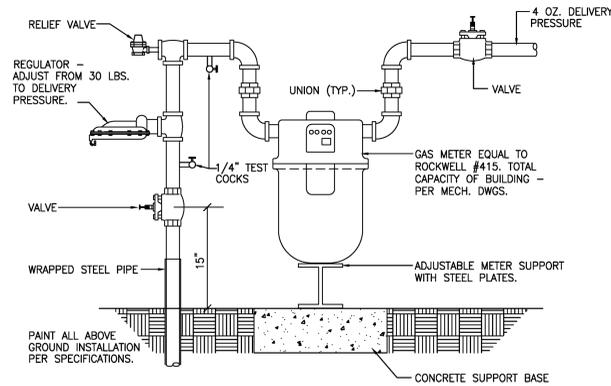

GAS METER AND REGULATOR DETAIL

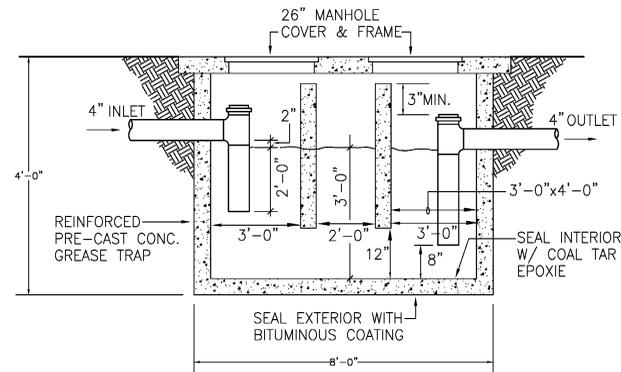


1000 GALLON
GREASE TRAP DETAIL

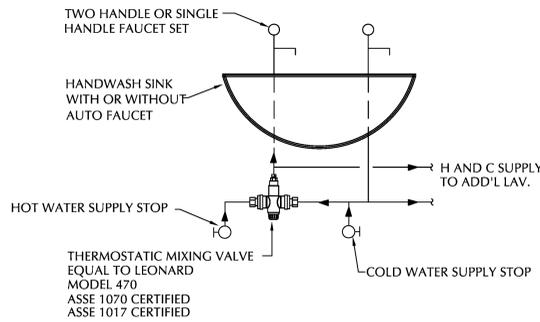

VALVE APPROXIMATELY 6"x4"
 INSTALL PER MANUFACTURER'S RECOMMENDATIONS.
 PROVIDE SUPPORT AS REQUIRED.
 INSULATE ALL EXPOSED SUPPLY AND WASTE PIPING INCLUDING MIXING VALVE UNDER LAVATORY TO MEET ADA GUIDELINE REQUIREMENTS.
 VALVE TO PROVIDE MAXIMUM 109 DEGREE F WATER TO HANDWASH SINKS.


HANDWASH SINK MIXING VALVE DETAIL
NO SCALE

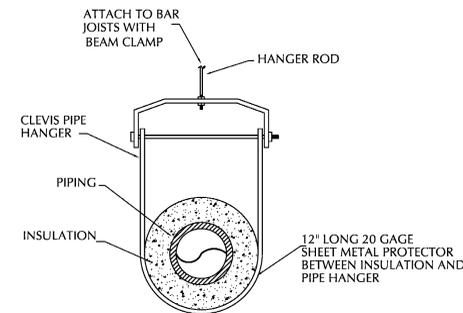

SUPPORT ALL PIPING ACCORDING TO THE IPC
 INSULATE ALL PIPING ACCORDING TO THE SPECIFICATIONS
 INSULATE ALL COLD PIPING WHICH WILL FORM CONDENSATE ON THE OUTSIDE OF THE PIPE. SEE DRAWINGS AND SPECS.


TYPICAL PIPE HANGER DETAIL

THE DIVISION 15 CONTRACTOR SHALL PROVIDE AND INSTALL 120V TO 24 V TRANSFORMERS, LOW VOLTAGE CONTROL WIRING, FOR MECHANICAL COMPONENTS SHOWN ON THE DRAWINGS AND IN THE CONTROLS SUBMITTALS. THE MECHANICAL DIVISION 15 CONTRACTOR WILL NOT BE RESPONSIBLE FOR INSTALLING ANY 120 VOLT POWER WIRING TO ANY CONTROLLERS. THAT RESPONSIBILITY IS THE ELECTRICAL DIVISION 16 CONTRACTOR.

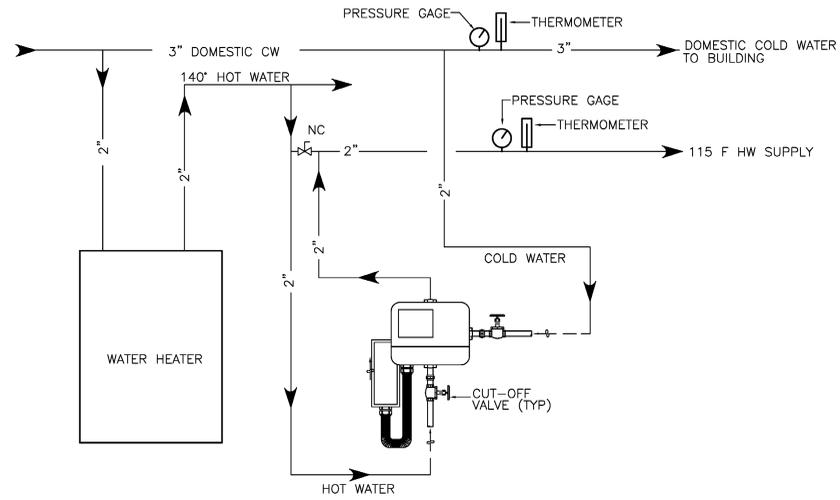

PROVIDE AND INSTALL THERMOSTATIC MIXING VALVE UNIT EQUAL TO POWERS MODEL INTLSTN LFIS075VL. VALVE CAPABLE OF FLOW RANGE FROM 1 GPM TO 50 GPM HOT WATER WITH MAX PRESSURE DROP OF 5 PSI.
 POWER: 115 V (AC), 50 / 60 HZ, 20 VA
 ACTUATOR LOAD: 24 V (DC), 0.55 A, 13 W

TYPICAL THERMOSTATIC MIXING VALVE DETAIL
NO SCALE

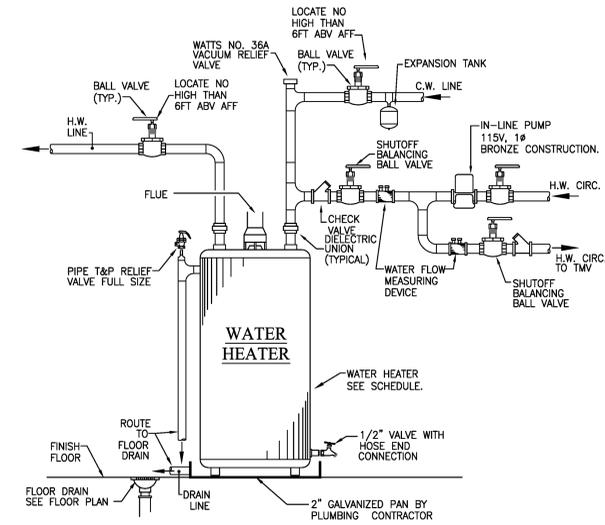

TYPICAL WATER HEATER DETAILS

WATER HEATER SCHEDULE										
MARK	MANUFACTURER	MODEL	STORAGE GAL	RECOVERY GPH	DISCHARGE TEMP	TEMP RISE	FUEL TYPE	INPUT	CHARACTERISTICS	REMARKS
WH-1	AO SMITH	BTR-197	100	193	120° F	80° F	GAS	199,000 BTUH	120V, 1 PH	COORDINATE ELECTRICAL WITH DIV. 16 CONTRACTOR.

PRODUCTS SHALL BE MADE IN USA PER 2CFR 200.322 ESSER GUIDELINES.

EXPANSION TANK SCHEDULE								
MARK	MAKE	SYSTEM	SYSTEM DESIGN PARAMETERS				TANK SIZE	
			TEMP. RANGE	VOLUME	FILL PRESSURE	RELIEF	MODEL	GAL.
ET-1	WATTS	DOMESTIC HOT WATER	40-140 F	4.5 GAL	20	150	PLT-12	4.5

PRODUCTS SHALL BE MADE IN USA PER 2CFR 200.322 ESSER GUIDELINES.

PLUMBING FIXTURE SCHEDULE										
TAG	FIXTURE TYPE	SUPPLY AND AIR CHAMBER FOR FIXTURE		TRIM REQ' TS.	WASTE/VENT REQ' TS.		MTG. HEIGHT (FLR. to RIM)	LOCATION	REMARKS	
		HW	CW		WASTE	VENT				
WC-1	FLOOR MOUNTED WATER CLOSET	-	1"	FLUSH VALVE STOP/SEAT	4"	2"	15"	TOILET	ELONGATED, TOP SPUD, FLOOR OUTLET, STANDARD, SIPHON ACTION, WHITE, CHINA, NOTE 1. FIXTURE EQUAL TO KOHLER K-4350, SLOAN FLUSH VALVE EQUAL TO ROYAL M# 111, CHROME PLATED, 1.6 GPF	
WC-2	FLOOR MOUNTED WATER CLOSET	-	1"	FLUSH VALVE STOP/SEAT	4"	2"	17 1/2"	TOILET	ACCESSIBLE, ASME A112.19.2 A.D.A., ELONGATED, TOP SPUD, FLOOR OUTLET, STANDARD, SIPHON ACTION, WHITE, CHINA, NOTE 1. FIXTURE EQUAL TO KOHLER K-4368, SLOAN FLUSH VALVE EQUAL TO ROYAL M# 111, CHROME PLATED, 1.6 GPF	
L-1	SINK	1/2"	1/2"	FAUCET, STOPS DRAIN	2"	2"	34"	AS SHOWN	ZURN MODEL #5340, 20" x 18" WALL MOUNTED LAV, VITREOUS CHINA, 4" CENTERS, FOR CONCEALED ARMS SUPPORT, WITH BACKSPASH, WITH CHICAGO FAUCET MODEL 895-3177CABCP W/ 1.5 GPM LAMINAR FLOW CONTROL FAUCET, GRID DRAIN, CAST BRASS P-TRAP, BRASS STOPS AND RIGID SUPPLIES, AND JR SMITH #0710 SERIES FLOOR MOUNTED CARRIER.	
S-1	HANDWASH SINK	1/2"	1/2"	FAUCET, STOPS DRAIN	2"	2"	34"	AS SHOWN	WALL HUNG, STAINLESS, 4"CTRS, HANDWASH SINK, 18"D x 20"W. GOOSENECK FAUCET WITH 4" WRISTBLADE HANDLES, NSF.	
S-2	3-COMP POT SINK	1/2"	1/2"	FAUCET, STOPS DRAIN	2"	2"	34"	AS SHOWN	3-COMPARTMENT, 300 SERIES STAINLESS STEEL, 8" CTR HOLE, TILE EDGE SPLASH, ROLLED EDGE, STAINLESS LEGS, NSF, 60" x 15". BACK SPLASH MOUNT FAUCET WITH WRISTBLADES HANDLES.	
FFCO	FLOOR CLEANOUT	-	-	-	PER PIPE SIZE	-	-	AS SHOWN	JAY R SMITH MODEL #4021S FLOOR CLEANOUT WITH NICKEL BRONZE COVER AND GASKET SEAL BRONZE PLUG.	
MS-1	MOPSINK	1/2"	1/2"	-	3"	2"	-	AS SHOWN	ACORN TERRAZZO-WARE MODEL #TNC-24-SH-SSC CORNER TYPE, FLOOR MOUNTED MOP SINK, DROP FRONT, STAINLESS STEEL CAP, WITH CHICAGO FAUCET MODEL 897-CP FAUCET WITH VACUUM BREAKER SPOUT, PAIL HOOK, AND WALL BRACKET.	
TP-1	TRAP PRIMER	-	1/2"	-	-	-	-	AS SHOWN	JOSAM 88300 TRAP PRIMER VALVE AND DISTRIBUTION UNIT	
HB-1	HOSE BIBB	-	3/4"	-	-	-	-	AS SHOWN	EQUAL TO WOODFORD MODEL B65 FREEZELESS RECESSED WALL HYDRANT.	
IMB-1	ICE MAKER BOX	-	1/2"	-	-	-	-	AS SHOWN	RECESSED BOX IN WALL WITH 1/2" ANGLE STOP FIXTURE EQUAL TO WATER TITE M# W9700	
FD-1	FLOOR DRAIN	-	1/2"	-	3"	2"	-	AS SHOWN	ZURN MODEL #ZB-415-B FLOOR DRAIN WITH ADJUSTABLE ROUND NICKEL BRONZE STRAINER.	
FD-2	FLOOR DRAIN	-	1/2"	-	4"	2"	-	AS SHOWN	12" ROUND FLOOR DRAIN, BRONZE GRATE, EQUAL TO JR SMITH MODEL# 2230	
FD-3	FLOOR DRAIN	-	1/2"	-	3"	2"	-	AS SHOWN	EQUAL TO ZURN M# ZB-415-4, ADJUSTABLE STRAINER HEAD	

- NOTE:**
- TOILET SEATS TO BE AMERICAN STANDARD 5311.012 MOLDED (OR EQUAL), WHITE, WITH OPEN FRONT IN PUBLIC USE AREAS. SEATS TO BE SOLID PLASTIC W/STAINLESS HINGES.
 - ALL FIXTURES TO BE WHITE IN COLOR UNLESS OTHERWISE SPECIFICALLY NOTED.
 - CONTRACTOR TO PROVIDE AND INSTALL ALL SEATS, GRAB BARS, HAND HELD DEVICES, OFFSET MIXING VALVES, FAUCET HANDLES, INSULATION, AND ETC TO MEET REQUIREMENTS OF THE ADA ACCESSIBILITY GUIDELINE.
 - ALL EXPOSED PLUMBING TO BE CHROME PLATED BRASS. NO PLASTIC IS ACCEPTABLE.

ALL PLUMBING FIXTURES AND COMPONENTS INCLUDING, BUT NOT LIMITED TO, WATER CLOSETS, FLUSH VALVES, SINKS, FAUCETS, ETC. TO HAVE FINAL APPROVAL BY OWNER.

HVAC SYMBOLS & ABBREVIATIONS

ABBREVIATIONS

AD	ACCESS DOOR	EWT	ENTERING WATER TEMPERATURE	OPNG	OPENING
AHU	AIR HANDLING UNIT	EUH	ELECTRIC UNIT HEATER	P	PRESSURE
AI	ANALOG INPUT	EXH	EXHAUST	PAT	PREHEAT AIR TEMP
AO	ANALOG OUTPUT	FCU	FAN COIL UNIT	PSI	POUNDS PER SQUARE INCH
AFF	ABOVE FINISH FLOOR	FD	FIRE DAMPER	PTU	PACKAGED TERMINAL UNIT
AFG	ABOVE FINISH GRADE	F/SD	FIRE/SMOKE DAMPER	QTY	QUANTITY
AFMD	AIR FLOW MEASURING DEVICE	FPM	FEET PER MINUTE	RAD	RETURN AIR DAMPER
ARCH	ARCHITECTURAL	FSTAT	FREEZESTAT	REQ'D	REQUIRED
BD	BACKDRAFT DAMPER	GPM	GALLONS PER MINUTE	R/A	RETURN AIR
BI	BINARY INPUT	GUH	GAS UNIT HEATER	RAT	RETURN AIR TEMP.
BO	BINARY OUTPUT	H	HUMIDISTAT	RPM	REVOLUTIONS PER MINUTE
BTUH	BRITISH THERMAL UNITS/HOUR	HWV	HEATING WATER VALVE	SA	SOUND ATTENUATOR
BYP	BYPASS	HWP	HOT WATER PUMP	S/A	SUPPLY AIR
CAT	COOLING AIR TEMP	KW	KILOWATT	SAT	SUPPLY AIR TEMP
CFM	CUBIC FEET PER MINUTE	LAT	LEAVING AIR TEMPERATURE	SD	SPLITTER DAMPER
CHP	CHILLED WATER PUMP	LF	LINEAR FEET	SF	SUPPLY FAN
CHWV	CHILLED WATER VALVE	LG	LONG	SP	STATIC PRESSURE
CLG	CEILING	LVG	LEAVING	S	SENSOR
DB	DRY BULB	LWT	LEAVING WATER TEMP	SS	STAINLESS STEEL
dF	DEGREES FAHRENHEIT	MAT	MIXED AIR TEMP	T	THERMOSTAT
DIFF	DIFFUSER	MAX	MAXIMUM	TSP	TOTAL STATIC PRESSURE
DN	DOWN	MBH	THOUSAND BTU/HR	TYP	TYPICAL
DWG	DRAWING	MBC	MODULAR BUILDING CONTROLLER	UH	UNIT HEATER
EA	EACH	M.D.	MOTORIZED DAMPER	VAV	VARIABLE AIR VOLUME
EAT	ENTERING AIR TEMPERATURE	MECH	MECHANICAL	VFD	VARIABLE FREQUENCY DRIVE
EF	EXHAUST FAN	MVD	MANUAL VOLUME DAMPER	VD	VOLUME DAMPER
ELEC	ELECTRICAL	NC	NORMALLY CLOSED	2W	TWO WAY
EL	ELEVATION	NO	NORMALLY OPEN	2WO	TWO WAY CORNER
EQ	EQUAL	O/A	OUTSIDE AIR	3W	THREE WAY
ESP	EXTERNAL STATIC PRESSURE	OAT	OUTDOOR AIR TEMP	4W	FOUR WAY
EWB	ELECTRIC WALL HEATER	OAD	OUTDOOR AIR DAMPER	WB	WET BULB
		OBD	OPPOSED BLADE DAMPER	WFMD	WATER FLOW MEASURING DEVICE

PIPING SYMBOLS

	AUTOMATIC AIR VENT		GAS COCK
	BUTTERFLY VALVE		HOSE BIB W/ VACUUM BREAKER
	BALANCING VALVE		HOT WATER HEATING RETURN
	BOTTOM CONNECTION BRANCH		HOT WATER HEATING SUPPLY
	CAPPED PIPE END		O.S.&Y. VALVE
	CHECK VALVE		PIPE RISE OR DROP
	COMBINATION SHUT-OFF/ BALANCING VALVE		RETURN LINE
	CONCENTRIC REDUCER		RISER DN
	CONDENSATE DRAIN		RISER UP
	CHILLED WATER RETURN		SLURRY LINE
	CHILLED WATER SUPPLY		SOLENOID VALVE
	CUT-OFF VALVE (ABOVE GRADE)		SIDE CONNECTION BRANCH
	CUT-OFF VALVE (BELOW GRADE)		TEE DOWN
	CUT-OFF VALVE (GATE VALVE WITH HOSE COUPLING)		TEE UP
	ECCENTRIC REDUCER		THERMOMETER
	ELBOW UP		THERMOMETER WELL
	ELBOW DOWN		TOP CONNECTION BRANCH
	FLEXIBLE PIPE CONNECTION		UNION
	FLOW IN DIRECTION OF ARROW		2-WAY AUTOMATIC CONTROL VALVE
	FUEL OIL RETURN		3-WAY AUTOMATIC CONTROL VALVE
	FUEL OIL SUPPLY		Y-TYPE STRAINER
	FUEL OIL VENT		Y-TYPE STRAINER
	GAUGE COCK		WATER FLOW MEASURING DEVICE (WFMD)

DUCTWORK SYMBOLS

SYMBOL	DESCRIPTION
	RISE IN DUCT, IN DIRECTION OF AIR FLOW
	DROP IN DUCT, IN DIRECTION OF AIR FLOW
	SUPPLY AIR DUCT, UP
	SUPPLY AIR DUCT, DN
	RETURN, EXHAUST, OR OUTSIDE AIR DUCT, UP
	RETURN, EXHAUST, OR OUTSIDE AIR DUCT, DN
	RETURN OR EXHAUST GRILLE, CEILING MTD.
	DIFFUSER SYMBOL 200 → CFM 4-WAY
	DIFFUSER SYMBOL 200 → CFM 2-WAY
	DIFFUSER SYMBOL 200 → CFM OR 200 → CFM
	DUCTWORK
	VANED ELBOW (PROVIDE ALL SQUARE OR RECTANGULAR ELBOWS WITH VANES.)
	SPLITTER FURNISH MANUAL VOLUME DPR. IN EACH LEG OF ALL SPLITTERS.
	MANUAL VOLUME DAMPER
	FIRE DAMPER
	LINEAR SLOT DIFFUSER
	THERMOSTAT, HUMIDISTAT, SENSOR WALL THERMOSTAT MTD. 5'-0" AFF.
	INDICATES POINT OF CONNECTION BETWEEN NEW AND EXISTING APPURTENANCES.
	INDICATES POINT OF DISCONNECT BETWEEN NEW AND EXISTING APPURTENANCES.

A. INSTALLATION

ALL PIPING OR DUCTS IN FINISHED ROOMS OR SPACES SHALL BE CONCEALED IN FURRED CHASES OR ABOVE CEILINGS. PROVIDE ACCESS PANELS IN HARD CEILINGS ADJACENT TO OPERABLE MECHANICAL DEVICES INCLUDING DAMPERS, VALVES, CONTROLS, AND TERMINAL UNITS (IF NOT ACCESSIBLE THROUGH ATTIC). PANELS TO MAINTAIN SAME FIRE RATING AS CEILING SYSTEM AND HAVE HINGED AND LATCHED DOOR. PANELS TO BE MINIMUM 12"x12" AND MAXIMUM 24"x24" DEPENDING ON THE DEVICE TO BE ACCESSED.

THERMOSTATS SHALL BE LOCATED 5'-0" ABOVE FLOOR AND SHALL CLEAR ALL EQUIPMENT. THERMOSTATS LOCATED NEXT TO DOORS SHALL BE LOCATED ON LATCH SIDE OF DOOR, AND AT SAME LEVEL AS LIGHT SWITCH. COORDINATE WITH ARCHITECTURAL.

COORDINATE DIFFUSER, GRILLE, AND REGISTER LOCATIONS WITH LAY-IN CEILING GRID AND ARCHITECTURAL CEILING PLAN. EXACT LOCATION OF DEVICES IS NOT CRITICAL BUT SHOULD BE LOCATED WITHIN TWO FEET OF SPOT SHOWN ON DRAWINGS.

THE CONTRACTOR SHALL EXERCISE EXTREME CARE IN THE COORDINATION OF WORK OF ALL TRADES TO ASSURE PROPER INSTALLATION AND CLEARANCES. DRAWINGS ARE ESSENTIALLY DIAGRAMMATICAL AND THEREFORE CONTRACTOR SHOULD PLAN EXACT ROUTING OF DUCT AND PIPE BASED ON FIELD CONDITIONS. PROVIDE ADDITIONAL TRANSITIONS AND OFFSETS AS NECESSARY (AT NO ADDITIONAL COST TO OWNER) TO COMPLETE INSTALLATION AND MAINTAIN REQUIRED CEILING HEIGHTS.

ACCESS PANELS IN DUCTWORK AND NON-ACCESSIBLE CEILINGS SHALL BE PROVIDED FOR OPERATION AND MAINTENANCE OF ALL BOXES, COILS, VALVES, TRAPS, DAMPERS, CLEANOUTS, CONTROLS, ETC. PROVIDE MINIMUM 24"x24" CEILING ACCESS PANEL FOR VAV BOXES AND 12"x12" FOR DAMPERS. COORDINATE EXACT PLACEMENT OF ACCESS PANELS AND EQUIPMENT SO THAT REASONABLE MAINTENANCE SPACE IS AVAILABLE. NO ACCESS PANELS SHALL BE PROVIDED IN SECURE AREAS.

INSTALLATION OF ALL EQUIPMENT AND SYSTEMS SHALL BE IN ACCORDANCE WITH STANDARD DETAILS, SECTIONS, AND ELEVATIONS SHOWN ON THE DRAWINGS.

CONTRACTOR SHALL MAINTAIN A CLEAR SERVICE AREA AROUND ALL EQUIPMENT FOR MAINTENANCE SUCH AS, FILTER REMOVAL, MOTOR AND DRIVE ADJUSTMENTS, COIL AND TUBE CLEANING OR REMOVAL.

PROVIDE ALL DRAIN PIPING FROM MECHANICAL EQUIPMENT WITH 2" AIR GAP CONNECTION AT WASTE PIPE, FLOOR DRAIN, OR ETC.

B. DUCTWORK

ALL DUCT RUNOUTS TO DIFFUSERS, RETURN AIR GRILLES, AND EXHAUST GRILLES SHALL BE COMPLETE WITH MANUAL VOLUME DAMPERS UNLESS NOTED OTHERWISE. LOCATE DAMPERS SO THEY ARE ACCESSIBLE FROM LAY-IN CEILING, ATTIC, OR ACCESS PANEL.

ROUND SUPPLY RUNOUTS TO DIFFUSERS SHALL BE HARD METAL. MAXIMUM 6'-0" OF FLEXIBLE DUCT MAY BE USED FOR FINAL CONNECTION TO DIFFUSER.

DUCT TRANSITIONS SHALL BE PROVIDED AS REQUIRED FROM ALL EQUIPMENT CONNECTIONS TO DUCT SIZES INDICATED ON DRAWINGS.

PROVIDE EASED INLET RECTANGULAR TO ROUND TAPS AT DUCT TAPS IF ROUND DUCT SIZE IS TOO LARGE FOR BELL MOUTH TAP TO TRUNK DUCT.

ALL EXTERIOR OPENINGS (INTAKE AND EXHAUST DUCTS, LOUVERS, FANS, ETC.) SHALL BE PROVIDED WITH BIRD SCREENING WHICH SHALL BE EASILY REMOVED FOR CLEANING AND ACCESS TO EQUIPMENT.

ALL DUCT SIZES INDICATE OUTSIDE DIMENSIONS OF SHEET METAL. NO ALLOWANCE FOR INSULATION IS SHOWN ON DRAWINGS.

PROVIDE HEMMED EDGES OVER RAW ENDS OF INSULATION AND SEAL WITH MASTIC FOR ALL LINED RETURN AIR DUCTS STUBBED INTO RETURN AIR PLENUMS.

ALL DUCT PLENUMS AND DUCTS (MINIMUM OF 5'-0" FROM LOUVER) CONNECTED TO EXTERIOR LOUVERS SHALL HAVE LIQUID TIGHT SEAMS AND LIQUID TIGHT CONNECTION TO LOUVER. SLOPE DOWN TO LOUVER AND ATTACH SO WATER WILL DRAIN TO OUTSIDE. PROVIDE 24"x24" (OR EQUIVALENT) ACCESS DOOR AT LOUVER IN EASILY ACCESSIBLE LOCATION FOR ACCESS TO LOUVER PLENUM AND LOUVER.

ALL RECTANGULAR DUCT SHALL BE GALVANIZED SHEET METAL WITH 2" EXTERIOR DUCT WRAP FIBERGLASS INSULATION. SEAL ALL DUCT JOINTS AND INSULATION JOINTS AIRTIGHT.


ALL ROUND BRANCH DUCTS SHALL BE GALVANIZED SHEET METAL WITH SAME INSULATION AS ABOVE. FLEXIBLE DUCTS OF NO MORE THAN 6 FEET MAY BE USED FOR DEVICE CONNECTIONS. ALL BRANCH DUCTS MUST HAVE STARTING COLLARS WITH INTEGRAL BALANCING DAMPERS.

SUPPORT ALL DUCT ACCORDING TO THE INTERNATIONAL MECHANICAL CODE AND SMACNA.

C. EQUIPMENT INSTALLATION

SAFE-OFF AIRTIGHT AROUND ALL COILS, SOUND TRAPS, FILTERS, ETC. WITH 16 GAGE GALVANIZED SHEET METAL SET IN NON-HARDENING FIRE RETARDANT MASTIC.

SUPPLY AIR DIFFUSER	
AIRFLOW	DUCT/NECK SIZE
0 - 100 CFM	6" ROUND
110 - 220 CFM	8" ROUND
225 - 400 CFM	10" ROUND
410 - 600 CFM	12" ROUND

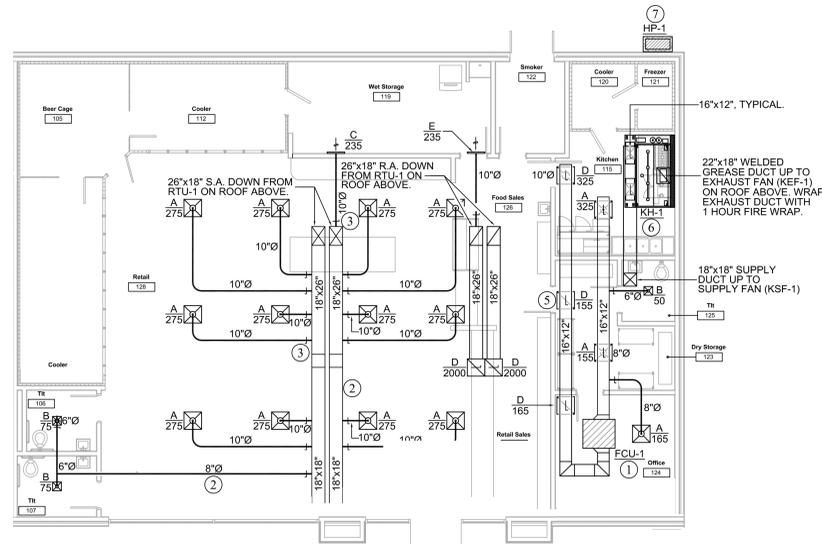


GENERAL NOTES:

- ALL CENTRAL AIR HANDLING UNITS SUPPLYING MORE THAN 2000 CFM AND/OR SERVING AN EXIT CORRIDOR SHALL HAVE SMOKE DETECTION TO INTERRUPT POWER. AHU SMOKE CONTROLS SHALL BE CONNECTED TO THE AUTOMATIC FIRE ALARM SYSTEM AS REQUIRED BY CODE.
- ALL INTERIOR DUCT TO BE INSULATED WITH 2" FIBERGLASS DUCT WRAP WITH FOIL BACK VAPOR BARRIER. SEAL ALL SEAMS AND LAPS WITH 2" HIGH PRESSURE FOIL TAPE. SEAL ALL DUCT JOINTS WITH MASTIC DUCT SEALANT.
- RECTANGULAR DUCT TO BE GALVANIZED SHEET METAL. LOW PRESSURE ROUND BRANCH DUCT TO BE SNAP LOCK GALVANIZED SHEET METAL TO WITHIN SIX FEET OF THE DIFFUSER CONNECTIONS WHERE FLEXIBLE DUCT MAY BE USED.
- ALL DUCT PENETRATING FIREWALLS SHALL BE EQUIPPED WITH DYNAMIC RATED FIRE DAMPERS. PROVIDE ACCESS PANELS AT EACH SIDE OF ALL FIRE DAMPER LOCATIONS. INSTALL ACCORDING TO MANUFACTURER'S RECOMMENDATIONS AND THE INTERNATIONAL MECHANICAL CODE.
- CONTRACTOR TO COORDINATE ALL ROOF LEVEL MECHANICAL WORK INCLUDING PENETRATIONS AND EQUIPMENT INSTALLATION WITH GENERAL CONTRACTOR.
- PROVIDE ACCESS PANELS IN DUCTS AT ALL FIRE AND FIRE/SMOKE DAMPERS WHERE APPLICABLE.
- COORDINATE HORIZONTAL ROUTE OF DUCT THROUGH EXTERIOR WALL WITH COLUMNS, WINDOWS, OVERHANGS, ETC.
- CONTRACTOR TO CONSULT ENGINEER WITH ALL QUESTIONS BEFORE PROCEEDING WITH WORK.
- COORDINATE WORK WITH OWNER. ALL WORK IN THE OCCUPIED SPACE TO BE COMPLETED AT OWNER'S CONVENIENCE.
- ALL WORK SHALL BE COMPLETED IN CONFORMANCE WITH THE 2018 INTERNATIONAL CODE SERIES.
- DUCT SIZES SHOWN MAY BE MODIFIED BY THE CONTRACTOR TO ACCOMMODATE CLEARANCE REQUIREMENTS AS LONG AS THE NET FREE AIRFLOW AREA IS NOT CHANGED. CONSULT ENGINEER FOR ASSISTANCE.
- RECTANGULAR DUCT DIMENSIONS SHOWN ARE INSIDE CLEAR. NO ALLOWANCE FOR INSULATION.
- MOUNT ALL DUCTWORK AS HIGH AS POSSIBLE. TRANSITION DUCT IN UPWARD DIRECTION TO MAINTAIN MAXIMUM CLEARANCE BETWEEN DUCT AND CEILING. COORDINATE ROUTING OF DUCT WITH BOTH PLUMBING TRADES, ELECTRICAL TRADES, AND STRUCTURE.
- THE DESIGN MECHANICAL ENGINEER WILL NOT BE RESPONSIBLE FOR THE RESULTS OF VALUE ENGINEERING BY THE CONTRACTOR/OWNER WHICH INVOLVES MODIFICATION OF THE MECHANICAL AND HVAC SYSTEMS AND THEIR CAPACITIES, ETC.
- PROVIDE REDUCERS, TRANSITIONS, AND FITTINGS AS REQUIRED FOR ALL CONNECTIONS AT EQUIPMENT AS SHOWN.
- PROVIDE REINFORCED CONCRETE BASE FOR ALL NEW EQUIPMENT AS SHOWN ON DRAWING. CHAMFER PAD EDGES AT 45 DEGREE ANGLE.
- ALL EQUIPMENT, LABOR, MATERIAL, AND COORDINATION TO COMPLETE THIS PROJECT PER THE DESIGN INTENT SHALL BE PROVIDED BY CONTRACTOR.
- COORDINATE INSTALLATION OF EQUIPMENT AND UTILITIES WITH CONDITIONS AT SITE. CONTRACTOR MAY MODIFY ROUTING OF DUCT AS REQUIRED BY SITE CONDITIONS. IF CHANGES IN SIZE ARE REQUIRED CONSULT ENGINEER.
- CONTRACTOR IS RESPONSIBLE FOR ALL WORK REQUIRED TO COMPLETE THE PROJECT IN AGREEMENT WITH THE DESIGN INTENT SHOWN ON THESE DRAWINGS. ANY DUCT DIMENSION SHOWN MAY BE MODIFIED BY CONTRACTOR FOR COORDINATION PURPOSES WHILE ENSURING THAT AIRFLOW AREA DOES NOT DECREASE.
- PROVIDE AABC OR NEBB TAB AGENT TO TEST, ADJUST, AND BALANCE THE AIR SYSTEMS MODIFIED ON THIS PROJECT TO WITHIN +/- 10%. PROVIDE COMPLETE TAB REPORT TO ENGINEER BEFORE SCHEDULING FINAL INSPECTION. COMPLETE FINAL BALANCING AND SUBMIT REPORT TO ENGINEER.
- THE MECHANICAL CONTRACTOR SHALL PROVIDE AND INSTALL 120V TO 24 V TRANSFORMERS AND LOW VOLTAGE CONTROL WIRING FOR MECHANICAL COMPONENTS SHOWN ON THE DRAWINGS AND IN THE CONTROLS SUBMITTALS. THE MECHANICAL CONTRACTOR WILL NOT BE RESPONSIBLE FOR INSTALLING ANY 120 VOLT POWER WIRING TO ANY CONTROLLERS. THAT RESPONSIBILITY IS THE ELECTRICAL CONTRACTOR.
- ALL BRANCH DUCT STARTING COLLARS SHOULD HAVE BALANCING DAMPERS, ABOVE SUSPENDED CEILINGS.
- MAXIMUM LENGTH OF FLEXIBLE DUCT IS SIX FEET. FLEXIBLE DUCT SHOULD NOT BE USED TO MAKE ABRUPT CHANGES IN DIRECTION OR FOR EXHAUST OR RETURN AIR.
- MINOR MODIFICATION OF DUCT SIZING AND ROUTING MAY BE REQUIRED DURING INSTALLATION. ANY CHANGES WHICH INCREASES/DECREASES AIRFLOW AREA BY GREATER THAN 10% SHOULD BE PREAPPROVED.
- ALL EQUIPMENT, LABOR, MATERIAL, AND COORDINATION TO COMPLETE THIS PROJECT PER THE DESIGN INTENT SHALL BE PROVIDED BY CONTRACTOR.

NUMBERED NOTES:

- ① PROVIDE AND INSTALL HORIZONTAL FAN COIL UNIT MOUNTED ABOVE CEILING LEVEL AS SHOWN. ROUTE HORIZONTAL SUPPLY AND RETURN AIR DUCT FROM FCU AND SEAL AIR TIGHT. PROVIDE REFRIGERANT PIPING TO CORRESPONDING CONDENSING UNIT AND CONTROLS TO THERMOSTATS. SUPPORT FROM STRUCTURE ABOVE. SEE SHEET M.6 FOR FAN COIL UNIT DETAIL.
- ② PROVIDE AND INSTALL NEW LOW PRESSURE SUPPLY DUCT SIZED AND ROUTED AS SHOWN WITH TRANSITIONS BY CONTRACTOR. HOLD DUCT AS HIGH AS POSSIBLE TO STRUCTURE AND CONSTRUCT/ROUTE IN A NEAT AND ORGANIZED MANNER.
- ③ PROVIDE AND INSTALL MANUAL BALANCING DAMPERS AT ALL BRANCH DUCT TAKE OFFS. ALL TYPICAL.
- ④ PROVIDE AND INSTALL NEW CEILING MOUNTED SUPPLY GRILLES IN LOCATIONS SHOWN. CONNECT TO NEW DUCT WITH TRANSITION AND FITTING AS REQUIRED. COORDINATE WITH ARCHITECTURAL CEILING LAYOUT AND ELECTRICAL LAYOUT. ALL TYPICAL.
- ⑤ PROVIDE AND INSTALL CUBE CORE RETURN AIR GRILLES WITH MANUAL VOLUME DAMPERS IN CEILING AT LOCATIONS SHOWN. SEE GRILLE SCHEDULE FOR SIZES. TYPICAL ALL LOCATIONS.
- ⑥ PROVIDE AND INSTALL STAINLESS STEEL KITCHEN HOOD. INCLUDE EXHAUST/SUPPLY FANS, CONTROL PANELS, LIGHTS, FILTERS, FIRE SUPPRESSION, GREASE CUP, TEMPERATURE SENSOR, ANY OTHER CODE REQUIRED COMPONENTS. ROUTE WELDED GREASE EXHAUST DUCT UP EXHAUST COLLAR UP TO UPBLAST GREASE VAPOR TYPE CENTRIFUGAL EXHAUST FAN AND SUPPLY DUCT FROM SUPPLY FAN DOWN TO SUPPLY PLENUM. TRANSITION DUCTS TO FANS AND HOODS AS REQUIRED. EXHAUST DUCT TO BE SEAMLESS, WELDED, 18 GAUGE, STAINLESS STEEL GREASE DUCT. SUPPLY DUCT TO BE GALVANIZED DUCT EXTERNAL INSULATED. INSTALL PER MANUFACTURERS RECOMMENDATIONS, IMC 2018 AND LOCAL CODE. SLOPE EXHAUST DUCT 1/8" PER FOOT TOWARD HOOD.
- ⑦ PLACE CONDENSING UNIT AT LOCATION SHOWN. ROUTE NEW REFRIGERANT PIPING ABOVE GRADE TO EXTERIOR WALL AND TURN UP IN WALL TO ABOVE CEILING. ROUTE TO CORRESPONDING AIR HANDLER. INSULATE REFRIGERANT PIPING TO PREVENT CONDENSATION. SEAL PIPING PENETRATIONS WITH WATER PROOF CAULKING TO PREVENT WATER INTRUSION. SIZE AND INSTALL AS PER MANUFACTURER ACCORDING TO LENGTH AND ELEVATION. INSTALL CONDENSING UNITS ON 4" REINFORCED CONCRETE EQUIPMENT PAD.

SUPPLY AIR DIFFUSER	
AIRFLOW	DUCT/NECK SIZE
0 - 100 CFM	6" ROUND
110 - 220 CFM	8" ROUND
225 - 400 CFM	10" ROUND
410 - 600 CFM	12" ROUND

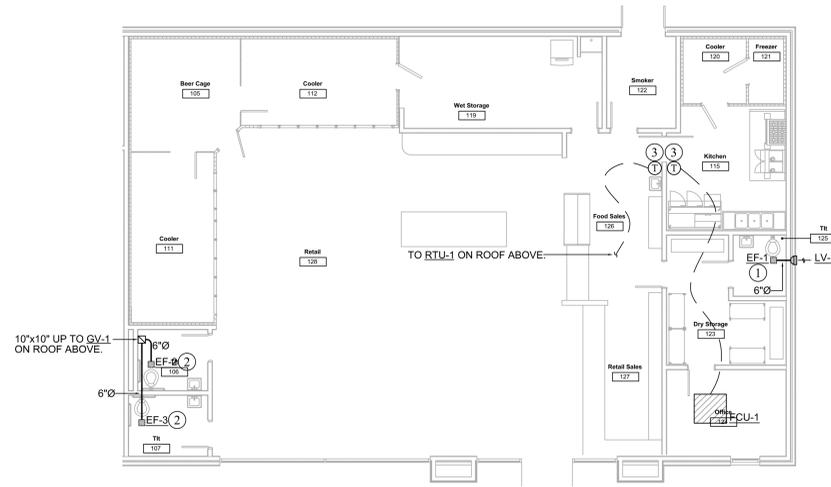

GENERAL NOTES:

ALL CENTRAL AIR HANDLING UNITS SUPPLYING MORE THAN 2000 CFM AND/OR SERVING AN EXIT CORRIDOR SHALL HAVE SMOKE DETECTION TO INTERRUPT POWER. AHU SMOKE CONTROLS SHALL BE CONNECTED TO THE AUTOMATIC FIRE ALARM SYSTEM AS REQUIRED BY CODE.

ALL INTERIOR DUCT TO BE INSULATED WITH 2" FIBERGLASS DUCT WRAP WITH FOIL BACK VAPOR BARRIER. SEAL ALL SEAMS AND LAPS WITH 2" HIGH PRESSURE FOIL TAPE. SEAL ALL DUCT JOINTS WITH MASTIC DUCT SEALANT. RECTANGULAR DUCT TO BE GALVANIZED SHEET METAL. LOW PRESSURE ROUND BRANCH DUCT TO BE SNAP LOCK GALVANIZED SHEET METAL TO WITHIN SIX FEET OF THE DIFFUSER CONNECTIONS WHERE FLEXIBLE DUCT MAY BE USED.

ALL DUCT PENETRATING FIREWALLS SHALL BE EQUIPPED WITH DYNAMIC RATED FIRE DAMPERS. PROVIDE ACCESS PANELS AT EACH SIDE OF ALL FIRE DAMPER LOCATIONS. INSTALL ACCORDING TO MANUFACTURER'S RECOMMENDATIONS AND THE INTERNATIONAL MECHANICAL CODE.

CONTRACTOR TO COORDINATE ALL ROOF LEVEL MECHANICAL WORK INCLUDING PENETRATIONS AND EQUIPMENT INSTALLATION WITH GENERAL CONTRACTOR.

PROVIDE ACCESS PANELS IN DUCTS AT ALL FIRE AND FIRE/SMOKE DAMPERS WHERE APPLICABLE.

COORDINATE HORIZONTAL ROUTE OF DUCT THROUGH EXTERIOR WALL WITH COLUMNS, WINDOWS, OVERHANGS, ETC.

CONTRACTOR TO CONSULT ENGINEER WITH ALL QUESTIONS BEFORE PROCEEDING WITH WORK.

COORDINATE WORK WITH OWNER. ALL WORK IN THE OCCUPIED SPACE TO BE COMPLETED AT OWNER'S CONVENIENCE.

ALL WORK SHALL BE COMPLETED IN CONFORMANCE WITH THE 2018 INTERNATIONAL CODE SERIES.

DUCT SIZES SHOWN MAY BE MODIFIED BY THE CONTRACTOR TO ACCOMMODATE CLEARANCE REQUIREMENTS AS LONG AS THE NET FREE AIRFLOW AREA IS NOT CHANGED. CONSULT ENGINEER FOR ASSISTANCE.

RECTANGULAR DUCT DIMENSIONS SHOWN ARE INSIDE CLEAR. NO ALLOWANCE FOR INSULATION.

MOUNT ALL DUCTWORK AS HIGH AS POSSIBLE. TRANSITION DUCT IN UPWARD DIRECTION TO MAINTAIN MAXIMUM CLEARANCE BETWEEN DUCT AND CEILING. COORDINATE ROUTING OF DUCT WITH BOTH PLUMBING TRADES, ELECTRICAL TRADES, AND STRUCTURE.

THE DESIGN MECHANICAL ENGINEER WILL NOT BE RESPONSIBLE FOR THE RESULTS OF VALUE ENGINEERING BY THE CONTRACTOR/OWNER WHICH INVOLVES MODIFICATION OF THE MECHANICAL AND HVAC SYSTEMS AND THEIR CAPACITIES, ETC.

PROVIDE REDUCERS, TRANSITIONS, AND FITTINGS AS REQUIRED FOR ALL CONNECTIONS AT EQUIPMENT AS SHOWN.

PROVIDE REINFORCED CONCRETE BASE FOR ALL NEW EQUIPMENT AS SHOWN ON DRAWING. CHAMFER PAD EDGES AT 45 DEGREE ANGLE.

ALL EQUIPMENT, LABOR, MATERIAL, AND COORDINATION TO COMPLETE THIS PROJECT PER THE DESIGN INTENT SHALL BE PROVIDED BY CONTRACTOR.

COORDINATE INSTALLATION OF EQUIPMENT AND UTILITIES WITH CONDITIONS AT SITE. CONTRACTOR MAY MODIFY ROUTING OF DUCT AS REQUIRED BY SITE CONDITIONS. IF CHANGES IN SIZE ARE REQUIRED CONSULT ENGINEER.

CONTRACTOR IS RESPONSIBLE FOR ALL WORK REQUIRED TO COMPLETE THE PROJECT IN AGREEMENT WITH THE DESIGN INTENT SHOWN ON THESE DRAWINGS. ANY DUCT DIMENSION SHOWN MAY BE MODIFIED BY CONTRACTOR FOR COORDINATION PURPOSES WHILE ENSURING THAT AIRFLOW AREA DOES NOT DECREASE.

PROVIDE AABC OR NEBB TAB AGENT TO TEST, ADJUST, AND BALANCE THE AIR SYSTEMS MODIFIED ON THIS PROJECT TO WITHIN +/- 10%. PROVIDE COMPLETE TAB REPORT TO ENGINEER BEFORE SCHEDULING FINAL INSPECTION. COMPLETE FINAL BALANCING AND SUBMIT REPORT TO ENGINEER.

THE MECHANICAL CONTRACTOR SHALL PROVIDE AND INSTALL 120V TO 24 V TRANSFORMERS AND LOW VOLTAGE CONTROL WIRING FOR MECHANICAL COMPONENTS SHOWN ON THE DRAWINGS AND IN THE CONTROLS SUBMITTALS. THE MECHANICAL CONTRACTOR WILL NOT BE RESPONSIBLE FOR INSTALLING ANY 120 VOLT POWER WIRING TO ANY CONTROLLERS. THAT RESPONSIBILITY IS THE ELECTRICAL CONTRACTOR.

ALL BRANCH DUCT STARTING COLLARS SHOULD HAVE BALANCING DAMPERS, ABOVE SUSPENDED CEILINGS.

MAXIMUM LENGTH OF FLEXIBLE DUCT IS SIX FEET. FLEXIBLE DUCT SHOULD NOT BE USED TO MAKE ABRUPT CHANGES IN DIRECTION OR FOR EXHAUST OR RETURN AIR.


MINOR MODIFICATION OF DUCT SIZING AND ROUTING MAY BE REQUIRED DURING INSTALLATION. ANY CHANGES WHICH INCREASES/DECREASES AIRFLOW AREA BY GREATER THAN 10% SHOULD BE PREAPPROVED.

ALL EQUIPMENT, LABOR, MATERIAL, AND COORDINATION TO COMPLETE THIS PROJECT PER THE DESIGN INTENT SHALL BE PROVIDED BY CONTRACTOR.

NUMBERED NOTES:

- PROVIDE AND INSTALL NEW CEILING MOUNTED EXHAUST FAN AT LOCATION SHOWN. SUPPORT EQUIPMENT WITH ALL THREAD ROD AND UNISTRUT FROM STRUCTURE ABOVE. ROUTE NEW LOW PRESSURE EXHAUST DUCT ABOVE CEILING AND TERMINATE WITH FIXED BLADE, EXTRUDED ALUMINUM, DRAINABLE, EXTERIOR WALL LOUVER WITH EXPANDED METAL BIRD SCREEN SIZED AS SHOWN. SEAL PERIMETER OF LOUVER AT OPENING WITH MATCHING MORTAR OR GROUT. BALANCE TO QUANTITY OF EXHAUST AIR PER SCHEDULE.
- PROVIDE AND INSTALL NEW CEILING MOUNTED EXHAUST FAN AT LOCATION SHOWN. SUPPORT EQUIPMENT WITH ALL THREAD ROD AND UNISTRUT FROM STRUCTURE ABOVE. ROUTE NEW LOW PRESSURE EXHAUST DUCT ABOVE CEILING AND OVER TO 10"x10" EXHAUST DUCT UP TO GRAVITY VENTILATOR GV-1 ON ROOF ABOVE. BALANCE TO QUANTITY OF EXHAUST AIR PER SCHEDULE. ROOF CURB, FLASHING, PATCHING, AND REPAIR OF ROOF BY CONTRACTOR.
- PROVIDE AND INSTALL 7 DAY PROGRAMMABLE, 2 STAGE HEAT/COOL ON/OFF LOW VOLTAGE THERMOSTAT AT LOCATION SHOWN. ROUTE CONTROL WIRING ABOVE CEILING AND DOWN IN WALLS FROM AIR HANDLER TO THERMOSTAT. PROVIDE TRANSFORMER, WIRING, THERMOSTAT, AND ELSE REQUIRED FOR COMPLETE INSTALLATION. MOUNT AT SAME HEIGHT AND ADJACENT TO LIGHT SWITCH. TYPICAL AS SHOWN.

SUPPLY AIR DIFFUSER	
AIRFLOW	DUCT/NECK SIZE
0 - 100 CFM	6" ROUND
110 - 220 CFM	8" ROUND
225 - 400 CFM	10" ROUND
410 - 600 CFM	12" ROUND

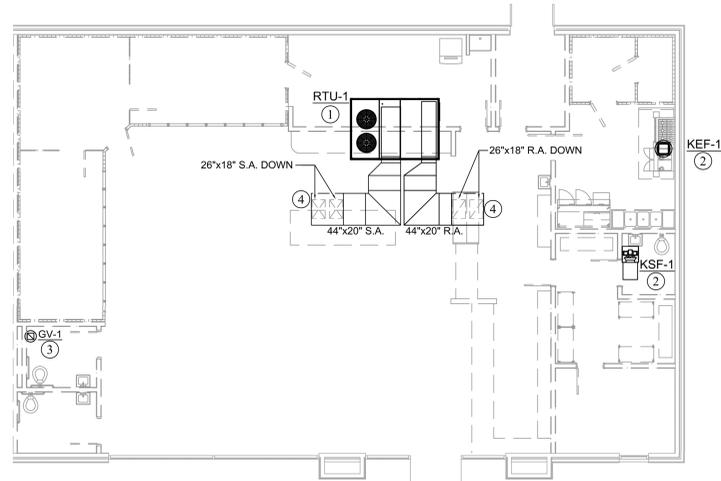

GENERAL NOTES:

ALL CENTRAL AIR HANDLING UNITS SUPPLYING MORE THAN 2000 CFM AND/OR SERVING AN EXIT CORRIDOR SHALL HAVE SMOKE DETECTION TO INTERRUPT POWER. AHU SMOKE CONTROLS SHALL BE CONNECTED TO THE AUTOMATIC FIRE ALARM SYSTEM AS REQUIRED BY CODE.

ALL INTERIOR DUCT TO BE INSULATED WITH 2" FIBERGLASS DUCT WRAP WITH FOIL BACK VAPOR BARRIER. SEAL ALL SEAMS AND LAPS WITH 2" HIGH PRESSURE FOIL TAPE. SEAL ALL DUCT JOINTS WITH MASTIC DUCT SEALANT.

RECTANGULAR DUCT TO BE GALVANIZED SHEET METAL. LOW PRESSURE ROUND BRANCH DUCT TO BE SNAP LOCK GALVANIZED SHEET METAL TO WITHIN SIX FEET OF THE DIFFUSER CONNECTIONS WHERE FLEXIBLE DUCT MAY BE USED.

ALL DUCT PENETRATING FIREWALLS SHALL BE EQUIPPED WITH DYNAMIC RATED FIRE DAMPERS. PROVIDE ACCESS PANELS AT EACH SIDE OF ALL FIRE DAMPER LOCATIONS. INSTALL ACCORDING TO MANUFACTURER'S RECOMMENDATIONS AND THE INTERNATIONAL MECHANICAL CODE.

CONTRACTOR TO COORDINATE ALL ROOF LEVEL MECHANICAL WORK INCLUDING PENETRATIONS AND EQUIPMENT INSTALLATION WITH GENERAL CONTRACTOR.

PROVIDE ACCESS PANELS IN DUCTS AT ALL FIRE AND FIRE/SMOKE DAMPERS WHERE APPLICABLE.

COORDINATE HORIZONTAL ROUTE OF DUCT THROUGH EXTERIOR WALL WITH COLUMNS, WINDOWS, OVERHANGS, ETC.

CONTRACTOR TO CONSULT ENGINEER WITH ALL QUESTIONS BEFORE PROCEEDING WITH WORK.

COORDINATE WORK WITH OWNER. ALL WORK IN THE OCCUPIED SPACE TO BE COMPLETED AT OWNER'S CONVENIENCE.

ALL WORK SHALL BE COMPLETED IN CONFORMANCE WITH THE 2018 INTERNATIONAL CODE SERIES.

DUCT SIZES SHOWN MAY BE MODIFIED BY THE CONTRACTOR TO ACCOMMODATE CLEARANCE REQUIREMENTS AS LONG AS THE NET FREE AIRFLOW AREA IS NOT CHANGED. CONSULT ENGINEER FOR ASSISTANCE.

RECTANGULAR DUCT DIMENSIONS SHOWN ARE INSIDE CLEAR. NO ALLOWANCE FOR INSULATION.

MOUNT ALL DUCTWORK AS HIGH AS POSSIBLE. TRANSITION DUCT IN UPWARD DIRECTION TO MAINTAIN MAXIMUM CLEARANCE BETWEEN DUCT AND CEILING. COORDINATE ROUTING OF DUCT WITH BOTH PLUMBING TRADES, ELECTRICAL TRADES, AND STRUCTURE.

THE DESIGN MECHANICAL ENGINEER WILL NOT BE RESPONSIBLE FOR THE RESULTS OF VALUE ENGINEERING BY THE CONTRACTOR/OWNER WHICH INVOLVES MODIFICATION OF THE MECHANICAL AND HVAC SYSTEMS AND THEIR CAPACITIES, ETC.

PROVIDE REDUCERS, TRANSITIONS, AND FITTINGS AS REQUIRED FOR ALL CONNECTIONS AT SHOWN.

PROVIDE REINFORCED CONCRETE BASE FOR ALL NEW EQUIPMENT AS SHOWN ON DRAWING. CHAMFER PAD EDGES AT 45 DEGREE ANGLE.

ALL EQUIPMENT, LABOR, MATERIAL, AND COORDINATION TO COMPLETE THIS PROJECT PER THE DESIGN INTENT SHALL BE PROVIDED BY CONTRACTOR.

COORDINATE INSTALLATION OF EQUIPMENT AND UTILITIES WITH CONDITIONS AT SITE. CONTRACTOR MAY MODIFY ROUTING OF DUCT AS REQUIRED BY SITE CONDITIONS. IF CHANGES IN SIZE ARE REQUIRED CONSULT ENGINEER.

CONTRACTOR IS RESPONSIBLE FOR ALL WORK REQUIRED TO COMPLETE THE PROJECT IN AGREEMENT WITH THE DESIGN INTENT SHOWN ON THESE DRAWINGS. ANY DUCT DIMENSION SHOWN MAY BE MODIFIED BY CONTRACTOR FOR COORDINATION PURPOSES WHILE ENSURING THAT AIRFLOW AREA DOES NOT DECREASE.

PROVIDE AABC OR NEBB TAB AGENT TO TEST, ADJUST, AND BALANCE THE AIR SYSTEMS MODIFIED ON THIS PROJECT TO WITHIN +/- 10%. PROVIDE COMPLETE TAB REPORT TO ENGINEER BEFORE SCHEDULING FINAL INSPECTION. COMPLETE FINAL BALANCING AND SUBMIT REPORT TO ENGINEER.

THE MECHANICAL CONTRACTOR SHALL PROVIDE AND INSTALL 120V TO 24 V TRANSFORMERS AND LOW VOLTAGE CONTROL WIRING FOR MECHANICAL COMPONENTS SHOWN ON THE DRAWINGS AND IN THE CONTROLS SUBMITTALS. THE MECHANICAL CONTRACTOR WILL NOT BE RESPONSIBLE FOR INSTALLING ANY 120 VOLT POWER WIRING TO ANY CONTROLLERS. THAT RESPONSIBILITY IS THE ELECTRICAL CONTRACTOR.

ALL BRANCH DUCT STARTING COLLARS SHOULD HAVE BALANCING DAMPERS, ABOVE SUSPENDED CEILINGS.

MAXIMUM LENGTH OF FLEXIBLE DUCT IS SIX FEET. FLEXIBLE DUCT SHOULD NOT BE USED TO MAKE ABRUPT CHANGES IN DIRECTION OR FOR EXHAUST OR RETURN AIR.

MINOR MODIFICATION OF DUCT SIZING AND ROUTING MAY BE REQUIRED DURING INSTALLATION. ANY CHANGES WHICH INCREASES/DECREASES AIRFLOW AREA BY GREATER THAN 10% SHOULD BE PREAPPROVED.


ALL EQUIPMENT, LABOR, MATERIAL, AND COORDINATION TO COMPLETE THIS PROJECT PER THE DESIGN INTENT SHALL BE PROVIDED BY CONTRACTOR.

FOR EXTERIOR DUCT, PROVIDE 2" RIGID EXTERIOR BOARD TYPE FIBERGLASS DUCT INSULATION WITH FSK VAPOR BARRIER. SEAL ALL SEAMS AND JOINTS TO BE AIR TIGHT. PROVIDE SECONDARY GALVANIZED METAL DUCT JACKET AROUND THE PERIMETER OF THE INSULATED AIR DISTRIBUTION DUCT. SEAL ALL JOINTS AND SEAMS WATER TIGHT.


NUMBERED NOTES:

- ① PROVIDE AND INSTALL NEW ROOFTOP AIR HANDLER AS SHOWN. PROVIDE MANUFACTURER'S REQUIRED CURB, DUCT CONNECTIONS, CONTROL CONNECTIONS, START UP, AND BALANCING OF THIS SYSTEM FOR FULLY FUNCTIONAL SYSTEM PERFORMING TO DESIGN REQUIREMENTS. ROOF PENETRATION(S), ROOF CURB, FLASHING, PATCHING, AND REPAIR OF ROOF BY CONTRACTOR.
- ② PROVIDE AND INSTALL KITCHEN HOOD EXHAUST FAN / SUPPLY FAN FOR KITCHEN EQUIPMENT AS SHOWN. INSTALL PER MANUFACTURER'S INSTALLATION REQUIREMENTS. COORDINATE INSTALLATION WITH GENERAL CONTRACTOR. BALANCE TO QUANTITY OF EXHAUST/MAKE-UP AIR PER SCHEDULE. FAN SUPPORTS, DUCT CONNECTIONS, ROOF PENETRATION, FLASHING, PATCHING, AND REPAIR OF ROOF BY CONTRACTOR.
- ③ PROVIDE AND INSTALL NEW GRAVITY VENTILATOR AS SHOWN. COORDINATE INSTALLATION WITH GENERAL CONTRACTOR. PROVIDE DUCT CONNECTIONS, ROOF PENETRATIONS, AND SUPPORTS AS REQUIRED. ALL TYPICAL.
- ④ PROVIDE AND INSTALL 44"x44" INSULATED DUCT PLENUM ON MANUFACTURER'S ROOF CURB. SEAL PLENUM AIR AND WATER TIGHT ON ALL FOUR SIDES AS REQUIRED. TAP 26"x18" CONNECTIONS INTO BOTTOM OF PLENUM WHERE INDICATED AND ROUTE AS SHOWN ON FIRST FLOOR PLAN. COORDINATE INSTALLATION WITH GENERAL CONTRACTOR. PROVIDE DUCT CONNECTIONS, ROOF PENETRATIONS, AND SUPPORTS AS REQUIRED. ALL TYPICAL.

NOTE:
DAMPERS SHALL BE PROVIDED IN ALL BRANCH RUN-OUTS TO DIFFUSERS,
RA AND EXHAUST GRILLES, UNLESS SPECIFICALLY NOTED OTHERWISE ON DRAWINGS.
LOCATE DAMPERS SO THEY ARE ACCESSIBLE FROM LAY-IN CEILING OR ACCESS DOORS.

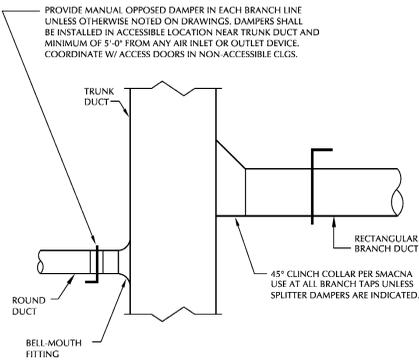


BRANCH DUCT TAP DETAIL




NOTE:
1. NO BRANCH DUCTS WITHIN 18" OF
END OF MAIN DUCT.
2. MINIMUM 10" BETWEEN BRANCH TAKE
OFF DUCTS.
3. NO BRANCH DUCTS FROM MAIN
DUCT TRANSITIONS.

TYPICAL ROUND BRANCH DUCT TAKE-OFF

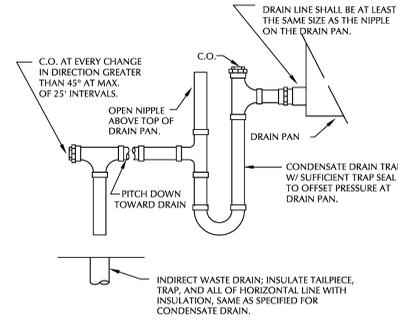


CONDENSATE DRAIN TRAP DETAIL

NOTE: THIS DETAIL APPLICABLE AT MECHANICAL
ROOM WALL PENETRATIONS, SMOKE TIGHT WALLS, SOUND CONTROL
PARTITIONS AND WHERE OTHERWISE INDICATED.

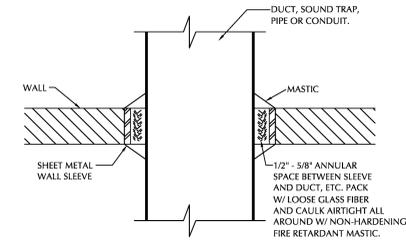


WALL PENETRATION DETAIL

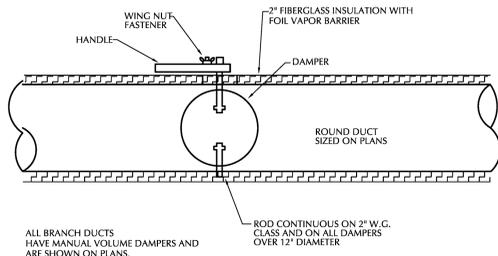


ALL BRANCH DUCTS
HAVE MANUAL VOLUME DAMPERS AND
ARE SHOWN ON PLANS.

ROUND DUCT MANUAL DAMPER

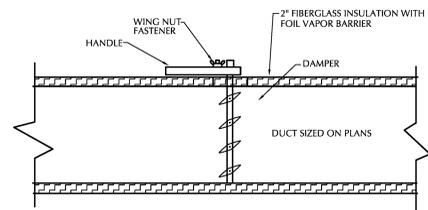


RECTANGULAR DUCT MANUAL DAMPER

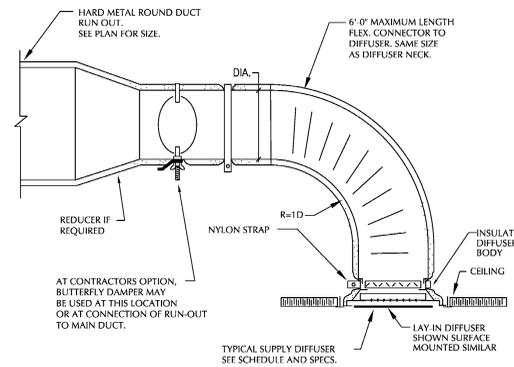


***ALL CEILING AIR DEVICES ON THIS PROJECT TO HAVE CEILING RADIATION
DAMPERS APPROVED FOR ARCHITECTURAL REQUIRED FIRE RATING.***

TYPICAL DIFFUSER MOUNTING

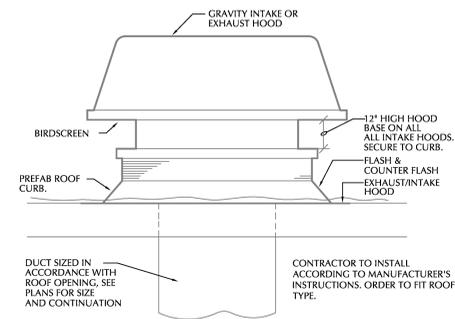


ROOF MOUNTED GRAVITY EXHAUST/INTAKE VENTILATOR DETAIL

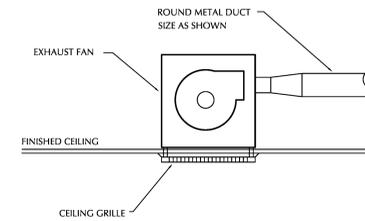


CEILING MOUNTED EXHAUST FAN

DETAIL ILLUSTRATES TYPICAL INSTALLATION. DIRECTION OF SUPPLY OR RETURN DUCT MAY BE DIFFERENT THAN THAT SHOWN. DUCT ROUTED HIGH TO STRUCTURE.

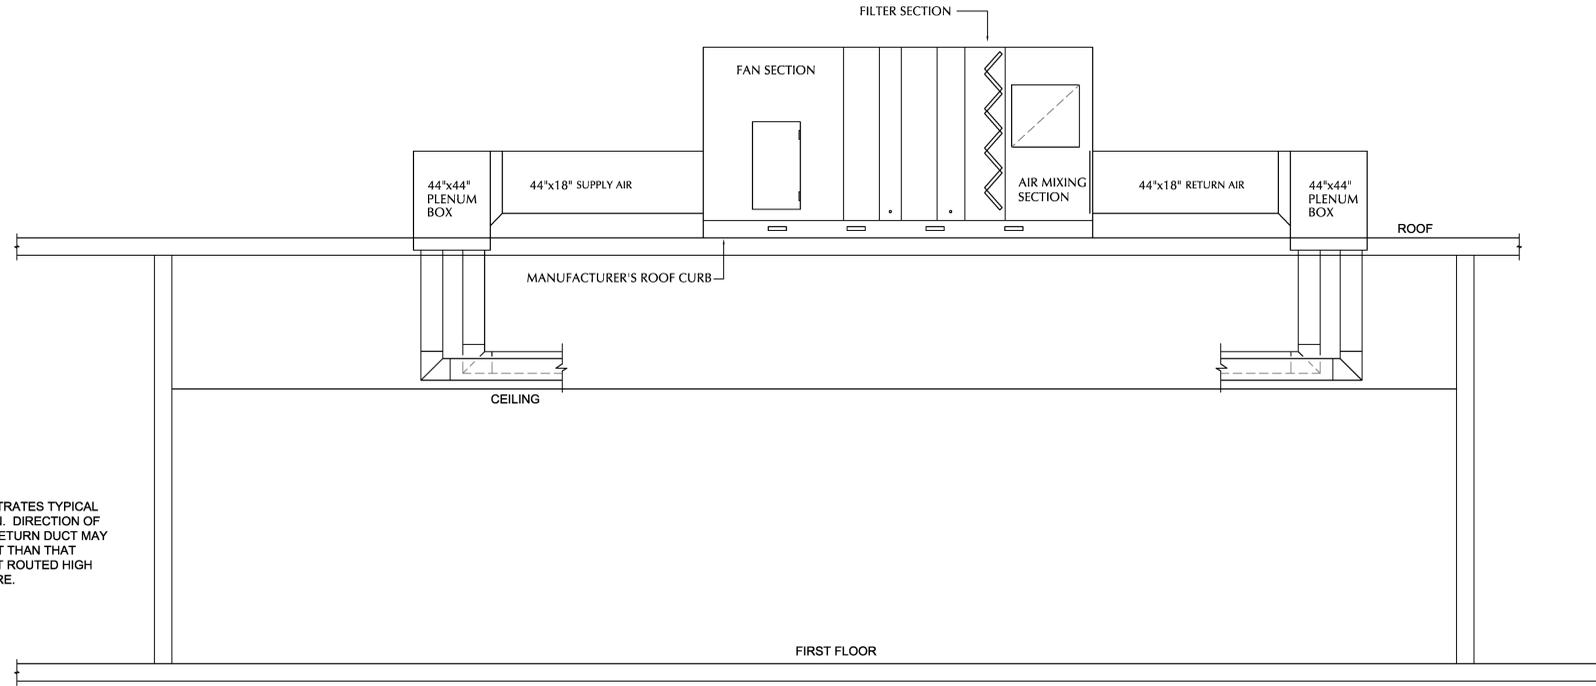

RTU-1 ELEVATION SCHEMATIC

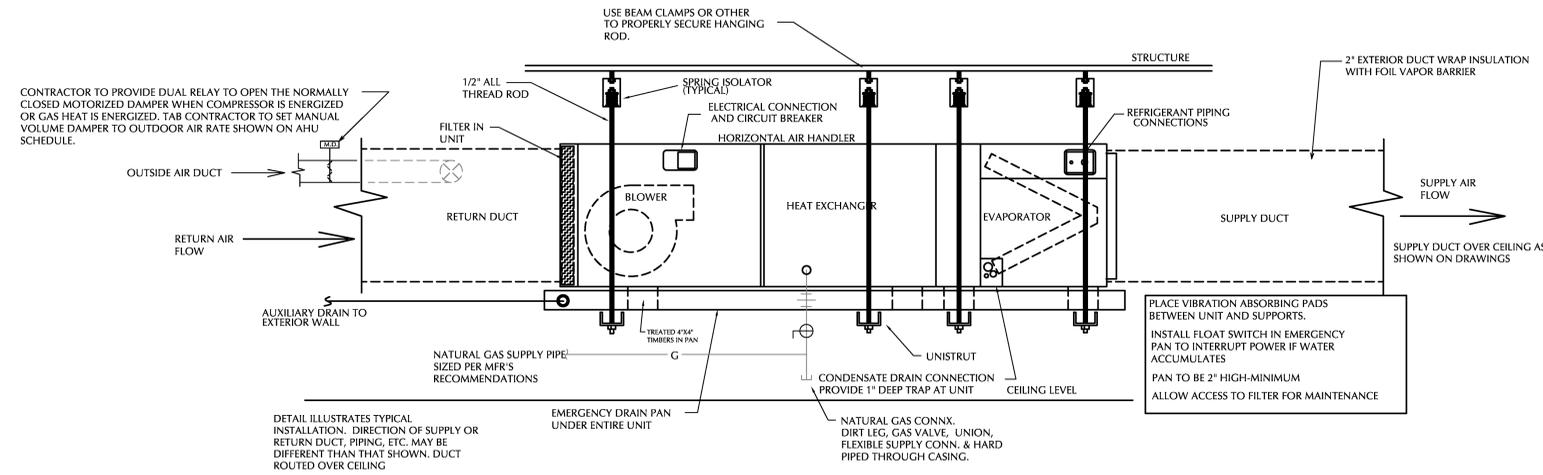

FCU-1 SIDE VIEW
SCALE: NONE

EXHAUST FAN SCHEDULE									
MARK	GREENHECK MODEL	CFM	MAX RPM	STATIC W.G.	DRIVE TYPE	MOUNTING	ELECTRICAL	REMARKS	
EF-1 THRU EF-3	SP-A90	75	878	25"	DIRECT	CEILING	115V, 14 WATT	CONTROLLED BY LIGHT SWITCH.	
PROVIDE ACCESSORIES AS SHOWN OR NOTED. PROVIDE WITH FACTORY MOUNTED DISCONNECT AT ALL FANS. BACKDRAFT DAMPERS, VIBRATION ISOLATION KIT, FLEXIBLE CONNECTIONS, FACTORY FAN SPEED CONTROL, WHITE ALUMINUM GRILLE, AND MOUNTING HARDWARE WITH ALL FANS. PRODUCTS SHALL BE MADE IN USA PER 2CFR 200.322 ESSER GUIDELINES.									

LOUVER SCHEDULE									
MARK	EQUAL TO RUSKIN MODEL	DUTY TYPE	SIZE	MOUNTING	COLOR	REQUIRED CFM	MATERIAL	REMARKS	
LV-1	ELF6375DX	EXHAUST AIR	12"x12"	EXTERIOR WALL SURFACE	TO MATCH	AS SHOWN	ALUMINUM	USED AS LOUVERED EXTERIOR WALL GRILLE INCLUDE 3/4" MESH SCREEN, FACTORY KYNAR FINISH, EXTENDED SILL, CHANNEL FRAME.	

GRAVITY VENTILATOR SCHEDULE									
MARK	MAKE	MODEL	TYPE	FINISH	WIDTH	HEIGHT	FACE VELOCITY	P.D.	REMARKS
GV-1	COOK	12 PR	ROOF TOP GRAVITY VENTILATOR	ALUMINUM	20"	20"	500 FPM	0.05"	

GRILLE, REGISTER, DIFFUSER SCHEDULE									
MARK	EQUAL TO TITUS MODEL	DUTY TYPE	SIZE	MOUNTING	COLOR	REQUIRED CFM	MATERIAL	REMARKS	
A	TMS AA	SUPPLY	24"x24"	LAY-IN	WHITE	AS SHOWN	ALUMINUM	SUPPLY AIR DIFFUSER	
B	TMS AA	SUPPLY	12"x12"	LAY-IN	WHITE	AS SHOWN	ALUMINUM	SUPPLY AIR DIFFUSER	
C	300 FL	SUPPLY	18"x12"	WALL SURFACE	WHITE	AS SHOWN	ALUMINUM	LOUVERED INTERIOR SUPPLY AIR WALL GRILLE.	
D	50F	RETURN	24"x24"	LAY-IN	WHITE	AS SHOWN	ALUMINUM	CUBE CORE GRILLE	
E	350 FL	RETURN	18"x12"	WALL SURFACE	WHITE	AS SHOWN	ALUMINUM	LOUVERED INTERIOR RETURN AIR WALL GRILLE (3/4" BLADE SPACING)	

SUPPLY DIFFUSERS WILL HAVE ROUND NECK SIZES AS SHOWN ON DRAWING. NECK SIZE OF DIFFUSER SHOULD MATCH DUCT SIZE WHICH SERVES THAT DIFFUSER. FOR THE SURFACE MOUNTED SUPPLY DIFFUSERS, A PLASTER RING MAY BE USED. NOTE: MECHANICAL CONTRACTOR TO COORDINATE DIFFUSERS WITH CEILING TYPES.

HORIZONTAL FAN COIL UNIT SCHEDULE												
MARK	EQUAL TO LENNOX MOD.	TOTAL CFM	MAX O.A. CFM	COOLING			ELECTRICAL	ELECTRIC HEAT		RATED LOAD AMPS	OUTPUT (W)	REMARKS
				CAP	EA DB/WB	LA DB/WB		SIZE	ELECTRICAL			
FCU-1	MMD802454	695	70	24 MBH	80°/67°	55°/55°	208V/1PH	--	--	1.7	160	HORIZONTAL SPLIT SYSTEM, THREE SPEEDMOTOR.


NOTES: EACH UNIT SHOULD BE EQUIPPED WITH THE APPROPRIATE SIZE EVAPORATOR COIL. VERIFY ELECTRICAL REQUIREMENTS PER MANUFACTURER'S RECOMMENDATIONS.

HEAT PUMP UNIT SCHEDULE									
MARK	EQUAL TO LENNOX MOD.	COOLING CAP. TOTAL BTU/H	TYPE HP/CU	HEATING CAPACITY	ELECTRICAL REQ.	MCA	MAX FUSE SIZE	REMARKS	
HP-1	MLB03054M	24 MBH	HP	24 MBH	208/1PH	25.0	40 A	2-STAGE HEAT PUMP	



NOTES: INSTALL ACCORDING TO MANUFACTURER'S INSTALLATION REQUIREMENTS.

PACKAGED UNIT SCHEDULES														
MARK	MAKE	MODEL	FAN DATA			COOLING		GAS HEAT		COMPRESSORS	ELECTRICAL		PRE-FILTER	REMARKS
			CFM	OA	ESP	TOT BTUH	INPUT BTUH	OUTPUT BTUH	VOLTS		MCA	MOP		
RTU-1	LENNOX	LGT108H4EM1Y	5,000	1,000	0.5"	103,000	132,000	105,000	2	208/3PH	61.0	80	MERV 8	SEE NOTES INDICATED BELOW

- NOTES:
- UNIT SHALL BE SUPPLIED WITH MODULATING O/A/RA DAMPER CONTROL FOR ECONOMIZER .
 - PROVIDE WITH MANUFACTURER'S ROOF CURB TO MATCH DUCT DROP ORIENTATION(S).
 - DIRECT DRIVE PLENUM FAN WITH EC MOTOR
 - HUMIDITROL HOT GAS REHEAT
 - CS7500 COLOR TOUCHSCREEN PROGRAMMABLE TSTAT
 - DUAL ENTHALPY ECONOMIZER WITH BARAMETRIC RELIEF
 - FACTORY 120V CONVENIENCE OUTLET
 - FACTORY DISCONNECT
 - SUPPLY AND RETURN SMOKE DETECTORS
 - CONDENSER HAIL GUARDS
 - WARRANTY: 1 YEAR UNIT PARTS, 5 YEAR COMPRESSOR PARTS.



DUCT TYPE	SIZE
STANDARD	16 SQ
FIRE-WRAPPED	12 SQ



DUCT DIMENSIONS ARE LARGEST POSSIBLE DUCT TO FIT THROUGH CURB. CONSULT SYSTEM DESIGN ENGINEER FOR RECOMMENDED DUCT SIZE.
OVERALL HEIGHT MAY BE GREATER DEPENDING ON MOTOR, ADAPTER, AND/OR HINGE BASE.


Direct Drive Mixed Flow Filtered Roof Supply Fan												
MARK INFORMATION			FAN INFORMATION						MOTOR INFORMATION			
QTY	MARK	MODEL	VOLUME (CFM)	TOTAL EXTERNAL SP (IN WG)	FAN RPM	OPERATING POWER (HP)	WEIGHT (LB.)	SIZE (HP)	V/C/P	ENCLOSURE	MOTOR RPM	WINDINGS
1	KSF-1	KSQ-12-M2	1,480	0.613	1,750	0.44	124	0.75	208/60/3	TF	1750	1

KSF-01 - SELECTED OPTIONS AND ACCESSORIES
 Horizontal Weatherhood Intake, Bottom (Curb Mounted) Discharge
 UL/CUL 705 Listed - "Power Ventilators"
 Switch, NEMA-3R, Toggle, Shipped Separate
 Damper Shipped Loose, WD-330-PB-14.25X14.25, Gravity Operated, Not Coated
 1" Aluminum Primary Filter

Direct Drive Upblast Centrifugal Roof Exhaust Fan													
MARK INFORMATION			FAN INFORMATION						MOTOR INFORMATION				
QTY	MARK	MODEL	VOLUME (CFM)	TOTAL EXTERNAL SP (IN WG)	FAN RPM	OPERATING POWER (HP)	WEIGHT (LB.)	SIZE (HP)	V/C/P	ENCLOSURE	MOTOR RPM	WINDINGS	NEC FLA*
1	KEF-1	CUE-140-VG	1,862	0.994	1,462	0.6	122	1	208/60/3	TF	1725	1	4.6

*NEC FLA - Based on table 430.250 or 430.248 of National Electrical Code 2020. Actual motor FLA may vary for sizing thermal overload, consult factory"

KEF-01 - SELECTED OPTIONS AND ACCESSORIES
 Standard Curb Cap Size - 22 Square
 UL/CUL 705 Listed - "Power Ventilators"
 Switch, NEMA-1, Toggle, Shipped with Unit
 Hinge, Factory Installed
 Foam Curb Seal (Factory Applied)
 Birdscreen: Stainless Steel, nom. 85% Free Area

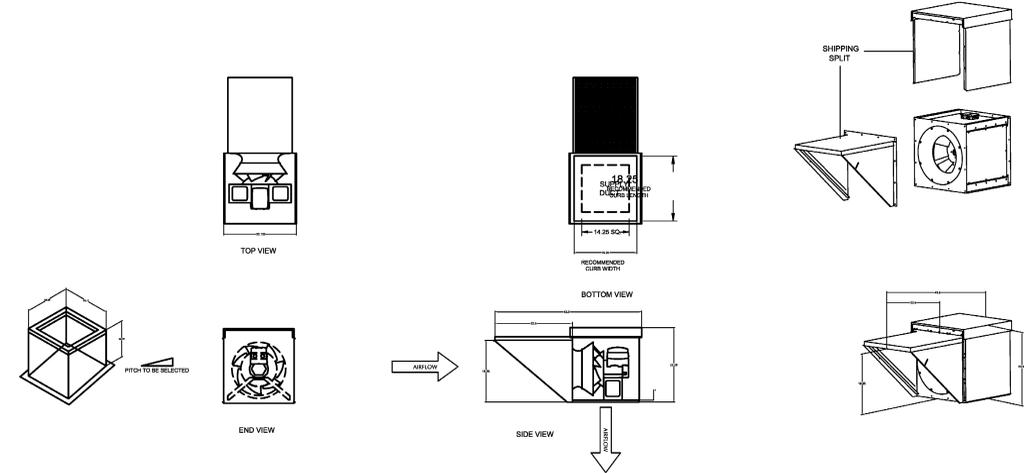

HOOD INFORMATION

HOOD NO.	MARK	MODEL	HOOD DIMENSIONS (IN.)			HOOD CONSTR.	COOKING LOAD / DUTY RATING	EXHAUST COLLAR(S)					SUPPLY		TOTAL WEIGHT LBS.	SECTION LOCATION	
			LENGTH	WIDTH	HEIGHT			TOTAL CFM	WIDTH	LENGTH	DIA.	CFM	S.P.	MUA CFM			AC CFM
1	KH-1	GHEW-88-S	88	48	24	430 SS WHERE EXPOSED	HEAVY	1862	9	18		1862	0.494	1490		215.277	SINGLE

HOOD INFORMATION

HOOD NO.	MARK	LIGHTING DETAILS			FOOT CANDLES	GREASE FILTRATION DETAILS			UTILITY CABINET(S)							
		FIXTURE TYPE	BULB / LAMP INFO	QTY		TYPE / MODEL	MATERIAL	QTY	SIZE (IN.)	LOCATION	FIRE SYSTEM	CONTROLS	TYPE	SIZE	MODEL	INTERFACE
1	KH-1	INCANDESCENT (GLOBE)	100W A19 (BULBS NOT INCL.)	4	45.69	BAFFLE	STAINLESS STEEL	2	3	16	20	LEFT	ANSUL R102	6	GKC	

SUPPLY PLENUM INFORMATION

HOOD NO.	MARK	POS.	TYPE	SIZE (IN.)			INSULATED	DAMPER(S)	LED LIGHT(S)	TOTAL SUPPLIED	QTY	TOTAL CFM	TOTAL S.P.	COLLARS					
				L	W	H								TYPE	MOUNTING	QTY	W	L	DIA.
1	KH-1	FRONT	ASP	100	14	4	NO	YES	NO	1490	0.02	MUA	FACTORY	2	12	30	745	298	

HOOD OPTIONS


UL 710 LISTED W/ OUT EXHAUST FIRE DAMPER - UL #MH11726
 BACK INTEGRAL AIR SPACE - 3 IN WIDE
 18 IN HIGH CEILING ENCLOSURES - FRONT LEFT RIGHT - FIELD INSTALLED
 FACTORY MOUNTED EXHAUST COLLAR(S)
 BACKSPASH 60.00 IN HIGH 100.00 IN LONG
 PERFORMANCE ENHANCING LIP (PEL) TECHNOLOGY
 STANDING SEAM CONSTRUCTION FOR SUPERIOR STRENGTH

CONTROL INFORMATION

MARK	ELECTRICAL CONTROL PACKAGE		TYPE	LOCATION	FAN #	TYPE	FAN	FAN MARK	ZONE	CFM	FANS CONTROLLED					
	MODEL	LOCATION									FULL COLOR TOUCHSCREEN	HOOD - FACE MOUNT LEFT END OF KH-01 SECTION 1	1	EXHAUST	E1	KEF-01
KH-1 CONTROLS	GKC-CV-S-11-1-1-0	LEFT CABINET ON KH-01	FULL COLOR TOUCHSCREEN	HOOD - FACE MOUNT LEFT END OF KH-01 SECTION 1	1	EXHAUST	E1	KEF-01	1	1862	0.75	208	60	3	NO	NO

CONTROL FEATURES

HOOD LIGHT CONTROL
 TEMP SENSORS (FACTORY INSTALLED) - QTY. 1
 DRY FIRE CONTACTS - QTY. 2
 LIGHTS OFF DURING FIRE
 EXHAUST MAX DURING FIRE
 SUPPLY OFF DURING FIRE

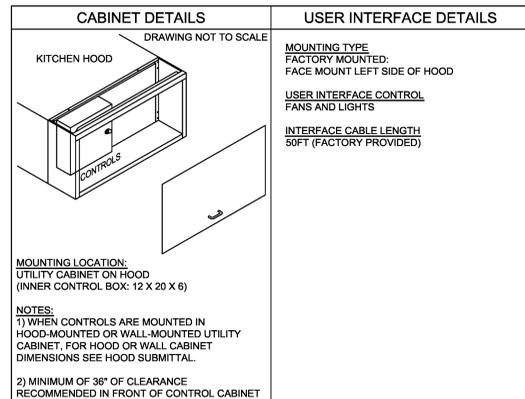

ZONE CONFIGURATION										WIRING DIAGRAM CODE: #WWW			
ZONE #	ZONE	ROOM TEMP								JOB NAME	RBR - CALHOUN STATION 1-4		
1	Z1	PRESET								MODEL	GKC-CV-S-11-1-1-0		
										SERIAL NUMBER	WDSNIF		
										NAME	KH-01 CONTROLS		
										DOC NUMBER	###		
										REV	###		
HOOD CONFIGURATION										FACTORY SETTINGS			
HOOD #	HOOD	HOOD MARK	ZONE	EXHAUST	SUPPLY	MB-TEMP SENSORS	HCB					TYPE OF CONFIGURATION	STANDARD
1	H1	KH-01 SECTION 1	Z1	E1	S1	TS1	NO					ZONE 1	HOODS: 1
										ZONE 2	EXHAUST FANS: 1		
										ZONE 3	SUPPLY FANS: 1		
										ZONE 4	MB ROOM SENSOR: NO		
										ZONE 5	MB TEMP SENSORS: 1		
										ZONE 6	HIGH TEMP FALLT: NO		
										ZONE 7	FREZE PROTECTION: YES		
										ZONE 8	GAS RESET: NO		
										ZONE 9	FAN PROVD: NO		
										ZONE 10	BMS: NONE		
										ZONE 11			
										ZONE 12			
										ZONE 13			
										ZONE 14			
										ZONE 15			
										ZONE 16			
										ZONE 17			
										ZONE 18			
										ZONE 19			
										ZONE 20			
										ZONE 21			
										ZONE 22			
										ZONE 23			
										ZONE 24			
										ZONE 25			
										ZONE 26			
										ZONE 27			
										ZONE 28			
										ZONE 29			
										ZONE 30			
										ZONE 31			
										ZONE 32			
										ZONE 33			
										ZONE 34			
										ZONE 35			
										ZONE 36			
										ZONE 37			
										ZONE 38			
										ZONE 39			
										ZONE 40			
										ZONE 41			
										ZONE 42			
										ZONE 43			
										ZONE 44			
										ZONE 45			
										ZONE 46			
										ZONE 47			
										ZONE 48			
										ZONE 49			
										ZONE 50			
										ZONE 51			
										ZONE 52			
										ZONE 53			
										ZONE 54			
										ZONE 55			
										ZONE 56			
										ZONE 57			
										ZONE 58			
										ZONE 59			
										ZONE 60			
										ZONE 61			
										ZONE 62			
										ZONE 63			
										ZONE 64			
										ZONE 65			
										ZONE 66			
										ZONE 67			
										ZONE 68			
										ZONE 69			
										ZONE 70			
										ZONE 71			
										ZONE 72			
										ZONE 73			
										ZONE 74			
										ZONE 75			
										ZONE 76			
										ZONE 77			
										ZONE 78			
										ZONE 79			
										ZONE 80			
										ZONE 81			
										ZONE 82			
										ZONE 83			
										ZONE 84			
										ZONE 85			
										ZONE 86			
										ZONE 87			
										ZONE 88			
										ZONE 89			
										ZONE 90			
										ZONE 91			
										ZONE 92			
										ZONE 93			
										ZONE 94			
										ZONE 95			
										ZONE 96			
										ZONE 97			
										ZONE 98			
										ZONE 99			
										ZONE 100			
										ZONE 101			
										ZONE 102			
										ZONE 103			
										ZONE 104			
										ZONE 105			
										ZONE 106			
										ZONE 107			
										ZONE 108			
										ZONE 109			
										ZONE 110			
										ZONE 111			
										ZONE 112			
										ZONE 113			
										ZONE 114			
										ZONE 115			
										ZONE 116			
										ZONE 117			
										ZONE 118			
										ZONE 119			
										ZONE 120			
										ZONE 121			
										ZONE 122			
										ZONE 123			
										ZONE 124			
										ZONE 125			
										ZONE 126			
										ZONE 127			
										ZONE 128			
										ZONE 129			
										ZONE 130			
										ZONE 131			
										ZONE 132			
										ZONE 133			
										ZONE 134			
										ZONE 135			
										ZONE 136			
										ZONE 137			
										ZONE 138			
										ZONE 139			
										ZONE 140			
										ZONE 141			
										ZONE 142			
										ZONE 143			
										ZONE 144			
										ZONE 145			
										ZONE 146			
										ZONE 147			
										ZONE 148			
										ZONE 149			
										ZONE 150			
										ZONE 151			
										ZONE 152			
										ZONE 153			
										ZONE 154			
										ZONE 155			
										ZONE 156			
										ZONE 157			
										ZONE 158			
										ZONE 159			
										ZONE 160			
										ZONE 161			
										ZONE 162			
										ZONE 163			
										ZONE 164			
										ZONE 165			
										ZONE 166			
										ZONE 167			
										ZONE 168			
										ZONE 169			
										ZONE 170			
										ZONE 171			
										ZONE 172			
										ZONE 173			
										ZONE 174			
										ZONE 175			
										ZONE 176			
										ZONE 177			
										ZONE 178			
										ZONE 179			
										ZONE 180			
										ZONE 181			
										ZONE 182			
										ZONE 183			
										ZONE 184			
										ZONE 185			
										ZONE 186			
										ZONE 187			
										ZONE 188			
										ZONE 189			
										ZONE 190			
										ZONE 191			
										ZONE 192			
										ZONE 193			
										ZONE 194			
										ZONE 195			
										ZONE 196			
										ZONE 197			
										ZONE 198			
										ZONE 199			
										ZONE 200			
										ZONE 201			
										ZONE 202			
										ZONE 203			
										ZONE 204			
										ZONE 205			
										ZONE 206			
										ZONE 207			
										ZONE 208			
										ZONE 209			
										ZONE 210			
										ZONE 211			
										ZONE 212			
										ZONE 213			
										ZONE 214			
										ZONE 215			
										ZONE 216			
										ZONE 217			
										ZONE 218			
										ZONE 219			
										ZONE 220			
										ZONE 221			
										ZONE 222			
										ZONE 223			
										ZONE 224			
										ZONE 225			
										ZONE 226			
										ZONE 227			
										ZONE 228			
										ZONE 229			
										ZONE 230			
										ZONE 231			
										ZONE 232			
										ZONE 233			
										ZONE 234			
										ZONE 235			
										ZONE 236			
										ZONE 237			
										ZONE 238			
										ZONE 239			
										ZONE 240			
										ZONE 241			
										ZONE 242			
										ZONE 243			
										ZONE 244			
										ZONE 245			
										ZONE 246			
										ZONE 247			
										ZONE 248			
										ZONE 249			
										ZONE 250			
										ZONE 251			
										ZONE 252			
										ZONE 253			
										ZONE 254			
										ZONE 255			
										ZONE 256			
										ZONE 257			
										ZONE 258			
										ZONE 259			
										ZONE 260			
										ZONE 261			
										ZONE 262			
										ZONE 263			
										ZONE 264			
										ZONE 265			
										ZONE 266			
										ZONE 267			
										ZONE 268			
										ZONE 269			
										ZONE 270			
										ZONE 271			
										ZONE 272			
										ZONE 273			
										ZONE 274			
										ZONE 275			
										ZONE 276			
										ZONE 277			
										ZONE 278			
										ZONE 279			
										ZONE 280			
										ZONE 281			
										ZONE 282			
										ZONE 283			
										ZONE 284			
										ZONE 285			
										ZONE 286			
										ZONE 287			
										ZONE 288			

SECTION 16000 ELECTRICAL

16000 SCOPE OF WORK

- The work described under this section of the specifications includes furnishing all material, labor, and equipment, except as furnished under other sections of the specification, to install all electrical work as shown in the drawings and as specified and referred to herein.
- The contractor shall furnish all labor, materials, and equipment, pay all fees and cost, shall obtain all permits, approvals, and inspections to provide a complete electrical installation.
- All electrical equipment and the resultant installation of such equipment, devices, etc., shall be in strict compliance with the National Electric Code, NFPA 70, all applicable local, state, and federal codes, and the Standard for Electrical Safety in the Workplace, NFPA 70E.
- The contractor shall take responsibility for field verification of all dimensions and locations of existing, relocated, and new equipment, and shall be responsible for coordination with the work of other trades necessary to the project.
- These drawings are intended to outline the scope of work required to provide a complete and operable project conclusion. All miscellaneous components, parts, fasteners, splices, and other incidental items necessary to provide a completed project shall be provided whether or not specifically noted.
- All connections to existing power, and all testing shall be done with the assistance and guidance of the construction manager and the local power company.
- Contractor shall notify the construction manager immediately of any conflicts arising from discovered conditions at any phase of the project.
- At any location where excavation or associated work causes damage to existing underground utilities, the contractor shall restore the damaged system to a like-new state.
- Contractor shall verify all final locations of electrical equipment prior to installation with the construction manager.
- Locations of other equipment specified by other trades or provided by the owner are approximate. Coordinate exact location in the field prior to roughing in and routing conduit.
- See architectural reflected ceiling plans and elevations for exact locations for light fixtures in lay-in or drywall ceilings, and on interior or exterior walls.
- Conduits are not necessarily shown on plan drawings for the sake of clarity. Provide conduits between devices and to panels per requirements listed in Division 16 specifications. Indicate the exact routing of conduit on plan drawings as part of as-built documentation to be submitted after final completion.
- The general contractor shall field-verify all existing conditions prior to beginning any work and shall immediately notify the architect and engineer of any discrepancies. Failure to do so indicates that the contractor accepts the conditions as they exist and shall perform the work required as shown and specified.
- The electrical contractor shall review mechanical drawings and specifications to obtain locations, wiring requirements, control wiring schemes, interlock wiring, and thermostat locations.
- Equipment shall be mounted on materials suitable for the environment in which it is installed with the appropriate NEMA enclosure rating.
- Working clearances for electrical equipment shall be in compliance with Article 110 and 408.
- The dedicated electrical space extending from the floor to the structural ceiling with the width and depth of the panelboard or switchboard must be clear of all piping, ducts, equipment foreign to the electrical or architectural appurtenances in accordance with NEC 110 & 408. Coordinate installation of electrical equipment with other trades prior to roughing in equipment.
- The electrical contractor shall obtain and review the mechanical and special equipment submittals prior to submitting the electrical submittals. Any electrical equipment, conduit, and wire size changes resulting from this review shall also be submitted for approval.

- Regulations: Comply with all applicable codes, rules, and regulations. All materials, equipment, and work must comply with the latest adopted code and the applicable municipal and life safety codes.
- Permits: Obtain and pay for all permits, fees, and licenses required to perform work described herein.
- Inspections: All work must be inspected and approved by local authorities. Prior to final approval, furnish the architect with certificates of inspection and approvals by the local authorities.

3. Work Listed Elsewhere

- Furnish and install motor controls unless in motor control center. Furnish hole cutting in pre-cast structural concrete.

4. Existing Services and Remodel Area

- Maintain all services, power, sound, telephone, etc., to existing buildings or areas. Interruptions of services required for "cut-over" or connections of new cables, etc., shall be done at the convenience of the tenant and be approved in writing by the tenant prior to the interruption.

5. Temporary Power

- Provide temporary power as required by the general contractor. This service shall be maintained throughout the entire project as the work progresses.
- Provide outlets at convenient points and in sufficient
- DEPTH OF NOT LESS THAN 18 INCHES BELOW FINISHED GRADE. CONDUIT SHALL BE SCHEDULE 40 PVC.

6. SUPPORT OF CONDUIT:

- All conduit shall be properly supported and securely fastened in place.
- Conduit run horizontally along walls or ceilings shall be supported by straps or hangers not more than 10 feet apart.
- All conduit runs shall be installed in a straight and workmanlike manner.

9. CONDUIT BODIES:

- Conduit bodies shall be used where necessary for access to conductors in conduit runs and shall be installed as directed by the engineer.

10. CONDUIT SEALS:

- All conduit penetrations through fire-rated walls or floors shall be sealed to maintain the fire rating of the assembly.

9. CONDUIT BENDING:

- All conduit bending shall be done accurately to ensure proper alignment of conduit runs and to avoid damage to conductors.

10. CONDUIT INSTALLATION IN SLAB:

- Conduit installed in the slab shall be elevated a minimum of 2 inches above grade and shall be securely supported to ensure proper positioning during concrete placement.

11. CONDUIT INSTALLATION IN EXPOSED LOCATIONS:

- Conduit installed in exposed locations, such as along walls or ceilings, shall be installed with proper offsets and alignments.

12. EXPANSION FITTINGS:

- Expansion fittings shall be installed where required to accommodate thermal expansion and contraction of conduit systems.

15. CONDUIT IDENTIFICATION:

- All conduit runs shall be properly identified with legible markings indicating circuit number and contents.

14. CAPPING AND SEALING:

- All open ends of conduit shall be capped or sealed to prevent the entry of moisture, dirt, or debris.

15. Electrical Installation Guidelines:

16. Underground Conduits:

- Conduits shall be
 - A minimum of 24" below grade or 18" below grade encased in a 3" thick concrete envelopment.
 - Trenching, backfilling, and concrete work for electrical installations shall comply with local regulations.

17. Conduit Installation:

- The contractor is responsible for providing sleeves and chases where conduits pass through floors or walls, sealing openings, and installing esutchcon plates for exposed conduits.
- All empty conduits shall be equipped with a pull wire.

18. Conduit Fittings:

- Rigid conduit fittings shall include double locknuts and bushings. For EMT or flexible conduits, fittings shall have insulated threads.

19. Wiring Devices and Boxes:

- Receptacles requiring surface weatherproof mounting shall be installed in an FS conduit box.
- Outlet boxes in exposed or wet locations shall be cast steel, while concealed locations shall use sheet steel boxes.
- Boxes shall be securely attached to the structure, independent of conduit support.

20. Hangers/Inserts:

- Unistrut, hangers, and supports required for the electrical work shall be furnished and installed.

21. Concrete and Excavation:

- The contractor shall provide all concrete, excavation, fill, backfill, and steel required unless otherwise noted in the specifications.

22. Final Location of Features:

- A list of manufacturers whose specification-grade equipment is acceptable is provided. Substitutions require approval from the architect.

25. Shop Drawings:

- Six sets of shop drawings for various equipment, including service entrance sections, switchboards, panelboards, lighting fixtures, transformers, and generators, shall be submitted to the architect for approval.

26. Final Inspection and Test:

- The contractor shall furnish all meters, cables, connections, and apparatus for the final inspection and test.

27. Electrical Testing and Safety:

28. Grounding:

- All EMT, flexible conduit, MC cable, or PVC conduit shall be provided with an insulated green ground wire.

30. Communication Systems:

- Provide all necessary material and labor required by the telephone company for delivering service to the telephone terminal board.
- All conduit, trenching, and backfill shall be provided by the electrical contractor in accordance with the telephone company standards.

32. Data:

- All data outlets are to have wall plates to match the device plate.

33. Guarantee:

- Guarantee all material, equipment, and workmanship for one year from the date of final acceptance. Replace without charge any material or equipment found defective during this period.

34. General Electrical Notes:

35. Lighting:

- Verify lamp type, color, number of lamps per fixture, lens type, and voltage before ordering new fixtures to match existing.

36. Emergency Lighting:

- Verify ceiling or wall mounting for emergency exit signs.

37. Power:

- Outlets on opposite sides of fire-rated walls shall be separated by a minimum horizontal distance of 24".

38. FINAL ACCEPTANCE:

- UPON FINAL INSPECTION, DEMONSTRATE TO THE ENGINEER THAT ALL LIGHTING, OUTLETS, SWITCHES, EMERGENCY LIGHTING, AND ALL OTHER EQUIPMENT IS PROPERLY INSTALLED AND OPERATING IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- UPON COMPLETION OF THE INSTALLATION, ALL SWITCHPLATES, COVERPLATES, AND FIXTURES SHALL BE CLEANED OF ALL DIRT, PAINT, ETC.
- IN ADDITION TO OTHER CODE REQUIRED TESTS, TEST THE CONTINUITY OF THE GROUNDING CONDUCTOR SYSTEM AND VERIFY THAT GROUNDING CONDUCTORS ARE SECURELY CONNECTED. ALL EQUIPMENT SHALL BE GROUNDED, AND THE SYSTEM SHALL MEET NEC REQUIREMENTS.
- UPON COMPLETION OF THE WORK, SUBMIT TO THE ENGINEER FOR HIS APPROVAL, THE MANUFACTURER'S CERTIFICATE THAT THE INSTALLATION HAS BEEN MADE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CONTRACT DOCUMENTS.
- AS-BUILT DRAWINGS SHALL BE PROVIDED TO THE ENGINEER UPON COMPLETION OF THE WORK, SHOWING ANY DEVIATIONS FROM THE CONTRACT DOCUMENTS.

40. AS-BUILT DRAWINGS:

- UPON COMPLETION OF THE PROJECT, PROVIDE THE ARCHITECT AND ENGINEER WITH THREE (3) COPIES OF AS-BUILT DRAWINGS. THE AS-BUILT DRAWINGS SHALL INDICATE ANY CHANGES MADE DURING CONSTRUCTION AND SHALL BE CLEARLY MARKED TO SHOW SUCH CHANGES.

41. FINAL CONNECTION:

- ALL FINAL CONNECTIONS TO EQUIPMENT INSTALLED UNDER THIS SECTION SHALL BE MADE IN THE PRESENCE OF THE ENGINEER.

42. OPERATION AND MAINTENANCE MANUALS:

- PROVIDE OPERATION AND MAINTENANCE MANUALS FOR ALL ELECTRICAL EQUIPMENT INSTALLED UNDER THIS SECTION. MANUALS SHALL BE SUBMITTED TO THE ENGINEER UPON COMPLETION OF THE WORK.

43. INSPECTION:

- ALL WORK SHALL BE SUBJECT TO INSPECTION BY THE ENGINEER AT ALL TIMES DURING THE PROGRESS OF THE WORK.

44. SUBMITTALS:

- ALL SHOP DRAWINGS, PRODUCT DATA, SAMPLES, AND OTHER SUBMITTALS SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW AND APPROVAL.

45. CHANGES AND ALTERATIONS:

- NO CHANGES OR ALTERATIONS TO THE CONTRACT WORK WILL BE MADE EXCEPT UPON WRITTEN ORDER OF THE ENGINEER.

46. CODE COMPLIANCE:



- ALL WORK SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE CURRENT EDITION OF THE NATIONAL ELECTRICAL CODE (NEC) AND ALL LOCAL CODES AND REGULATIONS.

47. WARRANTY:

- PROVIDE A ONE-YEAR WARRANTY ON ALL MATERIALS AND WORKMANSHIP. REPLACE, REPAIR, OR ADJUST ANY DEFECTIVE WORK AT NO COST TO THE OWNER.

ACCEPTABLE FUSE EQUIVALENTS						
UL CLASS	VOLT	DESCRIPTION	BUSSMAN	RELANCE	SHAWMUT	LITTLEFUSE
RK1	250	TIME DELAY	LPM-RK	LENRY	AZD-R	LLSRK
RK1 (A)	600	TIME DELAY	LPS-RK	LESRK	AGD-R	LLSRK
RK5	250	TIME DELAY	FRN-RK	ECNR	TR-R	FLNR
RK5 (A)	600	TIME DELAY	FRS-R	SCSR	TRS-R	FLSR
L	600	TIME DELAY	KRP-C	KLU	A4BY	---
L (A)	600	FAST ACTING	KLU	LCL	---	KLLU
L (B)	600	FAST ACTING	KTU	LCU	---	---
K1	250	FAST ACTING	KWN-R	---	---	---
K1 (A)	600	FAST ACTING	KWS-R	---	---	---
RK1 (B)	250	FAST ACTING	KTN-R	NSCR	A2K	---
RK1 (C)	600	FAST ACTING	KTS-R	SCLR	A6K	---
J	600	FAST ACTING	JKS	JLC	A4J	JLS
T	250	QUICK	JIN	---	A3T	JLN
T (A)	600	QUICK	JIS	---	---	JLS

NOTE: FUSES NOT LISTED ABOVE MUST BE APPROVED BY DESIGNER/ENGINEER.

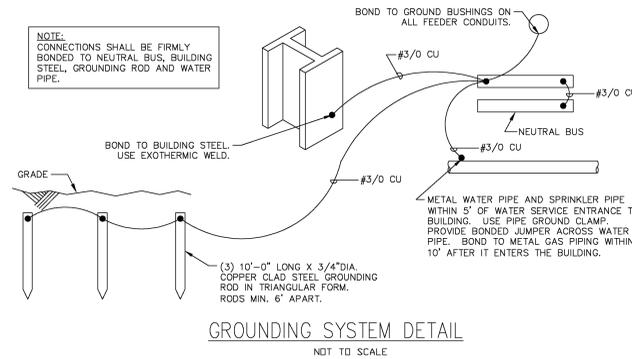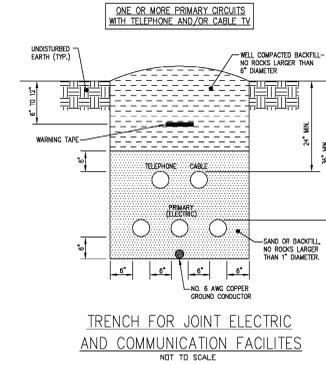


Construction Documents

Revision	Rev Date
CD	1/26/24

Electrical

101

E

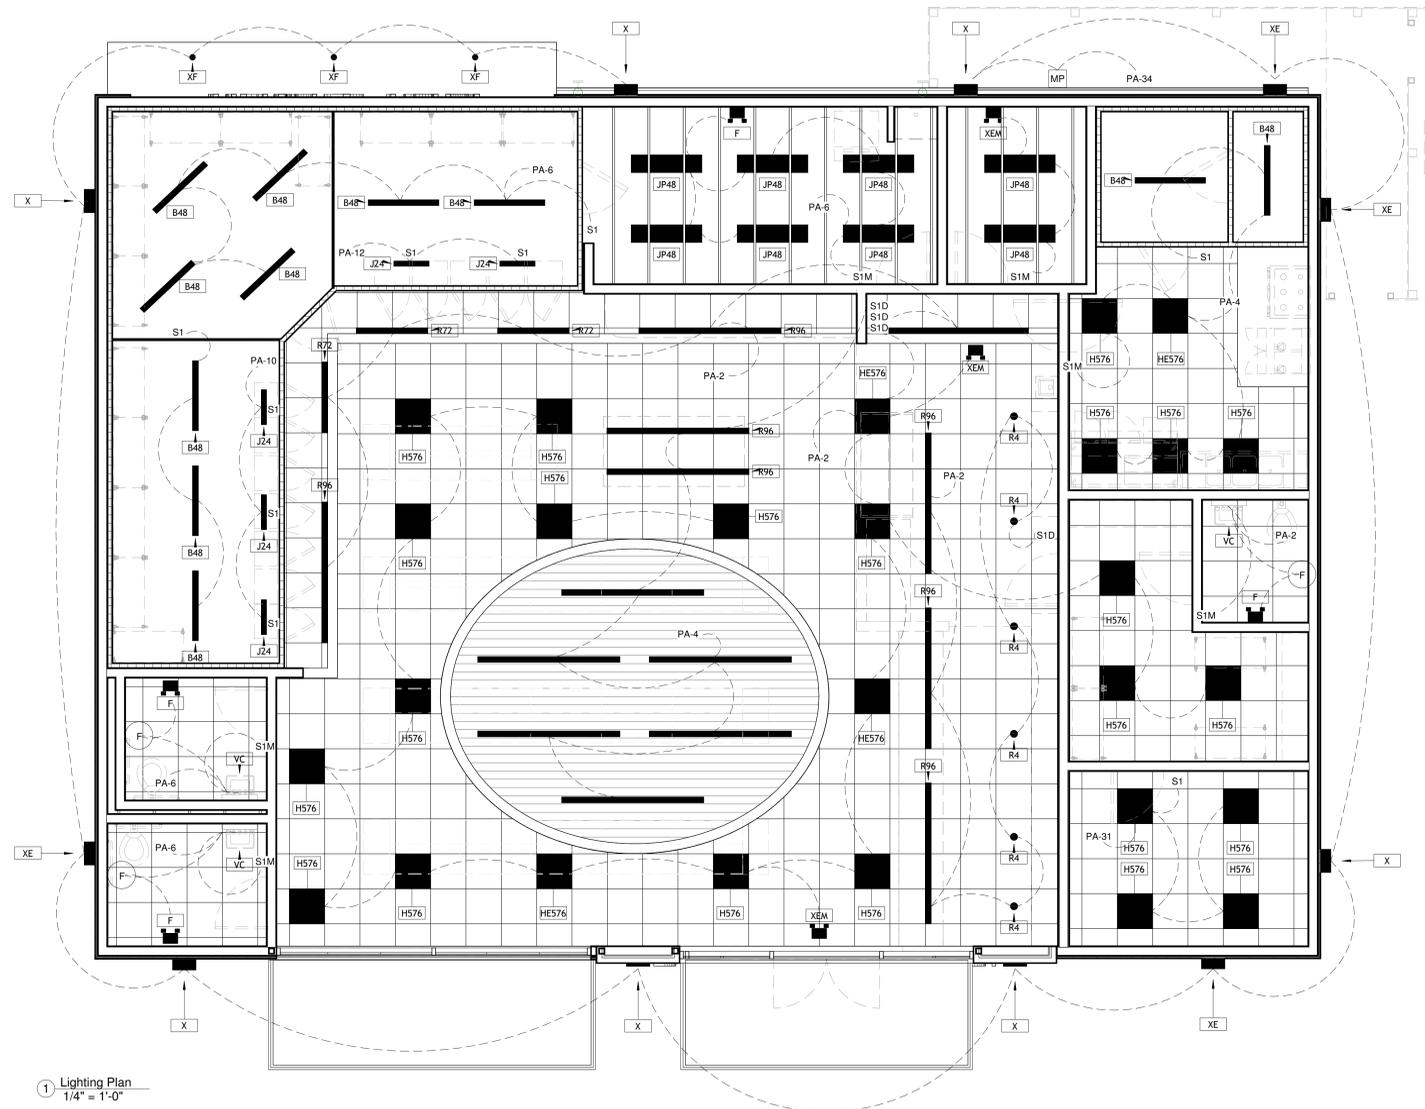




1 Lighting Plan
1/4" = 1'-0"

Lighting Fixture Schedule

Type Mark	Type	Wattage	Lamp	Description	Mounting	Model	Panel	Electrical Data	Mark
B48	4x48 Vapor Tight	57 W	LED	Vaportight Led, Internal Prismatic Lens, 15% DR High Impact Additive, Universal Voltage, 4000k, 1 Dimming Driver	Ceiling	Cooper 4VT2 LD4 6 DR UNV L840 CD1		120 V/1-40 VA	B48
11	F	Emergency Lighting	19 W	LED	Dual Head Emergency Light, White, Lithium Iron Phosphate, Led, UL Listed Damp Location, 50f-104f, Self-Diagnostics, Universal Volt Age 120-277v 50 Or 60hz, 6' Path Egress At 38' 7.5 Ceiling, 56' 1 0' Ceiling, 58' 121 Ceiling.	Wall	Lithonia ELMLT W LP06VS LTP SD	120 V/1-100 VA	F
4	H576	2x2 Grid Recessed	27 W	LED	Architectural Led Trouffer, 90 Cri, 3000k To 5000k Adjustable Cct	Grid Recessed	CREE CR22 32L 9ACK CMA UNV	120 V/1-0 VA	H576
23	HE576	2x2 Grid Recessed EB	27 W	LED	Architectural Led Trouffer, 90 Cri, 3000k To 5000k Adjustable CCT	Grid Recessed	CREE CR22 32L 9ACK CMA UNV EB	120 V/1-0 VA	HE576
4	J24	4x24 Narrow Strip	40 W	LED	LED Narrow Strip Light	Ceiling	Metalux 4SLSTP4040DD 120V	120 V/1-40 VA	J24
5	JP48	4x48 Narrow Strip	40 W	LED	LED Narrow Strip Light	Pendant	Metalux 4SLSTP4040DD 120V	120 V/1-40 VA	JP48
8	R4	4" Round Wall Wash	26 W	LED	Lensed Wall Wash	Grid Recessed	Gotham Lighting EVO4LW 40/25 ARFL LD 120 EZB	120 V/1-15 VA	R4
6	R72	4" Linear Recessed - 4'	45 W	LED	Architectural Led Trouffer, 80 Cri, 3000k to 4000k Adjustable CCT	Grid Recessed	Metalux 4RBG6-SL1-L8SCT3 120V	120 V/1-5 VA	R72
3	R96	4" Linear Recessed - 8'	89 W	LED	Architectural Led Trouffer, 80 Cri, 3000k to 4000k Adjustable CCT	Grid Recessed	Metalux 8RBG6-SL1-L8SCT3 120V	120 V/1-5 VA	R96
14	VC	Vanity Sconce	18 W	LED	24" Wall Mount Led, 3000k Color, Integral PIR Sensor, Dims To 10% When Room Unoccupied, Light Without Lumen Management	Wall	Lithonia WL2 18L LP830 NES7 N100 DIM10	120 V/1-15 VA	VC
3	X	Decorative Wall Sconce	60 W	LED	Decorative Wall Mounted Forward Throw Led, Nighttime Friendly.	Wall	Lithonia MRW LED P4 40K SR2 MVOL T	120 V/1-60 VA	X
7	XE	Decorative Wall Sconce E	60 W	LED	Decorative Wall Mounted Forward Throw Led, Nighttime Friendly, With Emergency Backup	Wall	Lithonia MRW LED P4 40K SR2 MVOL T E20WC	120 V/1-60 VA	XE
4	XEM	Emergency Directional Lighting	14 W	LED	Combination Exit Emergency Light with Automatic Battery Backup, Ceiling Or Wall Mount - Red Letters - Black	Ceiling	Astralite EEU MR R B	120 V/1-100 VA	XEM
3	XF	Wide Angle Flood Signage Light	8 W	LED	Tracer LED Floodlight directed to signage with die cast housing (IP66 rated)	Soffit	Cooper TCRS8W-BK-7030	120 V/1-15 VA	XF

Electrical Fixture Schedule



Symbol	Description	Notes	Comments
MP	Multi-Pole Lighting Contactor	Subscript indicates Pole Number on Contactor	
S1	Single-Pole Throw Switch	Mount Centerline of Box @ 42" AFF UNO	
S1D	Single-Pole Dimmer Switch	Mount Centerline of Box @ 42" AFF UNO	
S1M	Single-Pole Motion Switch	Mount Centerline of Box @ 42" AFF UNO	Motion Detcor Switch, Pass & Seymour #WSP200 or Equal

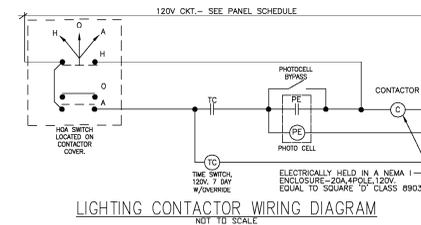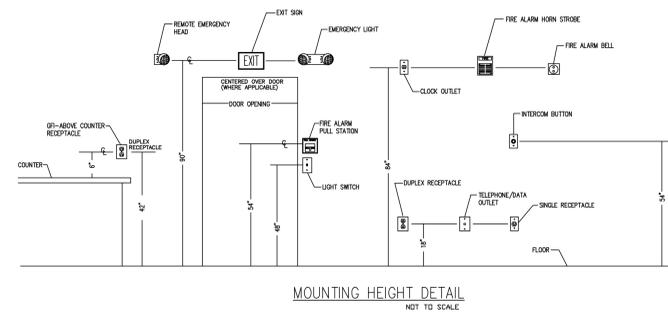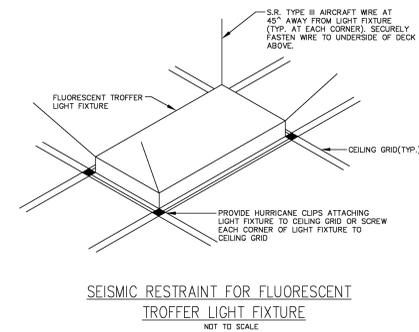


Construction Documents

Revision Rev Date

Lighting Plan

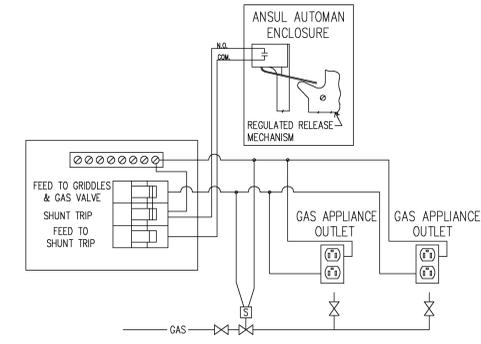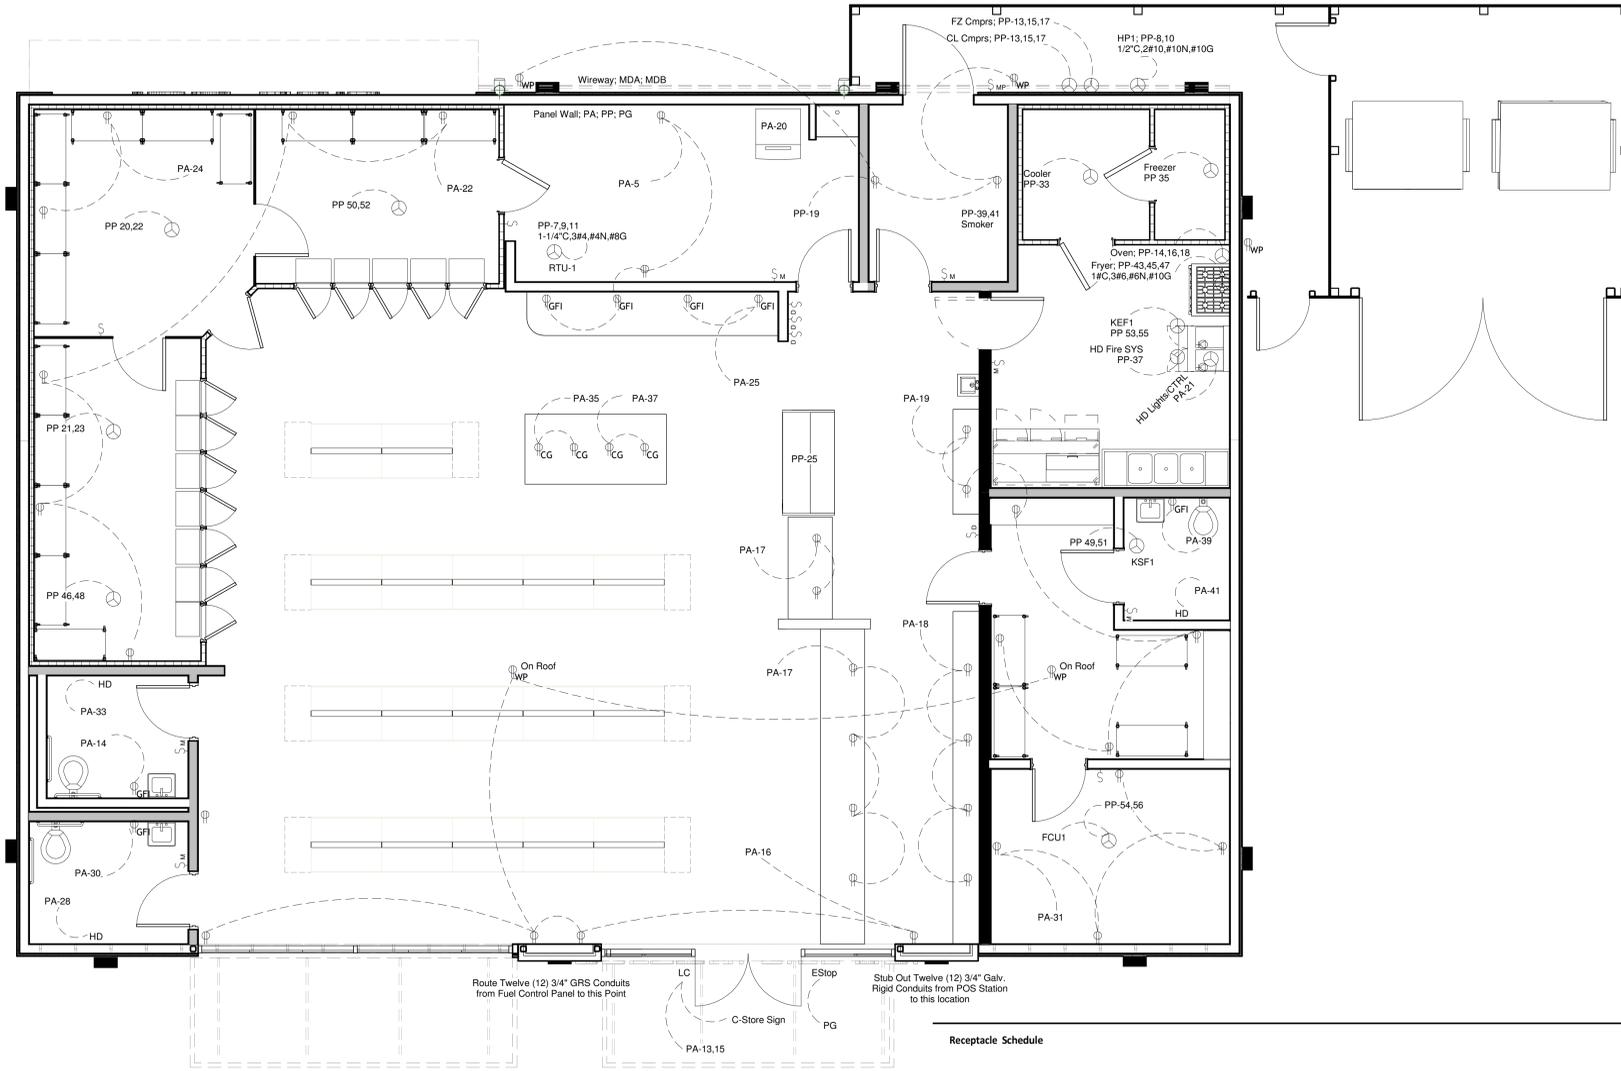

FIRE SUPPRESSION FOR GAS APPLIANCES
- KITCHEN HOOD WIRING DETAIL
NOT TO SCALE

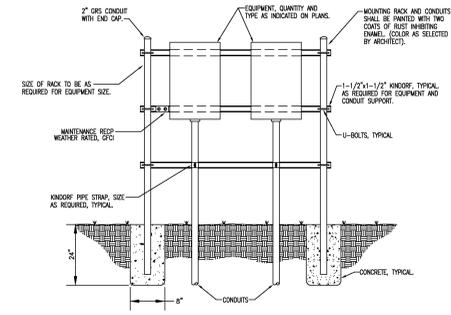

EQUIPMENT RACK MOUNTED AT GRADE DETAIL
NOT TO SCALE

Receptacle Schedule

Callout	Symbol	Nema	Volts	Details	Notes
Counter Gfci		5-20r	120v 1p 2w	G, Gnd	Mounted 2" Above Counter with Backsplash, 6" Above Counter Without Backsplash, Mounted 45" Aff Where Not Counter is Present Unless Noted Otherwise on Architect Details.
Gfci		5-15r	120v 1p 2w	G, Gnd	Mount At 18" Aff, Hubbell Gftr15 (15a) Or Gftr20 (20a) W/Plate or Equivalent
Hand			120v 1p 2w	Gnd	Excel Dryer Hand Dryer or XI-Sb Xlerator As Specified by Architect
Quad		5-15r	120v 1p 2w	Gnd	Two Reeps Mount At 18" Aff, Hubbell Drs15oxwtr (15a) Or Drs20oxwtr (20a) W/Plate or Equivalent
Standard		5-15r	120v 1p 2w	Gnd	Mount At 18" Aff, Hubbell Drs15oxwtr (15a) Or Drs20oxwtr (20a) W/Plate or Equivalent
WP		5-15r	120v 1p 2w	W, G, Gnd	Mount 24" Aff in A UI Approved Weatherproof Enclosure That Maintains Weatherproof Rating While a Plug Is Inserted.

1. If A 5-15r Is the Only Receptacle on The Circuit Then Upgrade Receptacle to 5-20r
2. Receptacle Color to Be Specified by Architect.
3. Receptacle Color and Light Switch Colors Are to Match.

1 Electrical Plan - Power & Auxiliary
1/4" = 1'-0"

FAULT	CURRENT	SCHEDULE	UTILITY			FED FROM			FEEDER			TRANSFORMER			TOTAL MOTOR			DIRECTLY CONNECTED MOTOR LOAD								
			FAULT	X	R	DEVI	FAUL	X	R	SIZE	X/1000	R/1000	LENGTH	X	R	KVA	Z%	XR RATIO	FAULT AT PRIMARY	X	R	FAULT	X	R		
UTIL TRANS	42,721	65,000	120V	41.667	0.002824	0.0005648																				
WIREWAY	30,417	35,000	120V	29.352	0.003878	0.001294	UTIL TRANS	41,667	0.002824	0.0005648	(2)#500kcm	10.0195	0.0135	54'	0.0011	0.0007										
MDA	26,087	42,000	120V	25,300	0.004319	0.001961	WIREWAY	29,352	0.003878	0.001294	#4/0	0.041	0.062	11'	0.0004	0.0007										
LA	14,215	35,000	120V	13,988	0.006626	0.005449	MDA	25,300	0.004319	0.001961	#4/0	0.041	0.062	56'	0.0023	0.0035										
MOB	28,281	42,000	120V	27,213	0.004125	0.001559	WIREWAY	29,352	0.003878	0.001294	(2)#300kcm	10.0205	0.022	12'	0.0002	0.0003										
PP	26,359	42,000	120V	25,288	0.004378	0.001831	MOB	27,213	0.004125	0.001559	(2)#300kcm	10.0205	0.022	12'	0.0003	0.0003										
PA	22,315	35,000	120V	21,533	0.00491	0.002636	PP	25,288	0.004378	0.001831	#4/0	0.041	0.062	13'	0.0005	0.0008										
PG	22,402	30,000	120V	21,568	0.004858	0.002712	PP	25,288	0.004378	0.001831	#3/0	0.042	0.077	11'	0.0005	0.0009										

- Utility transformer shall be mounted a minimum of 20' away from any main disconnect for AIC ratings to be valid.
- Utility transformer primary shall be 33.8kV or less primary for AIC ratings to be valid.
- Please contact engineer for AIC revisions if above changes.

WIREWAY

Ckt #	BREAKER TRIP/POLES	CIRCUIT DESCRIPTION	LOAD KVA			FEDER REWAYWAY AND CONDUCTORS
			A	B	C	
1	225/3	BREAKER MDA	1.94	2.23	3.5	2-1/2" C, 3#4/0, #4/0N, #4G
2	600/3	BREAKER MOB	45.1	59.3	38.9	(2)3" C, 3#300kcmIL, #300kcmIL N, #1G
3	20/3	SPARE	0	0	0	
4	20/3	SPARE	0	0	0	
5	20/3	SPARE	0	0	0	

TOTAL CONNECTED		KVA BY PHASE			CORN KVA		CALC KVA	
		A	B	C				
		47	61.5	42.4				

	CORN KVA	CALC KVA		CORN KVA	CALC KVA
LIGHTING	13.4	16.8	(125%)	24.9	36.2
LARGEST MOTOR	21.6	5.4	(25%)	1	1.25
MOTORS	66.6	66.6	(100%)	5.9	5.9
RECEPTACLES	17.3	13.7	(50%-10)	21.8	21.8
				0	0
				21.8	0
				0	0
				0	0
				148	
				410 A	

PG

Ckt #	Ckt BR	CIRCUIT DESCRIPTION	LOAD KVA		
			A	B	C
1	20/1	DSP 1	0.8	0	0
3	20/1	SWITCHED NEUTRAL	0	0	0
5	20/1	DSP 3	0.8	0	0
7	20/1	SWITCHED NEUTRAL	0	0	0
9	20/1	DSP 5	0.8	0	0
11	20/1	SWITCHED NEUTRAL	0	0	0
13	20/1	DSP 7	0.8	0	0
15	20/1	SWITCHED NEUTRAL	0	0	0
17	20/1	DSP 9	0.8	0	0
19	20/1	SWITCHED NEUTRAL	0	0	0
21	20/1	SUBMERGED PUMP 1	1	0	0
23	20/1	SWITCHED NEUTRAL	0	0	0
25	20/1	SUBMERGED PUMP 2	1	0	0
27	20/1	SWITCHED NEUTRAL	0	0	0
29	20/1	SUBMERGED PUMP 3	1	0	0
31	20/1	SWITCHED NEUTRAL	0	0	0
33	20/1	DSP 13,5,7,9 LIGHTS	0.5	0	0
35	20/1	SWITCHED NEUTRAL	0	0	0
37	20/1	DSP 2,4,6,8,10 LIGHTS	0.5	0	0
39	20/1	SWITCHED NEUTRAL	0	0	0
41	20/1	SPARE	0	0	0

TOTAL CONNECTED		KVA BY PHASE		
		A	B	C
		15	0	0
		125.0		

	CORN KVA	CALC KVA		CORN KVA	CALC KVA
LIGHTING	1	1.25	(125%)	11	11
LARGEST MOTOR	1	0.25	(25%)	3	3
				15.5	
				74.5 A	

pp

Ckt #	Ckt BR	CIRCUIT DESCRIPTION	LOAD KVA		
			A	B	C
1	20/1	PNL PG 6-STOP Ckt PANEL PG	0.2	15	2
3	20/1	SPARE	0	4	0
5	1	RTU-1	7.21	0	8
7	80/3	HP1	2.29	2.29	0
9	1	SPARE	0	10	0
11	1	SPARE OVEN	7.21	12	20/1
13	20/3	COOLER COMPRESSOR	1.33	16	1
15	1	SPARE	0	13	0
17	20/1	RECEPTACLE	1.33	18	1
19	20/1	DRINK COOLER FAN	0.72	1.1	21
21	20/2	BEER COOLER COOLING UNIT	1.1	1.1	2.63
23	1	DEU CASE	1.1	24	30/3
25	20/1	FREEZER COMPRESSOR	1.8	1.33	26
27	20/3	COKE COOLER CU	2.63	2.63	2.63
29	1	SPARE	0	30	30/3
31	1	COOLER	1.33	0.5	32
33	20/1	FREEZE	2.63	2.63	2.63
35	20/1	HOOD FIRE SYS	0.5	34	30/3
37	20/1	SMOKER	1	0.5	38
39	20/2	DRINK COOLER FAN	0.5	42	20/2
41	50/3	FRYER	5.77	5.77	44
43	1	DRINK COOLER FAN	1.1	1.1	1.1
45	1	DRINK COOLER FAN	1.1	1.1	1.1
47	20/2	COOLER FAN	5.77	50	20/2
49	1	FCUL	0.828	0.828	50
51	20/2	FCUL	0.828	50	20/2
53	1	SPARE	0	54	1

TOTAL CONNECTED		KVA BY PHASE		
		A	B	C
		45.1	59.3	38.9
		376	404	324

	CORN KVA	CALC KVA		CORN KVA	CALC KVA
LIGHTING	11.9	14.9	(125%)	1	1.25
LARGEST MOTOR	21.6	5.4	(25%)	21.8	21.8
OTHER MOTORS	66.6	66.6	(100%)	3	3
RECEPTACLES	14.1	12	(50%-10)	24.9	36.2
				0	0
				0	0
				0	0
				143	141
				392	

PA

Ckt #	Ckt BR	CIRCUIT DESCRIPTION	LOAD KVA		
			A	B	C
1	20/1	LIGHTING	0.536	0	2
3	20/1	SPARE	0	4	0
5	20/1	RECEPTACLE	0	0.72	6
7	20/1	SPARE	0	8	0
9	20/1	RECEPTACLE	0	0.36	10
11	20/1	TELEPHONE	0.8	12	20/1
13	20/2	C STORE SIGN	0.6	0.6	14
15	1	RECEPTACLE	0.6	0.6	16
17	20/1	RECEPTACLE	0.6	0.72	18
19	20/1	ICE	1.08	20	20/1
21	20/1	HOOD LIGHTS/CTRL	1.2	22	20/1
23	20/1	RECEPTACLE	0	24	20/1
25	20/1	RECEPTACLE	0.36	26	20/1
27	20/1	RECEPTACLE	0.18	28	20/1
29	20/1	RECEPTACLE	0.18	30	20/1
31	20/1	RECEPTACLE	1.08	32	20/1
33	20/1	RECEPTACLE	1.45	34	20/1
35	20/1	RECEPTACLE	0.36	36	20/1
37	20/1	RECEPTACLE	0.36	38	20/1
39	20/1	RECEPTACLE	1.45	40	20/1
41	20/1	LIGHTING	1.45	42	20/1

TOTAL CONNECTED		KVA BY PHASE		
		A	B	C
		9.02	10.9	8.74
		75.2	91	72.8


	CORN KVA	CALC KVA		CORN KVA	CALC KVA
LIGHTING	9.93	12.4	(125%)	0.8	1
LARGEST MOTOR	1.8	2.25	(125%)	0	0
OTHER MOTORS	1.6	1.6	(100%)	0	0
RECEPTACLES	13.4	11.7	(50%-10)	1.2	1.2
				0	0
				0	0
				0	0
				28.7	30.1
				85.6	

LA

Ckt #	Ckt BR	CIRCUIT DESCRIPTION	LOAD KVA		
			A	B	C
1	20/1	LIGHTING	0.313	1.45	2
3	20/1	RECEPTACLE	1.45	1.45	4
5	20/1	RECEPTACLE	0.18	1.45	6
7	20/1	RECEPTACLE	0.18	1.45	8
9	20/1	RECEPTACLE	0.18	1.45	10
11	20/1	RECEPTACLE	0.18	1.45	12
13	20/1	RECEPTACLE	0.18	1.45	14
15	20/2	OH SIGN	0.6	0.6	16
17	20/1	RECEPTACLE	0	0.6	18
19	20/1	SPARE	0	0	20
21	20/1	SPARE	0	0	22
23	20/1	SPARE	0	0	24
25	20/1	SPARE	0	0	26
27	20/1	SPARE	0	0	28
29	20/1	SPARE	0	0	30
31	20/1	SPARE	0	0	32
33	20/1	SPARE	0	0	34
35	20/1	SPARE	0	0	36
37	20/1	SPARE	0	0	38
39	20/1	SPARE	0	0	40
41	20/1	SPARE	0	0	42

TOTAL CONNECTED		KVA BY PHASE		
		A	B	C
		1.94	2.23	3.5
		16.2	18.8	29.3

	CORN KVA	CALC KVA		CORN KVA	CALC KVA
LIGHTING	1.51	1.89	(125%)	0	0
LARGEST MOTOR	0	0	(25%)	0	0
OTHER MOTORS	0	0	(100%)	29	2.9
RECEPTACLES	3.26	3.26	(100%-10)	0	0
				0	0
				0	0
				0	0
				72.7	80.5

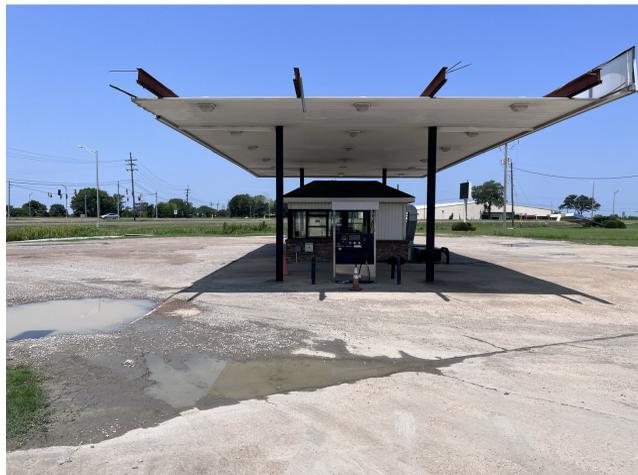

Existing Awning Structure to be Removed



Area of Underground Tank



Area of New Construction



North Extent of Site



Northeast Extent of Site



Area of New Construction



Utility Sub Structure



Existing Structure to be Demolished



Existing Pump to be Demolished

MS CONSTRUCTION LAW - 1. PURSUANT TO SECTION 73-1-39, PRIVATELY OWNED BUILDINGS THAT ARE THREE (3) STORIES IN HEIGHT OR MORE, OR BUILDINGS THAT ARE MORE THAN 5,000 SQUARE FEET, THE PROJECT IS SPECIFICALLY EXEMPTED BY SECTION 73-1-38, 2. PURSUANT TO SECTION 73-1-38, PUBLIC BUILDINGS OWNED BY THE STATE OF MISSISSIPPI IF THE PROJECT CONTAINS MORE THAN TEN THOUSAND (10,000) SQUARE FEET OF GROUND FLOOR AREA, OR IF THE PROJECT IS THREE (3) OR MORE STOREYS IN HEIGHT, UNLESS SPECIFICALLY EXEMPTED BY SECTION 73-1-38.

Paul Purser
5582

STAMP NOT VALID WITHOUT SIGNATURE

Dhunna Gas Station - Belzoni
Project No. 20230703001 Date 1/28/2024

PURSER & COMPANY | 601.376.9647 DRAWINGS@PURSERANDCOMPANY.COM

650 1st St, Belzoni, MS 39008
New Construction

Construction Documents		
Revision	#	Rev Date
SD	2	1/7/24

Existing Site Photos

V901
R